

1. 6:00 P.M. CoA2026-02 Forest Ave 245 Demo

Documents:

[COA2026-02 FOREST AVE 245 DEMO BACKUP.PDF](#)

Little, Shelby

From: Courtney Morrison <cmorrison@madearch.design>
Sent: Friday, January 23, 2026 1:41 PM
To: Little, Shelby
Cc: Karls Mundaray; Roy Fleeman; Kate Petri
Subject: RE: 245 Forest Ave - Stop Work
Attachments: We sent you safe versions of your files; Fleeman Remodel 245 Forest.tiff

Mimecast Attachment Protection has deemed this file to be safe, but always exercise caution when opening files.



Good afternoon, Shelby. Thank you for taking my call this morning. As discussed, below is a recap of how we got to where we are today.

In October of 2025 we submitted for and were approved by the Historic Planning Commission for a major remodel/addition to the existing house at 245 Forest Ave. The packet that was submitted and approved is attached here for your reference.

About a month after receiving HPC approval we submitted for permit and were approved without comments.

Between the HPC approval and permit submission, we continued to advance the drawings for construction and coordinate between myself, our structural engineer and our contractor. During this time it was determined that the existing foundations would not be adequate to support the addition of the proposed second story. So, we updated the drawings to facilitate the rebuilding of the foundations. That is what is reflected in the approved permit drawings.

During the HPC meetings the demolition scope was never mentioned or discussed. So, we updated it for the permit drawings understanding it would be reviewed and would either be approved or disapproved. The permit drawings were approved and we started construction. We were certainly not trying to deceive anyone or “pull a fast one” and get away with something. This is evident in the fact that there has not been any change to the front elevation design that was discussed, presented and approved at the HPC.

If you have any questions, or need additional information please let me know.

Thank you for your attention to this matter. We are hopeful for a quick resolution.

COURTNEY MORRISON, NCARB
FOUNDING ARCHITECT

470.387.9316
YouTube [@madearchitecture](#)
IG [@madearchitecture](#)
LinkedIn [@madearchitecture](#)
[www.madearchitecture.design](#)

MADE
ARCHITECTURE & DESIGN



1/21/26



1/21/26



MARIETTA HISTORIC PRESERVATION COMMISSION

205 Lawrence Street
Phone: 770.794.5669

Marietta, GA 30060
Fax: 770.794.5655

November 17, 2025
Courtney Morrison
MADE Architecture & Design
By Email: cmorrison@madearch.design

Re: 245 Forest Avenue NE- Limited Demolition, Partial New Construction, Additions, Material Change in Appearance

At the November 3, 2025, meeting of the Historic Preservation Commission (HPC), your certificate of appropriateness application for limited demolition, partial new construction, additions and material change in appearance was **APPROVED** as submitted. The certificate of appropriateness requested the following:

- Limited demolition and partial new construction at the existing single-family residence located at 245 Forest Avenue NE as described in the application and the architectural drawings included with the submission.

A motion to approve was made by commission member Steve Imler, second by commission member Chris Campbell and carried out by a vote of 6-0-0 (Forest Avenue Historic District members were absent).

Contact Permits and Inspections (770) 794-5454/5177 for information regarding the online permitting process if needed.

Please give Development Services a call if you have any questions.

Sincerely,

Sandra Lloyd

Administrative Assistant

Secretary to the Historic Board of Review
Department of Development Services
City of Marietta, GA

Cc By email: royfleeman@gmail.com; katepetri@gmail.com; bigdbrowne@yahoo.com;
jhoover423@gmail.com



RECEIVED Application for a Certificate of Appropriateness (COA)

Applicant:	Courtney Morrison	Phone Number:	404.735.2132
Email Address:	cmorrison@madearch.design	Parcel ID:	16116000850
Subject Property:	245 Forest Ave NE	Phone Number:	Roy: 770.274.9559
Property Owner:	Rov and Kate Fleeman		Kate: 404.610.9400


Type of Project Proposed:

- Demolition
- New Construction/Infill
- Additions
- Material Change in Appearance

Description of Proposed Project (attach additional sheets if necessary):

This project proposes limited demolition and partial new construction at the existing single-family residence located at 245 Forest Ave NE - per the included architectural drawings. The resulting addition would add increased living space on the ground floor and 3 new bedrooms and common space on the expanded second floor. The materials of the new home are proposed to be a combination of shake siding and lapped siding (6" and 4" exposure) and trim. This is similar to what is present on the existing house and surrounding homes in the Forest Hills Historic District. Care will be taken to ensure the fenestration is similar to what exists on the house today to create a cohesive visual in the neighborhood.

I hereby affirm that the information supplied on this application is correct and if found to be incorrect that any permit issued pursuant to this application may be void.

Signature:  Date: September 18, 2025

***Applicant/Owner/or Representative Must Be Present at the Historic Preservation Commission Meeting**

<i>To be completed by STAFF ONLY</i>	
HPC Hearing Date:	11/3/25
City Council Hearing Date: _____	
APPROVAL	
DENIAL	
Conditions:	
	
Chairman's Signature	Date

FLEEMAN RESIDENCE



245 FOREST AVE. REMODEL

OCTOBER 19, 2025

RECEIVED
10/19/25

CURRENT



PROPOSED



245 FOREST AVE. REMODEL

OCTOBER 19, 2025


RECEIVED
10/19/25

FRONT ELEVATION



245 FOREST AVE. REMODEL

RECEIVED
10/20/25
OCTOBER 19, 2025

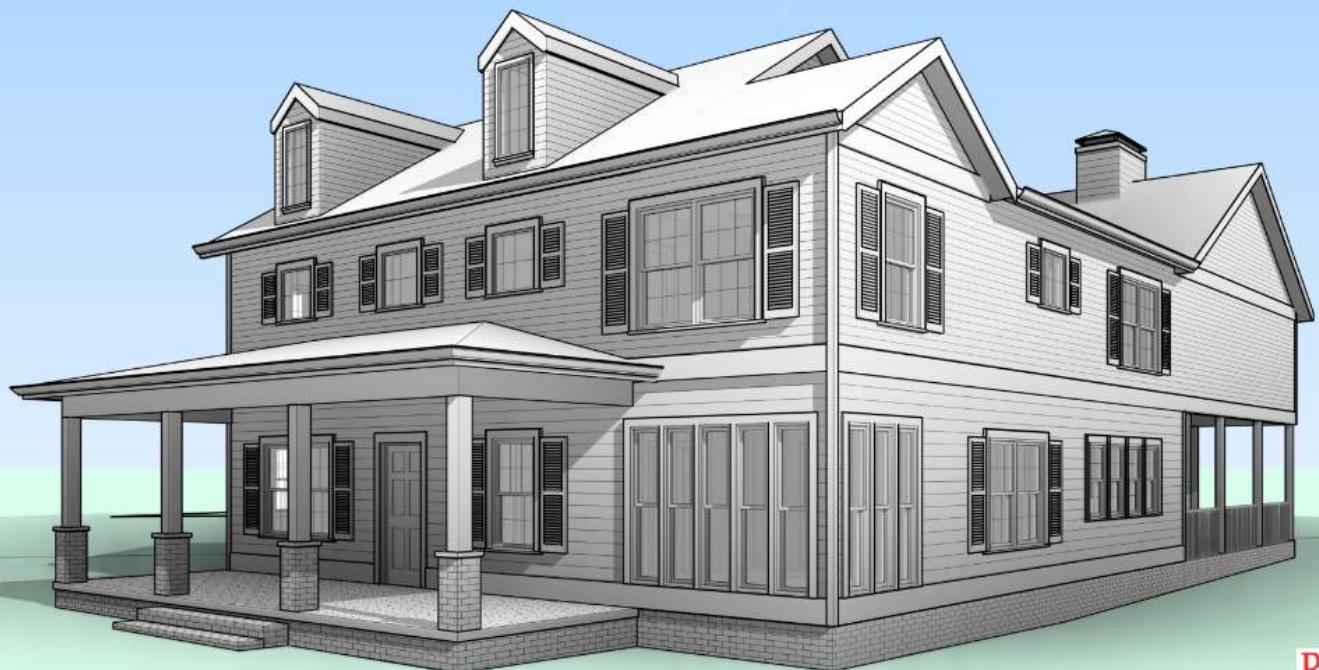

245 FOREST AVE. REMODEL

RECEIVED
10/20/25
OCTOBER 19, 2025

WEST (LEFT)



EAST (RIGHT)



245 FOREST AVE. REMODEL

OCTOBER 19, 2025

RECEIVED
10/20/25



THANK YOU

RECEIVED
10/20/25

Permit Number:

BLDG-2025-033828

Project Number:

BLDG2511065886

Permit Date:

12/10/2025



MUST BE POSTED ON JOB SITE

BUILDING PERMIT

Main #: 770-794-5659

Address:	245 FOREST AVE, MARIETTA, GA 30060	Subdivision :		
Lot # :		Suite # :		
Contractor :	Karls Mundaray	Contractor Contact # :	(470) 357-5865	
Inspection #	Type	Scheduled Date	Status	Status Date
INSP2025 11184697	Zoning, Final		Required	11/20/2025
INSP2025 11184794	Building, Final		Required	11/21/2025
INSP2025 11184795	Building, Footing		Required	11/21/2025
INSP2025 11184796	Building, Foundation Wall		Required	11/21/2025
INSP2025 11184797	Building, Framing		Required	11/21/2025
INSP2025 11184798	Building, Insulation		Required	11/21/2025
INSP2025 11184799	Building, Sheathing		Required	11/21/2025

This Project is for the remodel and addition to the existing residence. Include selective demolition and new construction per architectural and structural plans.

"The issuance of this permit authorizes improvements of the real property designated herein which improvements may subject such property to mechanics' and materialmen's liens pursuant to Part 3 of Article 8 of Chapter 14 of Title 44 of the Official Code of Georgia Annotated. In order to protect any interest in such property and to avoid encumbrances thereon, the owner or any person with an interest in such property should consider contacting an attorney or purchasing a consumer's guide to the lien laws which may be available at building supply home centers." Reference: O.C.G.A. 8-2-26(e)(2)

Comments

All Erosion & Sediment Control measures must be in place at all times during construction.


At anytime the proper Erosion & Sediment Control is not in place a Stop Work Order will be issued.

GENERAL NOTES:

- DO NOT SCALE DRAWINGS.
- VERIFY FIELD CONDITIONS PRIOR TO COMMENCEMENT OF EACH PORTION OF WORK. NOTIFY ARCHITECT IMMEDIATELY OF ANY DISCREPANCY FROM THE CONTRACT DOCUMENTS.
- THE CONTRACT DOCUMENTS ARE COMPLIMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE BINDING AS IF REQUIRED BY ALL. THE CONTRACTOR SHALL COORDINATE ALL PORTIONS OF THE WORK DESCRIBED IN THE CONTRACT DOCUMENTS. NOTIFY ARCHITECT FOR RESOLUTION OF ALL DISCREPANCIES PRIOR TO CONSTRUCTION.
- ANY DISCREPANCIES BETWEEN ARCHITECTURAL AND CONSULTANT DRAWINGS SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- PROVIDE SUBMITTALS FOR ALL EQUIPMENT, FIXTURES, MILLWORK, AND FINISHES. NO SUBSTITUTION WILL BE ACCEPTABLE WITHOUT SPECIFIC PRIOR APPROVAL OF THE ARCHITECT AND OWNER.
- ALL QUANTITIES SHALL BE VERIFIED PRIOR TO ORDERING.
- CONTRACTOR SHALL VERIFY COMPATIBILITY OF ALL ARCHITECTURAL CONDITIONS W/ APPLIANCES, EQUIPMENT, FIXTURES, HARDWARE, AND MOUNTING ACCESSORIES.
- ANY PORTIONS OF THE EXISTING CONDITION INTENDED FOR RE-USE (INCLUDING BUT NOT LIMITED TO EQUIPMENT, FIXTURES, HARDWARE, FINISHES, ETC) SHALL BE THOROUGHLY INSPECTED, CLEANED, SERVICED, REPAIRED AS NEEDED, UPGRADED TO COMPLY WITH CURRENT CODES, AND BROUGHT TO LIKE-NEW CONDITION BY CONTRACTOR. ALL EXISTING LIGHT FIXTURES SHALL BE RE-LAMPED BY CONTRACTOR. CONTRACTOR IS RESPONSIBLE FOR IDENTIFYING FULL SCOPE OF THIS WORK DURING THE BID PHASE, NOTIFYING ARCHITECT OF ANY WORK NOT DESCRIBED IN THE CONTRACT DOCUMENTS, AND INCLUDING THIS COST IN INITIAL CONTRACT SUM.
- GC TO VERIFY FEASIBILITY OF AND COORDINATE DELIVERY FOR ALL OWNER-PROVIDED ITEMS, INCLUDING LOADING ZONE ACCESS AND WIDTH OF ALL HALLWAYS, DOORS, ELEVATORS, ETC. ALONG ROUTE OF DELIVERY. CONTRACTOR IS RESPONSIBLE FOR IDENTIFYING FULL SCOPE OF THIS WORK DURING THE BID PHASE, NOTIFYING ARCHITECT OF ANY ISSUES, AND INCLUDING THIS COST IN INITIAL CONTRACT SUM.
- ALL ENVELOPE AND MECHANICAL CERTIFICATE OF ACCEPTANCE FORMS, AND ALL RELATED ACCEPTANCE DOCUMENTS SHALL BE PROVIDED AND SUBMITTED TO THE FIELD INSPECTOR DURING CONSTRUCTION AS REQUIRED.
- CONTRACTOR SHALL VERIFY ALL DIMENSIONS SHOWN ON THE DRAWINGS AND CONFIRM THOSE WITH MEASUREMENTS TAKEN IN THE FIELD. ANY DISCREPANCIES IN THE DRAWINGS SHOULD BE BROUGHT TO THE ARCHITECT'S ATTENTION IN WRITING.
- THE CONTRACTOR SHALL COORDINATE WITH THE OWNER FOR THE SELECTION OF ALL APPLIANCES AND RELATED ACCESSORIES. ALL COLORS, FINISHES, AND OPTIONS TO BE CONFIRMED BY OWNER.
- THE CONTRACTOR SHALL CONFIRM WITH THE OWNER THE SELECTION OF ALL INTERIOR FINISHES INCLUDING FLOOR COVERINGS AND UNDERLAYMENTS, PAINT, AND OTHER WALL COVERINGS, BASE, LAMINATES, TILE, ETC.
- THE CONTRACTOR SHALL CONFIRM WITH THE OWNER THE DESIGN, MATERIALS, FINISHES, AND HARDWARE OF ALL BUILT-IN MILLWORK AND CABINETRY AND SHALL SUBMIT SHOP DRAWINGS FOR LANDLORD AND ARCHITECT APPROVAL PRIOR TO FABRICATION.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF THE HVAC AND DISTRIBUTION SYSTEM AS REQUIRED. ALL SYSTEMS SHALL BE INSTALLED IN COMPLIANCE WITH GOVERNING CODES AND REGULATIONS.
- ADDITIONS AND ALTERATIONS MUST COMPLY WITH CURRENT CODE REQUIREMENTS FOR THE LOCATION OF SMOKE ALARMS AND CARBON MONOXIDE ALARMS (IRC314.3 AND 315.3) THROUGHOUT THE ENTIRE HOUSE.

FLEEMAN RESIDENCE REMODEL AND ADDITION

245 FOREST AVENUE NE, MARIETTA, GA 30060

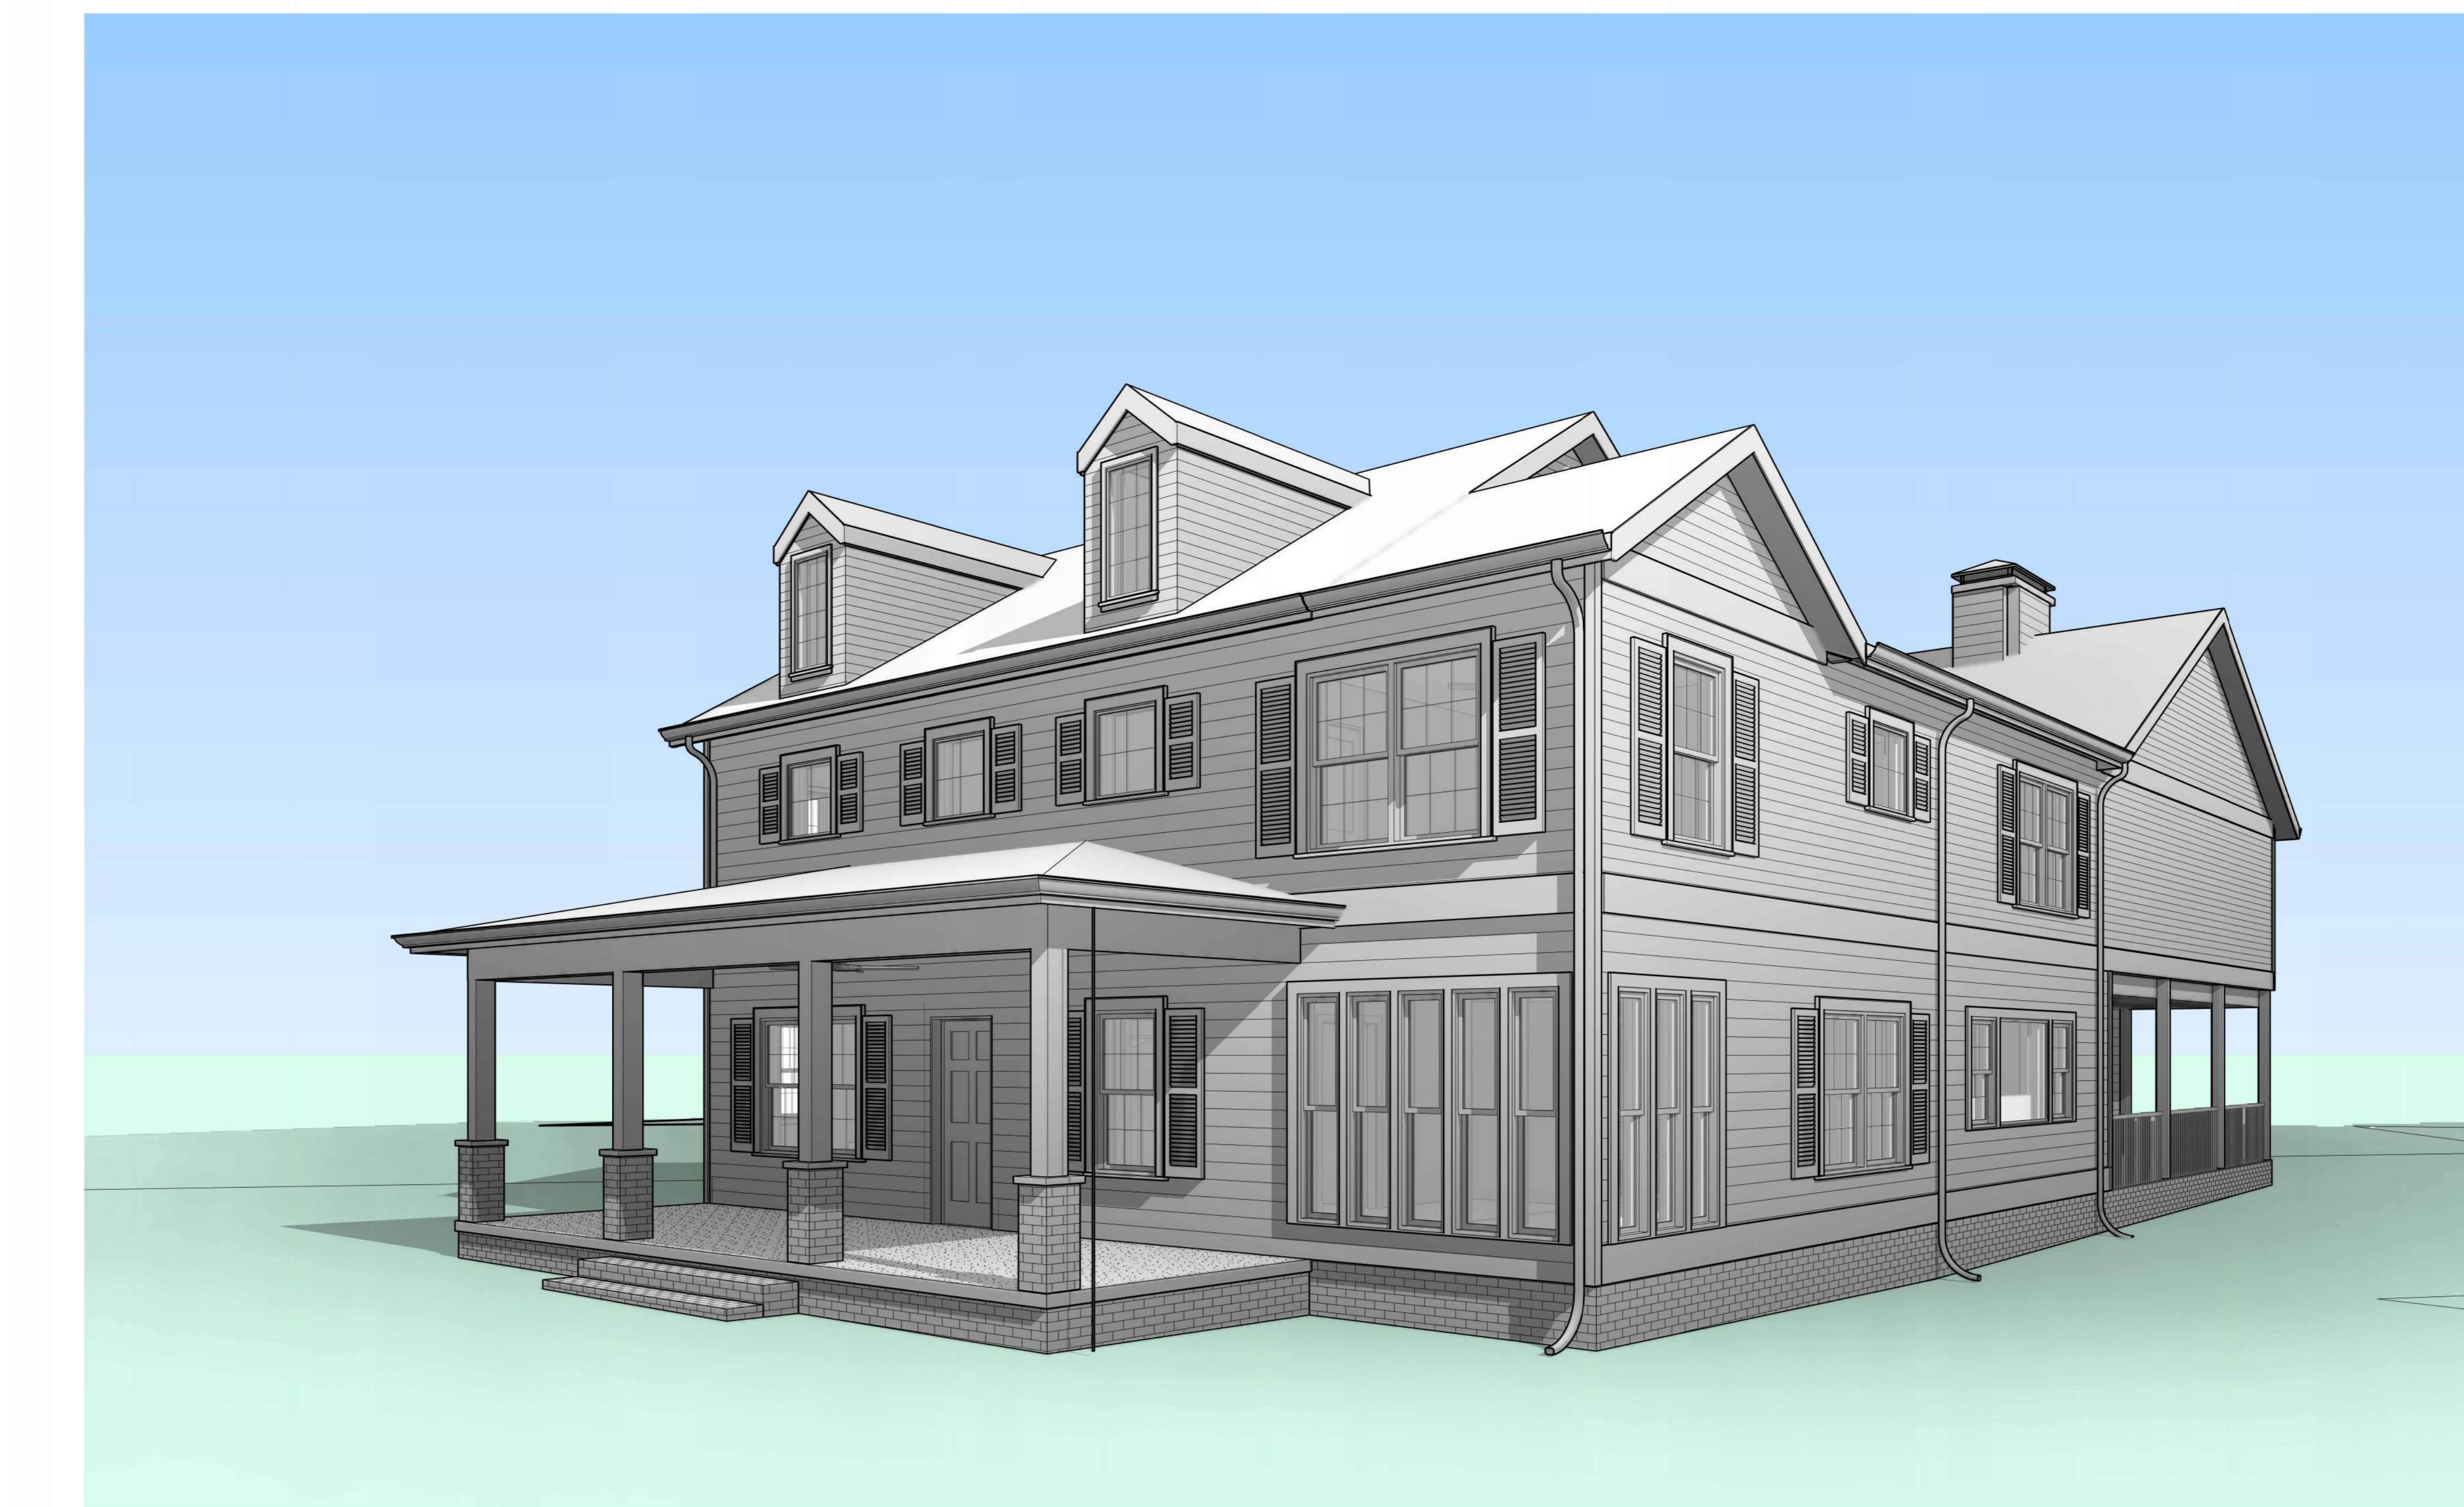245 FOREST AVE. NE
MARIETTA, GA 30060

PROJECT DESCRIPTION:

DESCRIPTION: THIS PROJECT IS FOR THE REMODEL AND ADDITION TO THE EXISTING RESIDENCE LOCATED AT THE ADDRESS 245 FOREST AVENUE NE, MARIETTA, GA 30060. THE BUILD-OUT WILL INCLUDE SELECTIVE DEMOLITION AND LIMITED NEW CONSTRUCTION PER THIS SET OF DRAWINGS.

REFER TO STRUCTURAL DRAWINGS FOR COMPLETE SCOPE.

AREA:

EXISTING:	NEW CONDITIONED SPACE:
EXISTING MAIN FLOOR: 2,566 SF	NEW MAIN FLOOR: 588 SF
EXISTING UPPER FLOOR: 680 SF	NEW UPPER FLOOR: 1,430 SF
EXISTING SF TOTAL: 3,246 SF	NEW SF TOTAL: 2,018 SF

TOTAL SF (EXISTING + NEW): 5,264 SF

ZONING:
R4 - FOREST HILLS HISTORIC DISTRICT

APPLICABLE CODES:

ALL WORK SHALL BE IN ACCORDANCE WITH THE FOLLOWING CODES AND ORDINANCES

RESIDENTIAL: INTERNATIONAL RESIDENTIAL CODE, 2018 EDITION, WITH GEORGIA AMENDMENTS (2020, 2024)

FIRE: INTERNATIONAL FIRE CODE, 2018 EDITION

PLUMBING: INTERNATIONAL PLUMBING CODE, 2018 EDITION, WITH GEORGIA AMENDMENTS (2020, 2022, 2023, 2024)

MECHANICAL: INTERNATIONAL MECHANICAL CODE, 2018 EDITION, WITH GEORGIA AMENDMENTS (2020, 2024)

FUEL GAS: INTERNATIONAL FUEL GAS CODE, 2018 EDITION, WITH GEORGIA AMENDMENTS (2020, 2022)

ELECTRICAL: NATIONAL ELECTRICAL CODE, 2023 EDITION

ENERGY: INTERNATIONAL ENERGY CONSERVATION CODE, 2015 EDITION, WITH GEORGIA SUPPLEMENTS AND AMENDMENTS (2020, 2022, 2023)

ACCESSIBILITY: GEORGIA ACCESSIBILITY CODE 120-3-20

LIFE SAFETY: 2024 NFPA 101 LIFE SAFETY CODE

NOTHING IN THESE DRAWINGS SHALL BE TAKEN AS PERMITTING OR PROPOSING WORK NOT CONFORMING TO THESE CODES AND REGULATIONS

Sheet List

Sheet Number	Sheet Name
A000	COVERSHEET
A001	SCHEDULES
A100	SITE PLAN
A101	EXISTING & DEMO MAIN LEVEL PLAN
A102	EXISTING & DEMO UPPER LEVEL PLAN
A103	NEW LOWER LEVEL PLAN
A104	NEW UPPER LEVEL PLAN
A105	ROOF PLAN
A201	NEW LOWER LEVEL R.C.P.
A202	NEW UPPER LEVEL R.C.P.
A401	ELEVATIONS
A402	ELEVATIONS
A403	ELEVATIONS & DETAILS
A404	ELEVATIONS
S001	GENERAL NOTES
S002	GENERAL NOTES
S003	GENERAL NOTES
S004	GENERAL NOTES
S101	FOUNDATION PLAN
S201	FIRST FLOOR FRAMING PLAN
S202	FIRST LEVEL WALL FRAMING PLAN
S203	SECOND FLOOR FRAMING PLAN
S204	SECOND LEVEL WALL FRAMING PLAN
S301	ROOF FRAMING PLAN
S401	BRACING WALL SCHEDULES & DETAILS
S402	WALL FRAMING SCHEDULES & DETAILS
S403	WALL FRAMING & BEAM PENETRATIONS
S601	FOUNDATION SECTIONS & DETAILS
S701	FLOOR FRAMING SECTIONS & DETAILS
S801	ROOF FRAMING SECTIONS & DETAILS

MADE
ARCHITECTURE & DESIGN

www.madearchitecture.design

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearchitecture.com

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com



November 14, 2025

Issuances

No.	Description	Date
Schematic Design	8/29/2025	
Design Development	9/16/2025	
Historic Board Review	9/18/2025	
Issued for Permit	11/14/2025	

COVERSHEET

Project number 20250505

Date November 14, 2025

Drawn by CM

Checked by CM

A000

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com




November 14, 2025

Issuances		
No.	Description	Date
	Schematic Design	8/29/2025
	Design Development	9/16/2025
	Historic Board Review	9/18/2025
	Issued for Permit	11/14/2025

Project number	20250505
Date	November 14, 2025
Drawn by	CM
Checked by	CM

A100

1/8" = 1'-0"

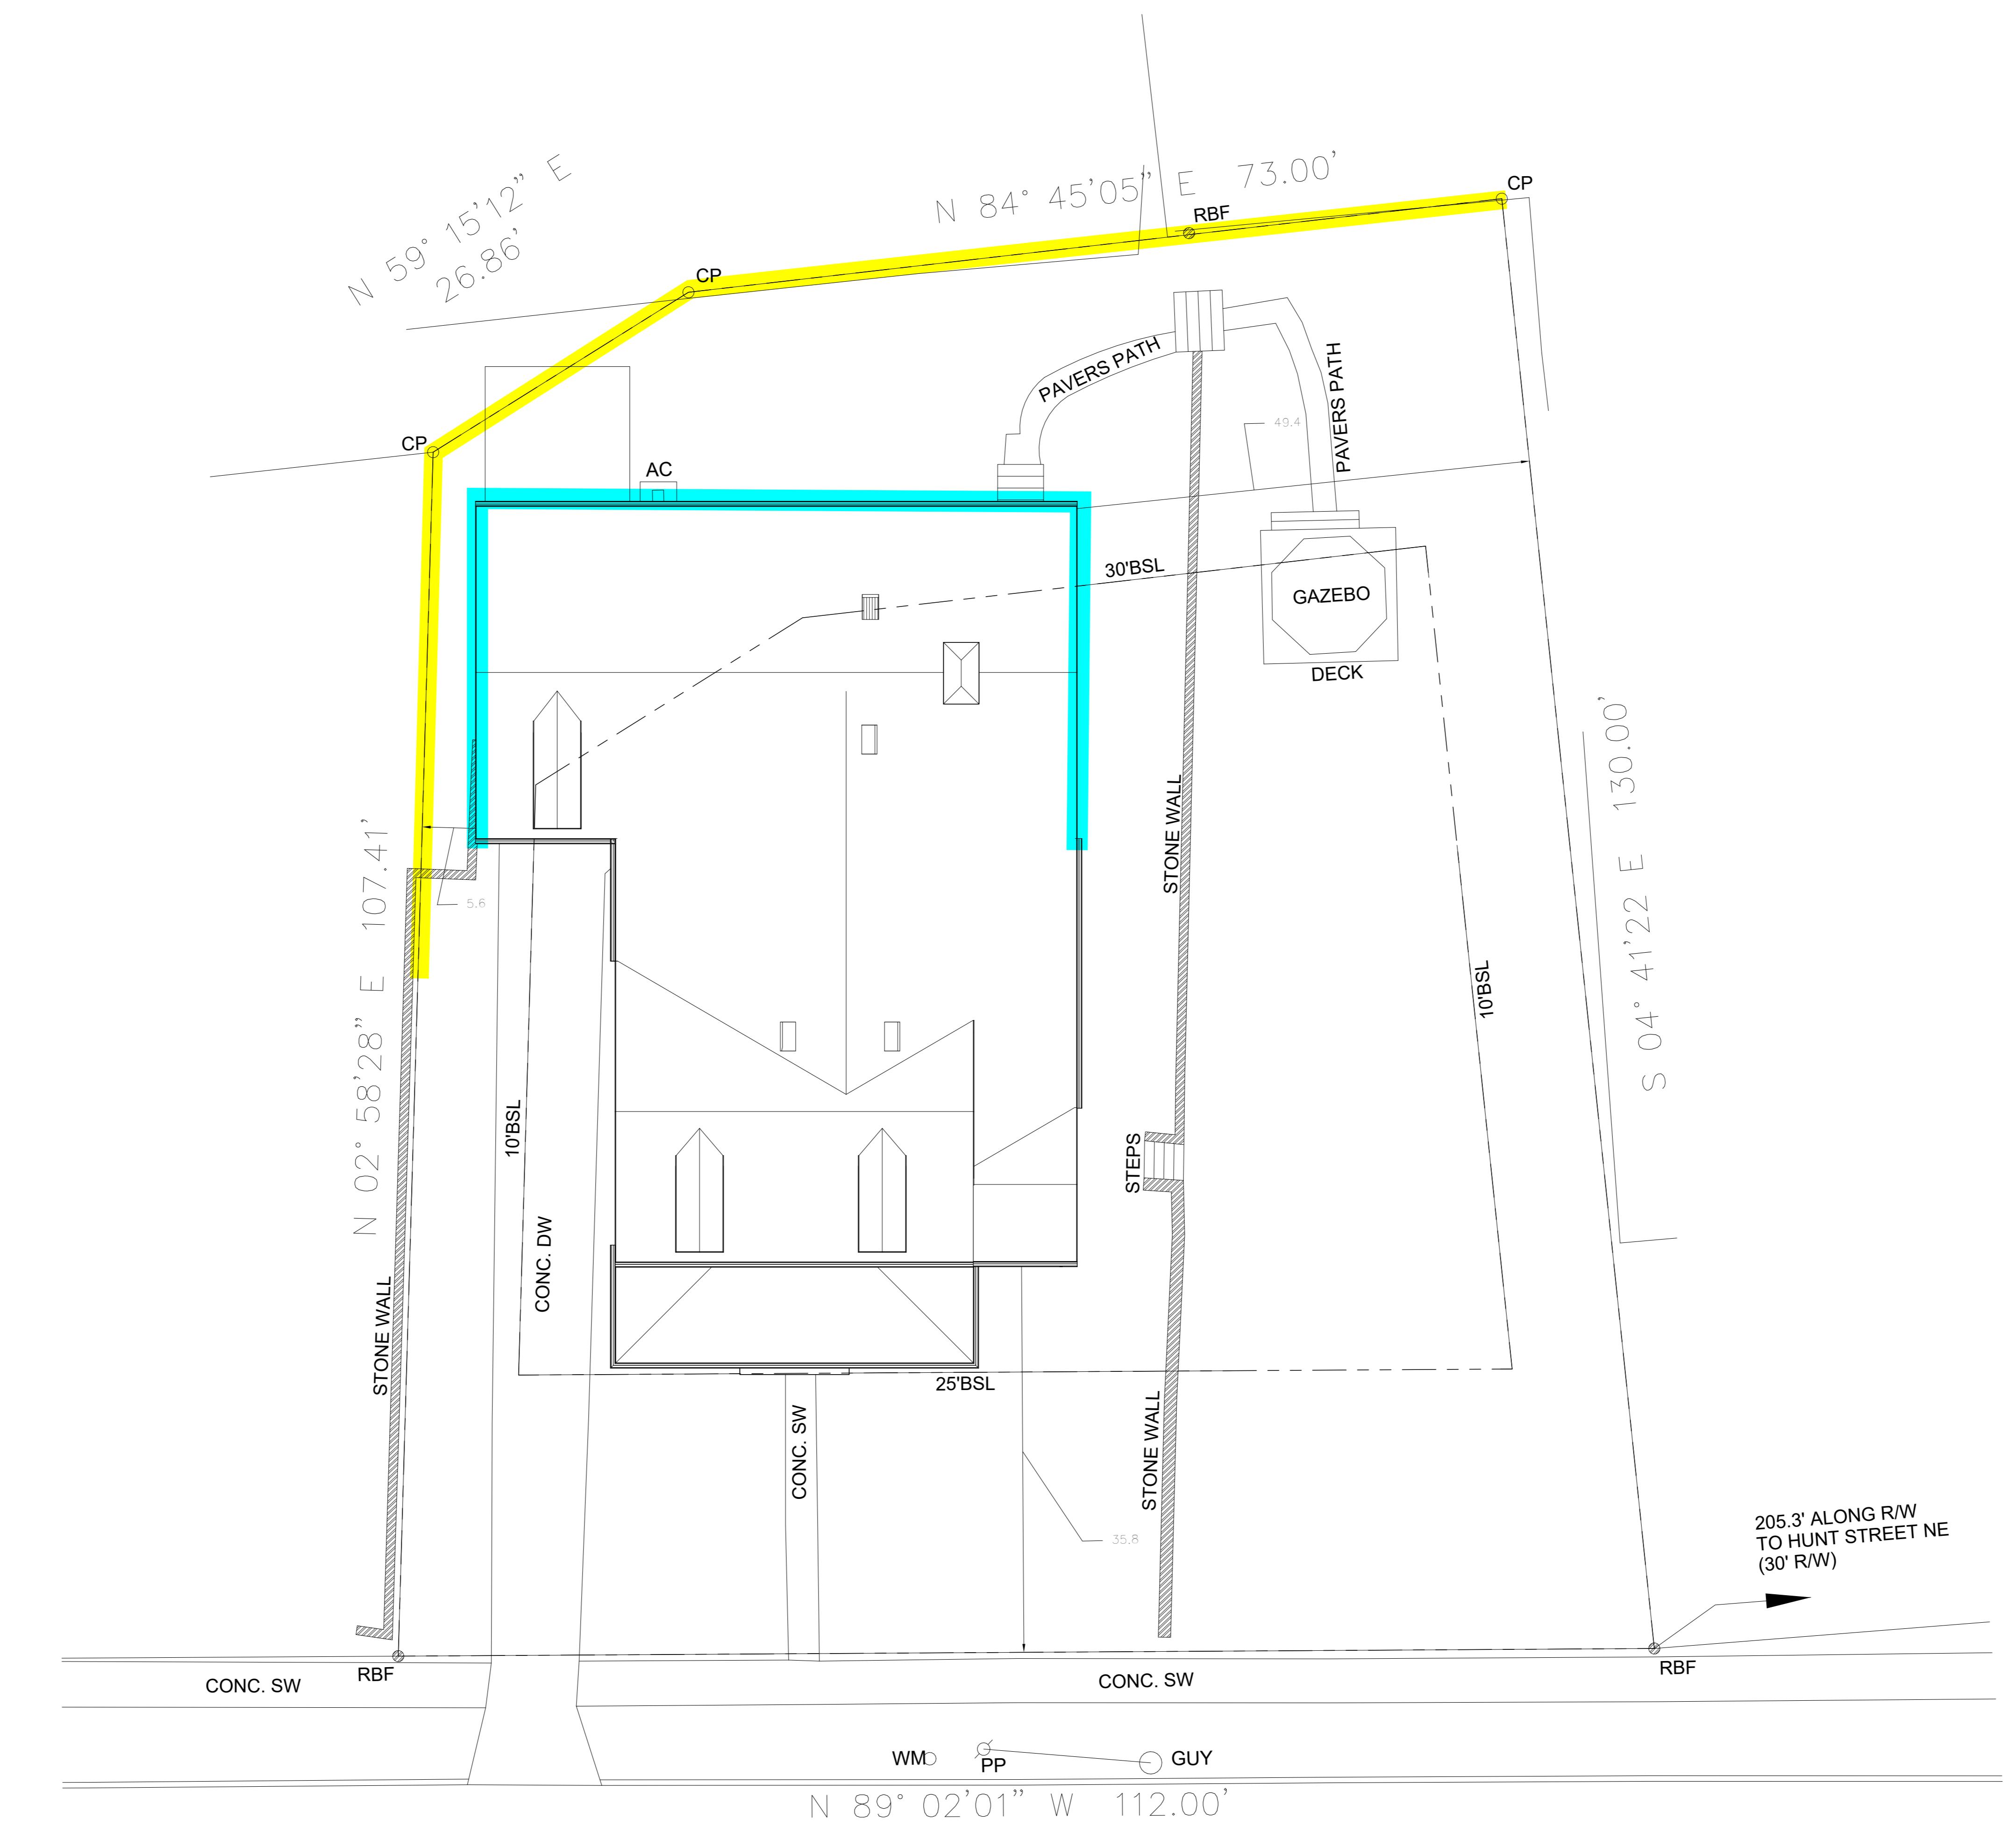





FLOOR PLAN NOTES:

- DO NOT SCALE THESE DRAWINGS
- ALL DIMENSIONS TO BE VERIFIED IN THE FIELD
- ALL DIMENSIONS SHOWN ARE FROM **FACE OF GYP** AT EXISTING WALLS TO **FACE OF STUD** AT NEW WALLS.

WALL LEGEND

SYMBOL	DESCRIPTION	ASSEMBLY
Grey	EXISTING PARTITION	EXISTING PARTITION, V.I.F.
Pink	2X4 NOMINAL INTERIOR PARTITION	2X4 NOMINAL WOOD STUD 1/2" GYPSUM BOARD ON EACH SIDE
Blue	2X4 ACTUAL INTERIOR PARTITION	2X4 ACTUAL WOOD STUD 5/8" PLASTER ON EACH SIDE
Yellow	2X6 NOMINAL INTERIOR PARTITION	2X6 NOMINAL WOOD STUD 1/2" GYPSUM BOARD ON EACH SIDE
Orange	2X6 NOMINAL EXTERIOR	2X6 NOMINAL WOOD STUD 1/2" GYPSUM INTERIOR SIDE. 1/2" EXTERIOR SHEATHING. WEATHER-RESISTANT MEMBRANE REFER TO ELEVATIONS FOR FINISH
Green	2X4 NOMINAL EXTERIOR	2X4 NOMINAL WOOD STUD 1/2" GYPSUM BOARD ON EACH SIDE 1/2" EXTERIOR SHEATHING. WEATHER-RESISTANT MEMBRANE REFER TO ELEVATIONS FOR FINISH

MADE
ARCHITECTURE & DESIGN

www.madarchitecture.design

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com



November 14, 2025

Issuances		
No.	Description	Date
Schematic Design	8/29/2025	
Design Development	9/16/2025	
Historic Board Review	9/18/2025	
Issued for Permit	11/14/2025	

NEW LOWER LEVEL PLAN

Project number	20250505
Date	November 14, 2025
Drawn by	CM
Checked by	CM
Scale	As indicated

A103



PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com



November 14, 2025


Issuances		
No.	Description	Date
Schematic Design	8/29/2025	
Design Development	9/16/2025	
Historic Board Review	9/18/2025	
Issued for Permit	11/14/2025	

ROOF PLAN

Project number 20250505
Date November 14, 2025
Drawn by CM
Checked by CM

A105

Scale 1/4" = 1'-0"

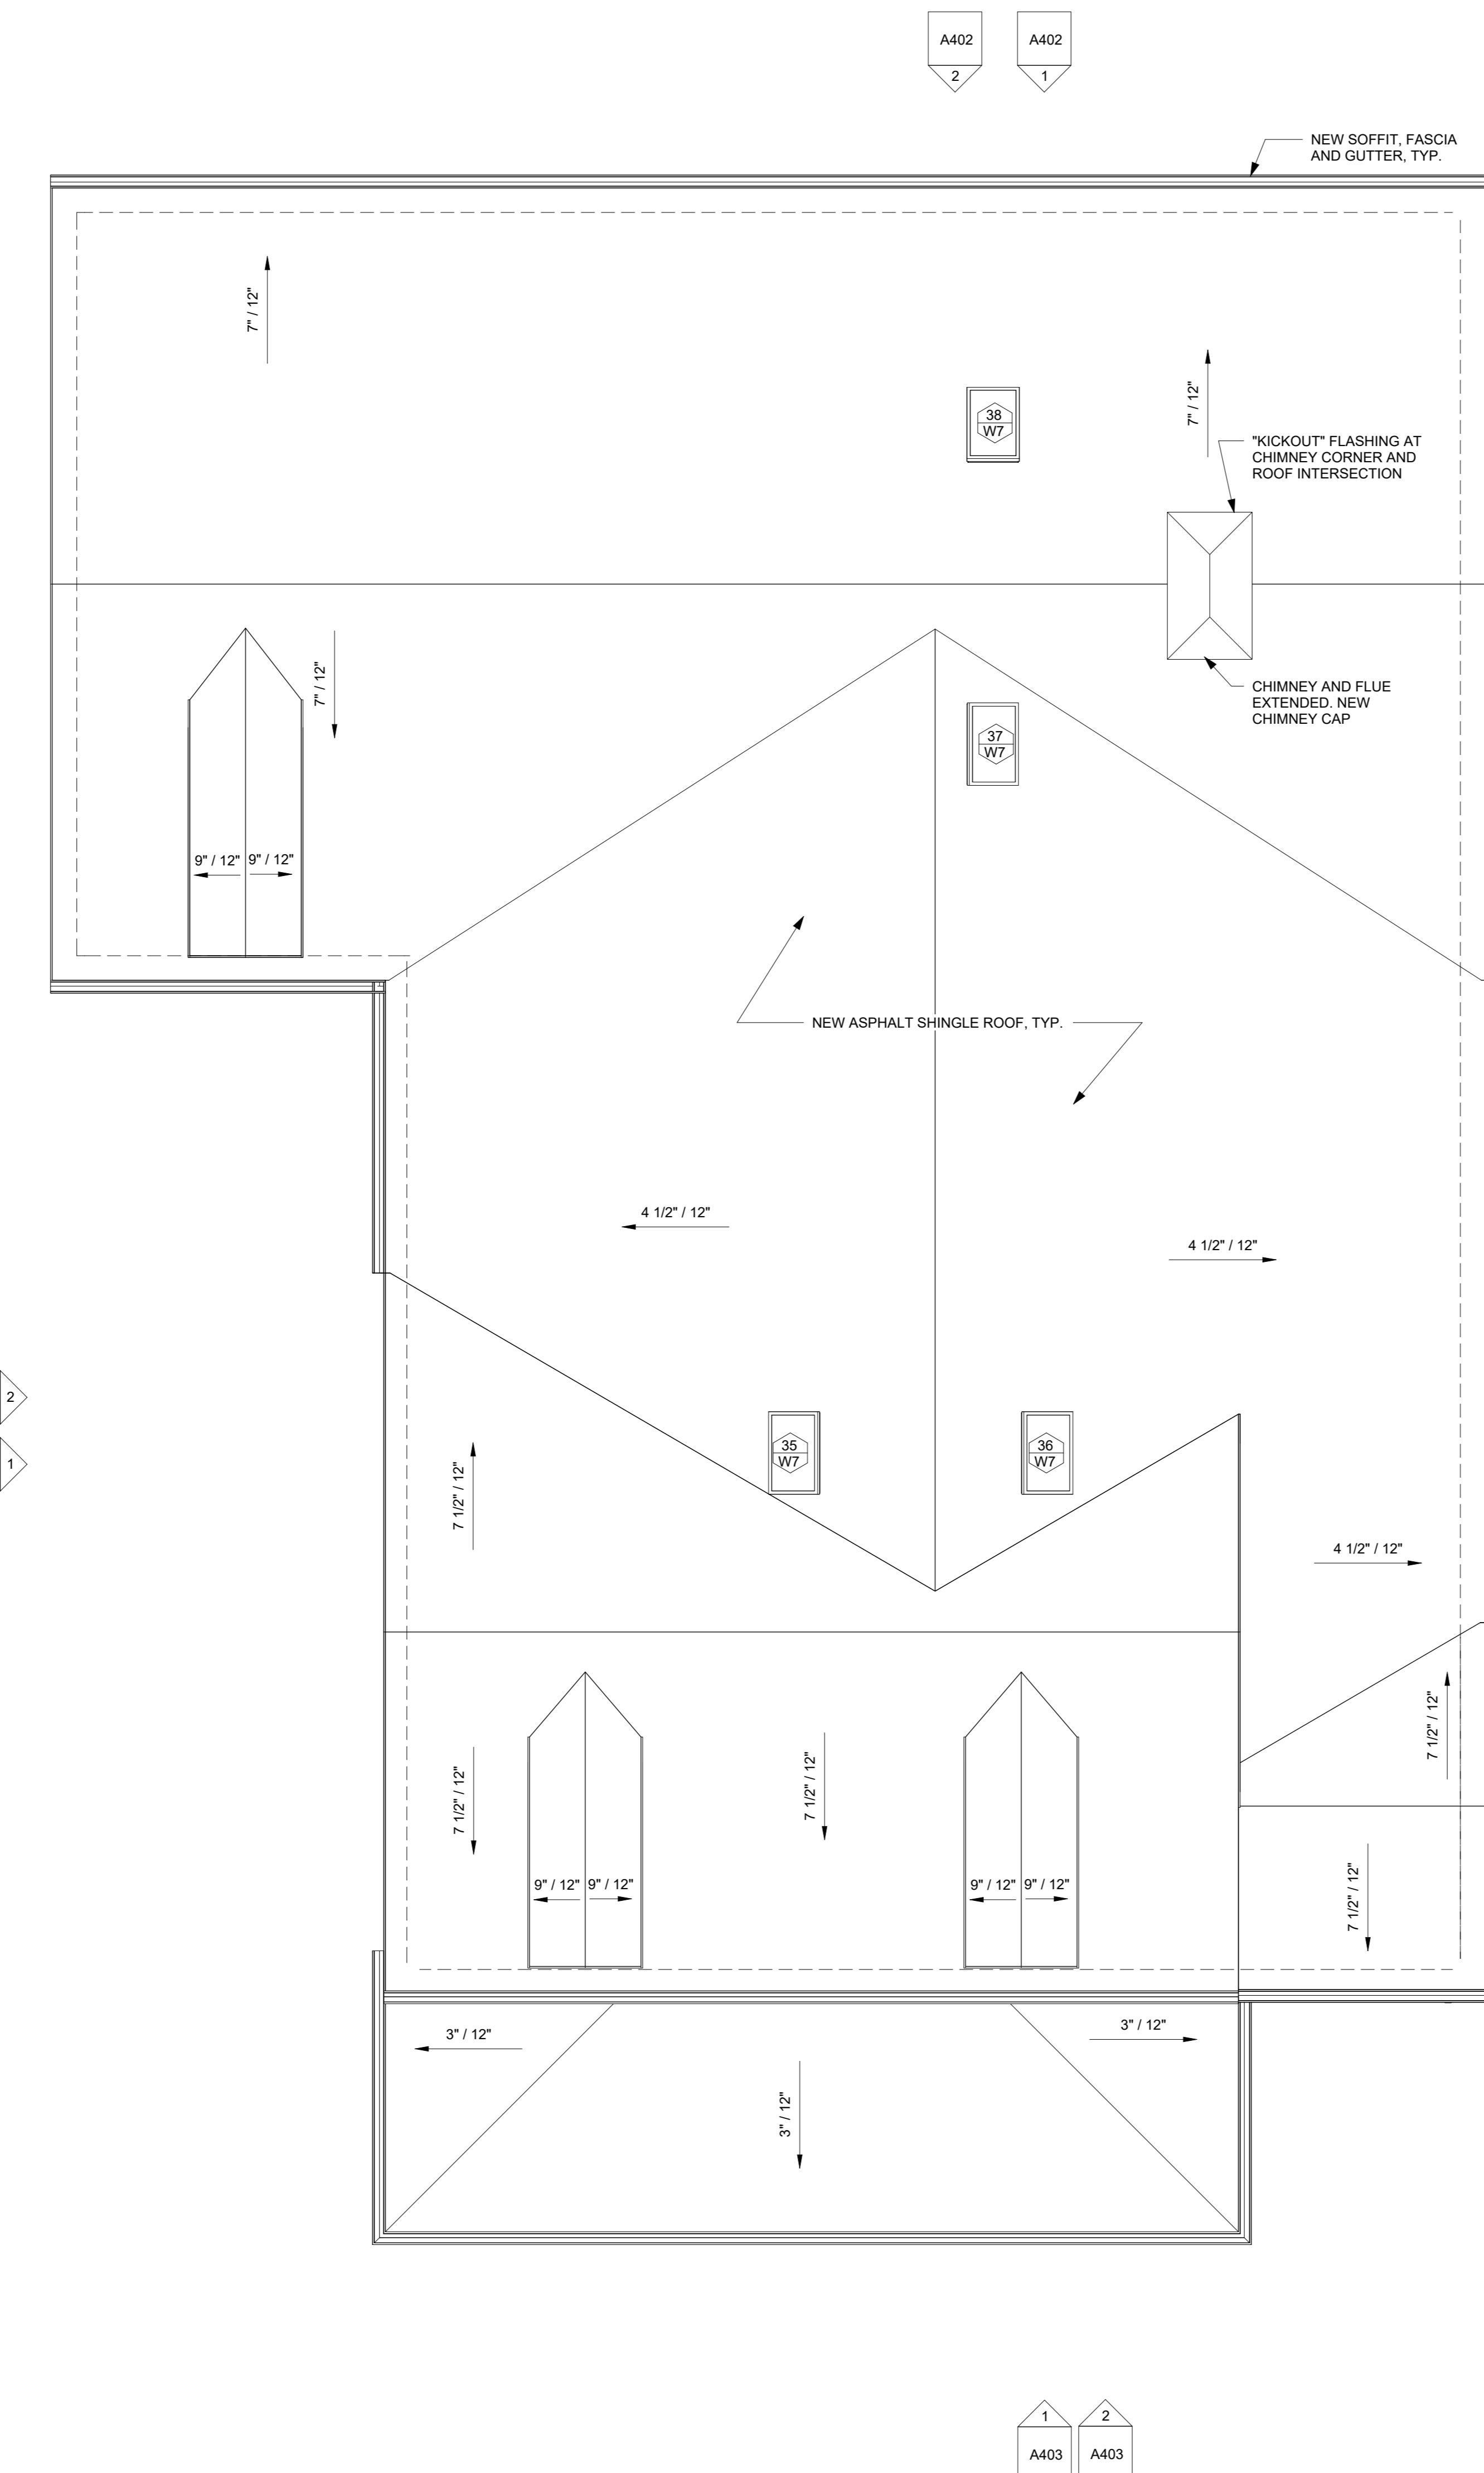


PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

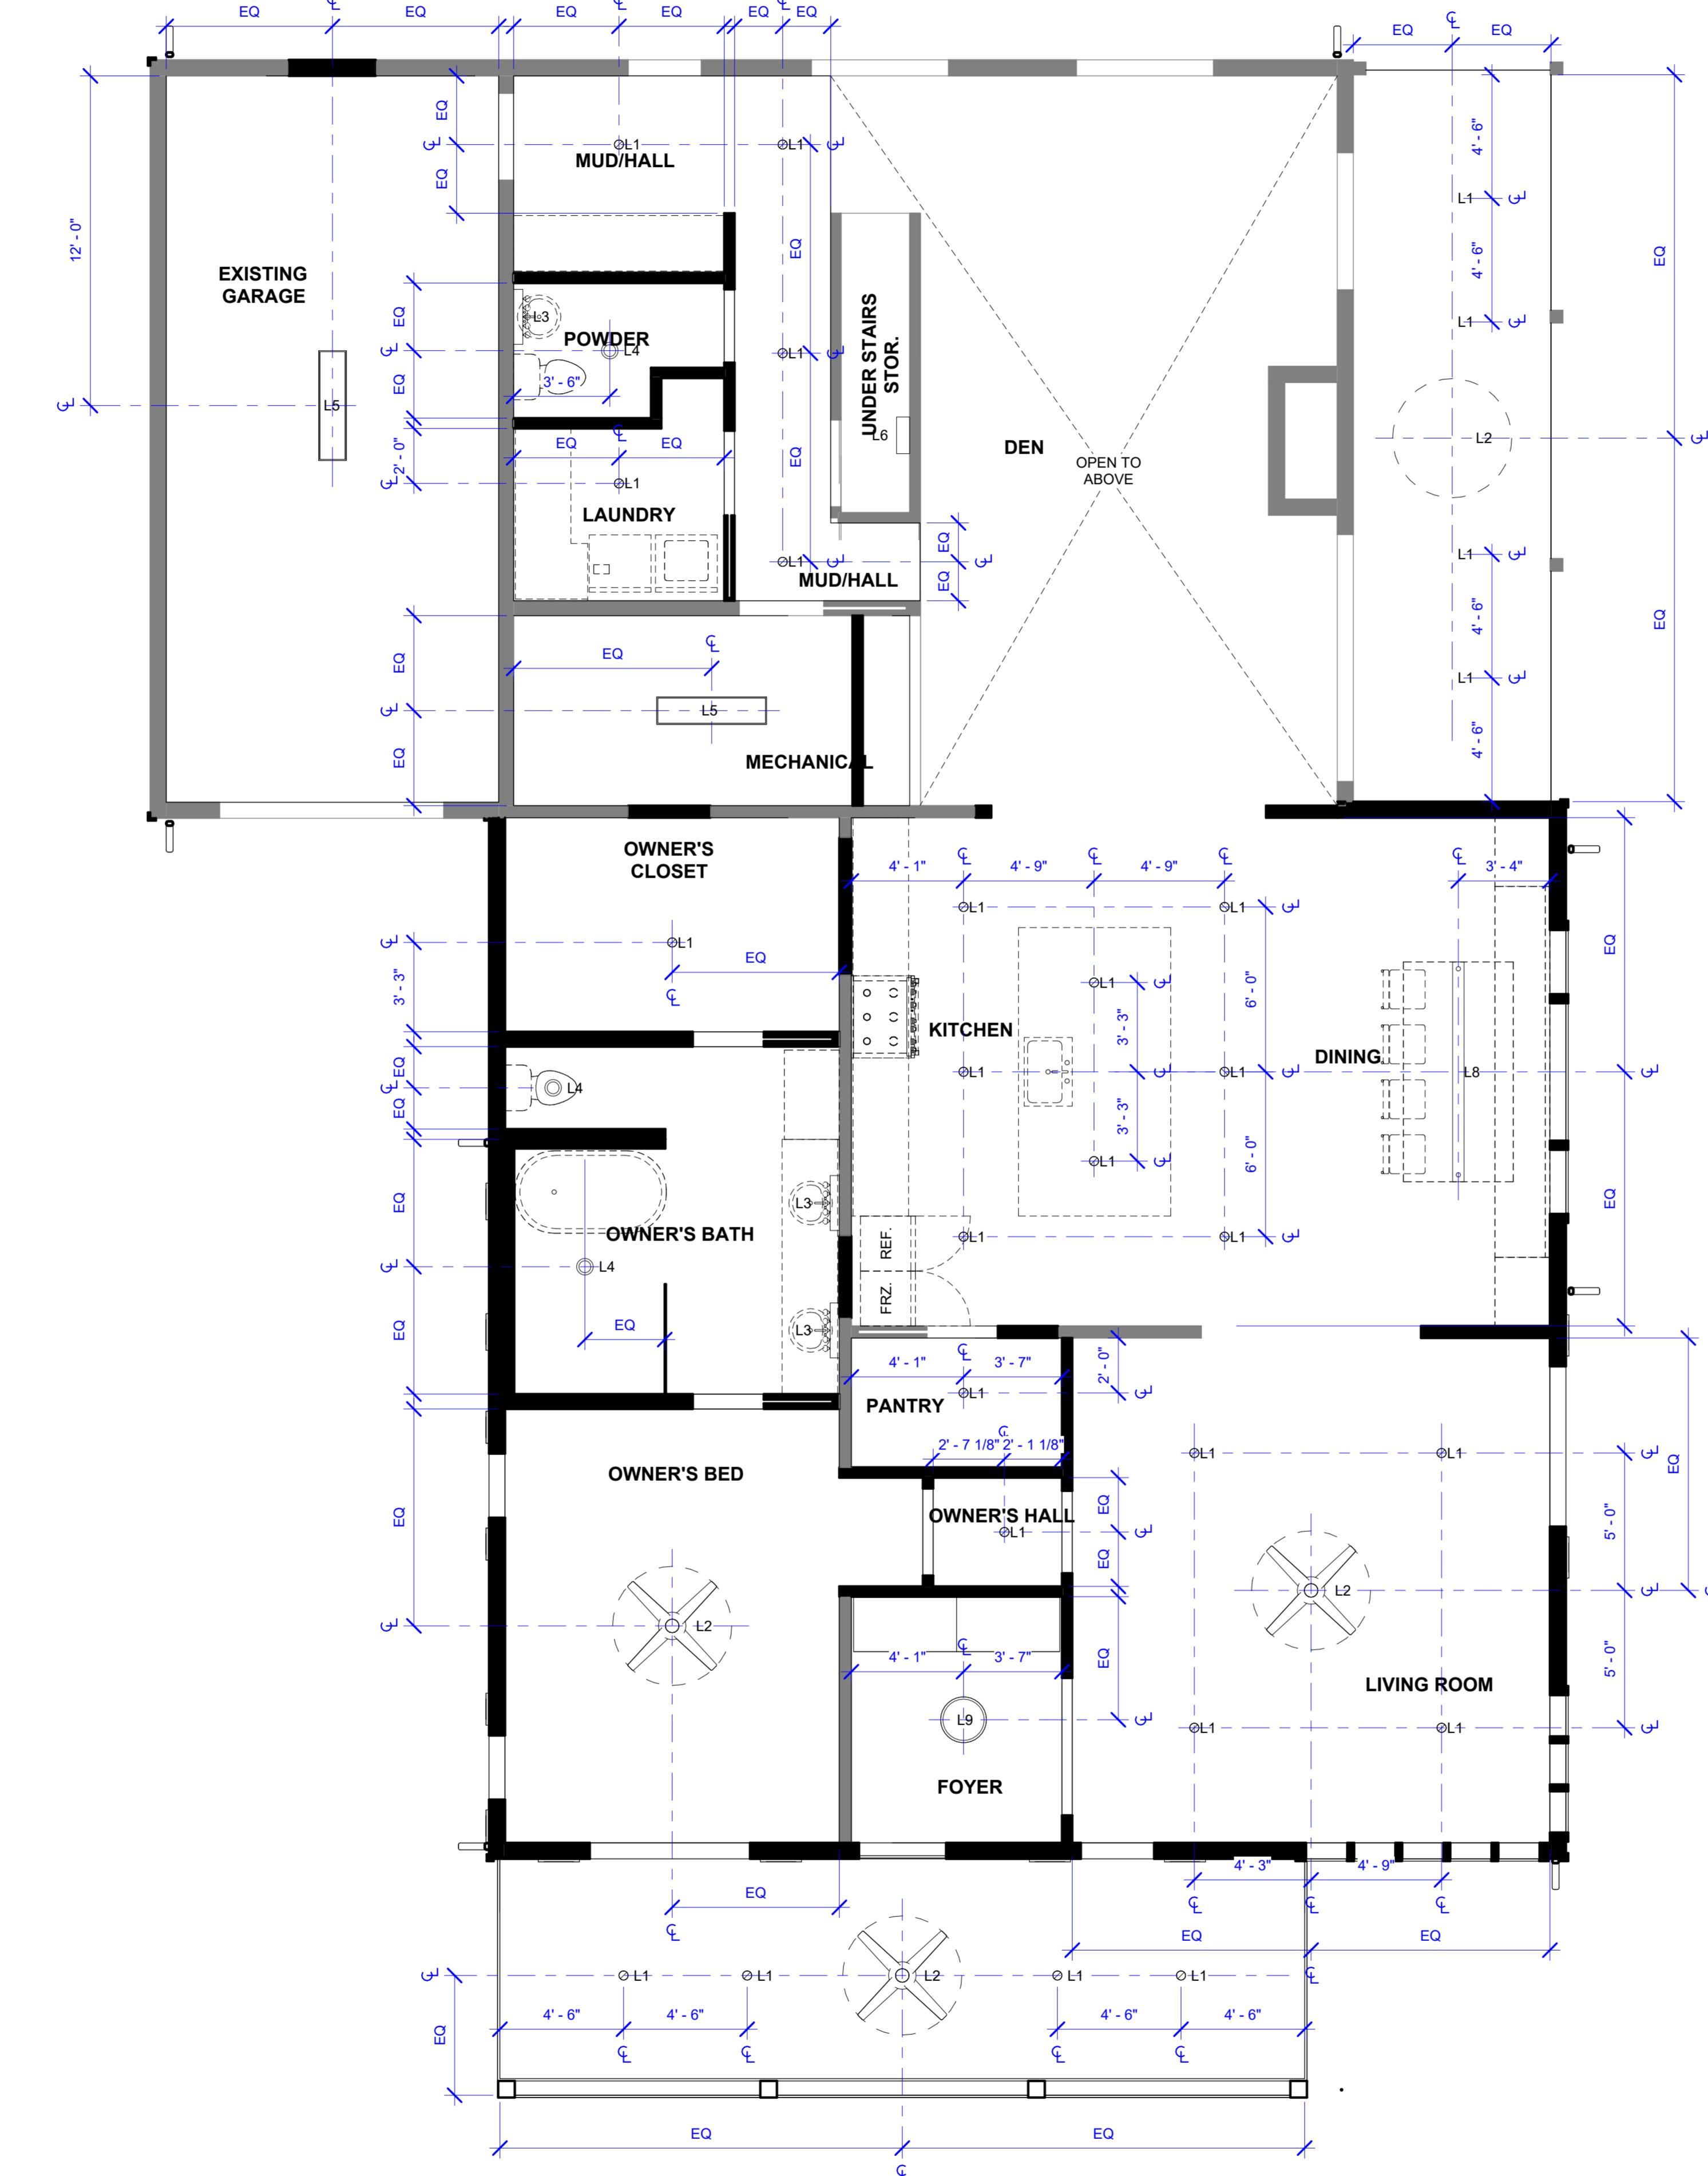

1 First F
1/4" =

NEW LOWER LEVEL R.C.P.

ject number	20250505
e	November 14, 2025
wn by	CM
ecked by	CM


A201

PROJECT: Fleeman Residence Remodel & Addition
Forest Avenue NE
Atlanta, GA 30060

CHITECT: Made Architecture, LLC
rtney Morrison, NCARB
Maple Avenue, NW
etta, GA 30064
735.2132
morrison@madearch.design

HERS: Roy and Kate Fleeman
Hunt Street NE
Atlanta, GA 30060
: 770.274.9559
e: katefleeman@gmail.com
e: katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
123 Thomas Road
Marietta, GA 30528
(404) 969.5636
mfernandez@fernz-structural.com

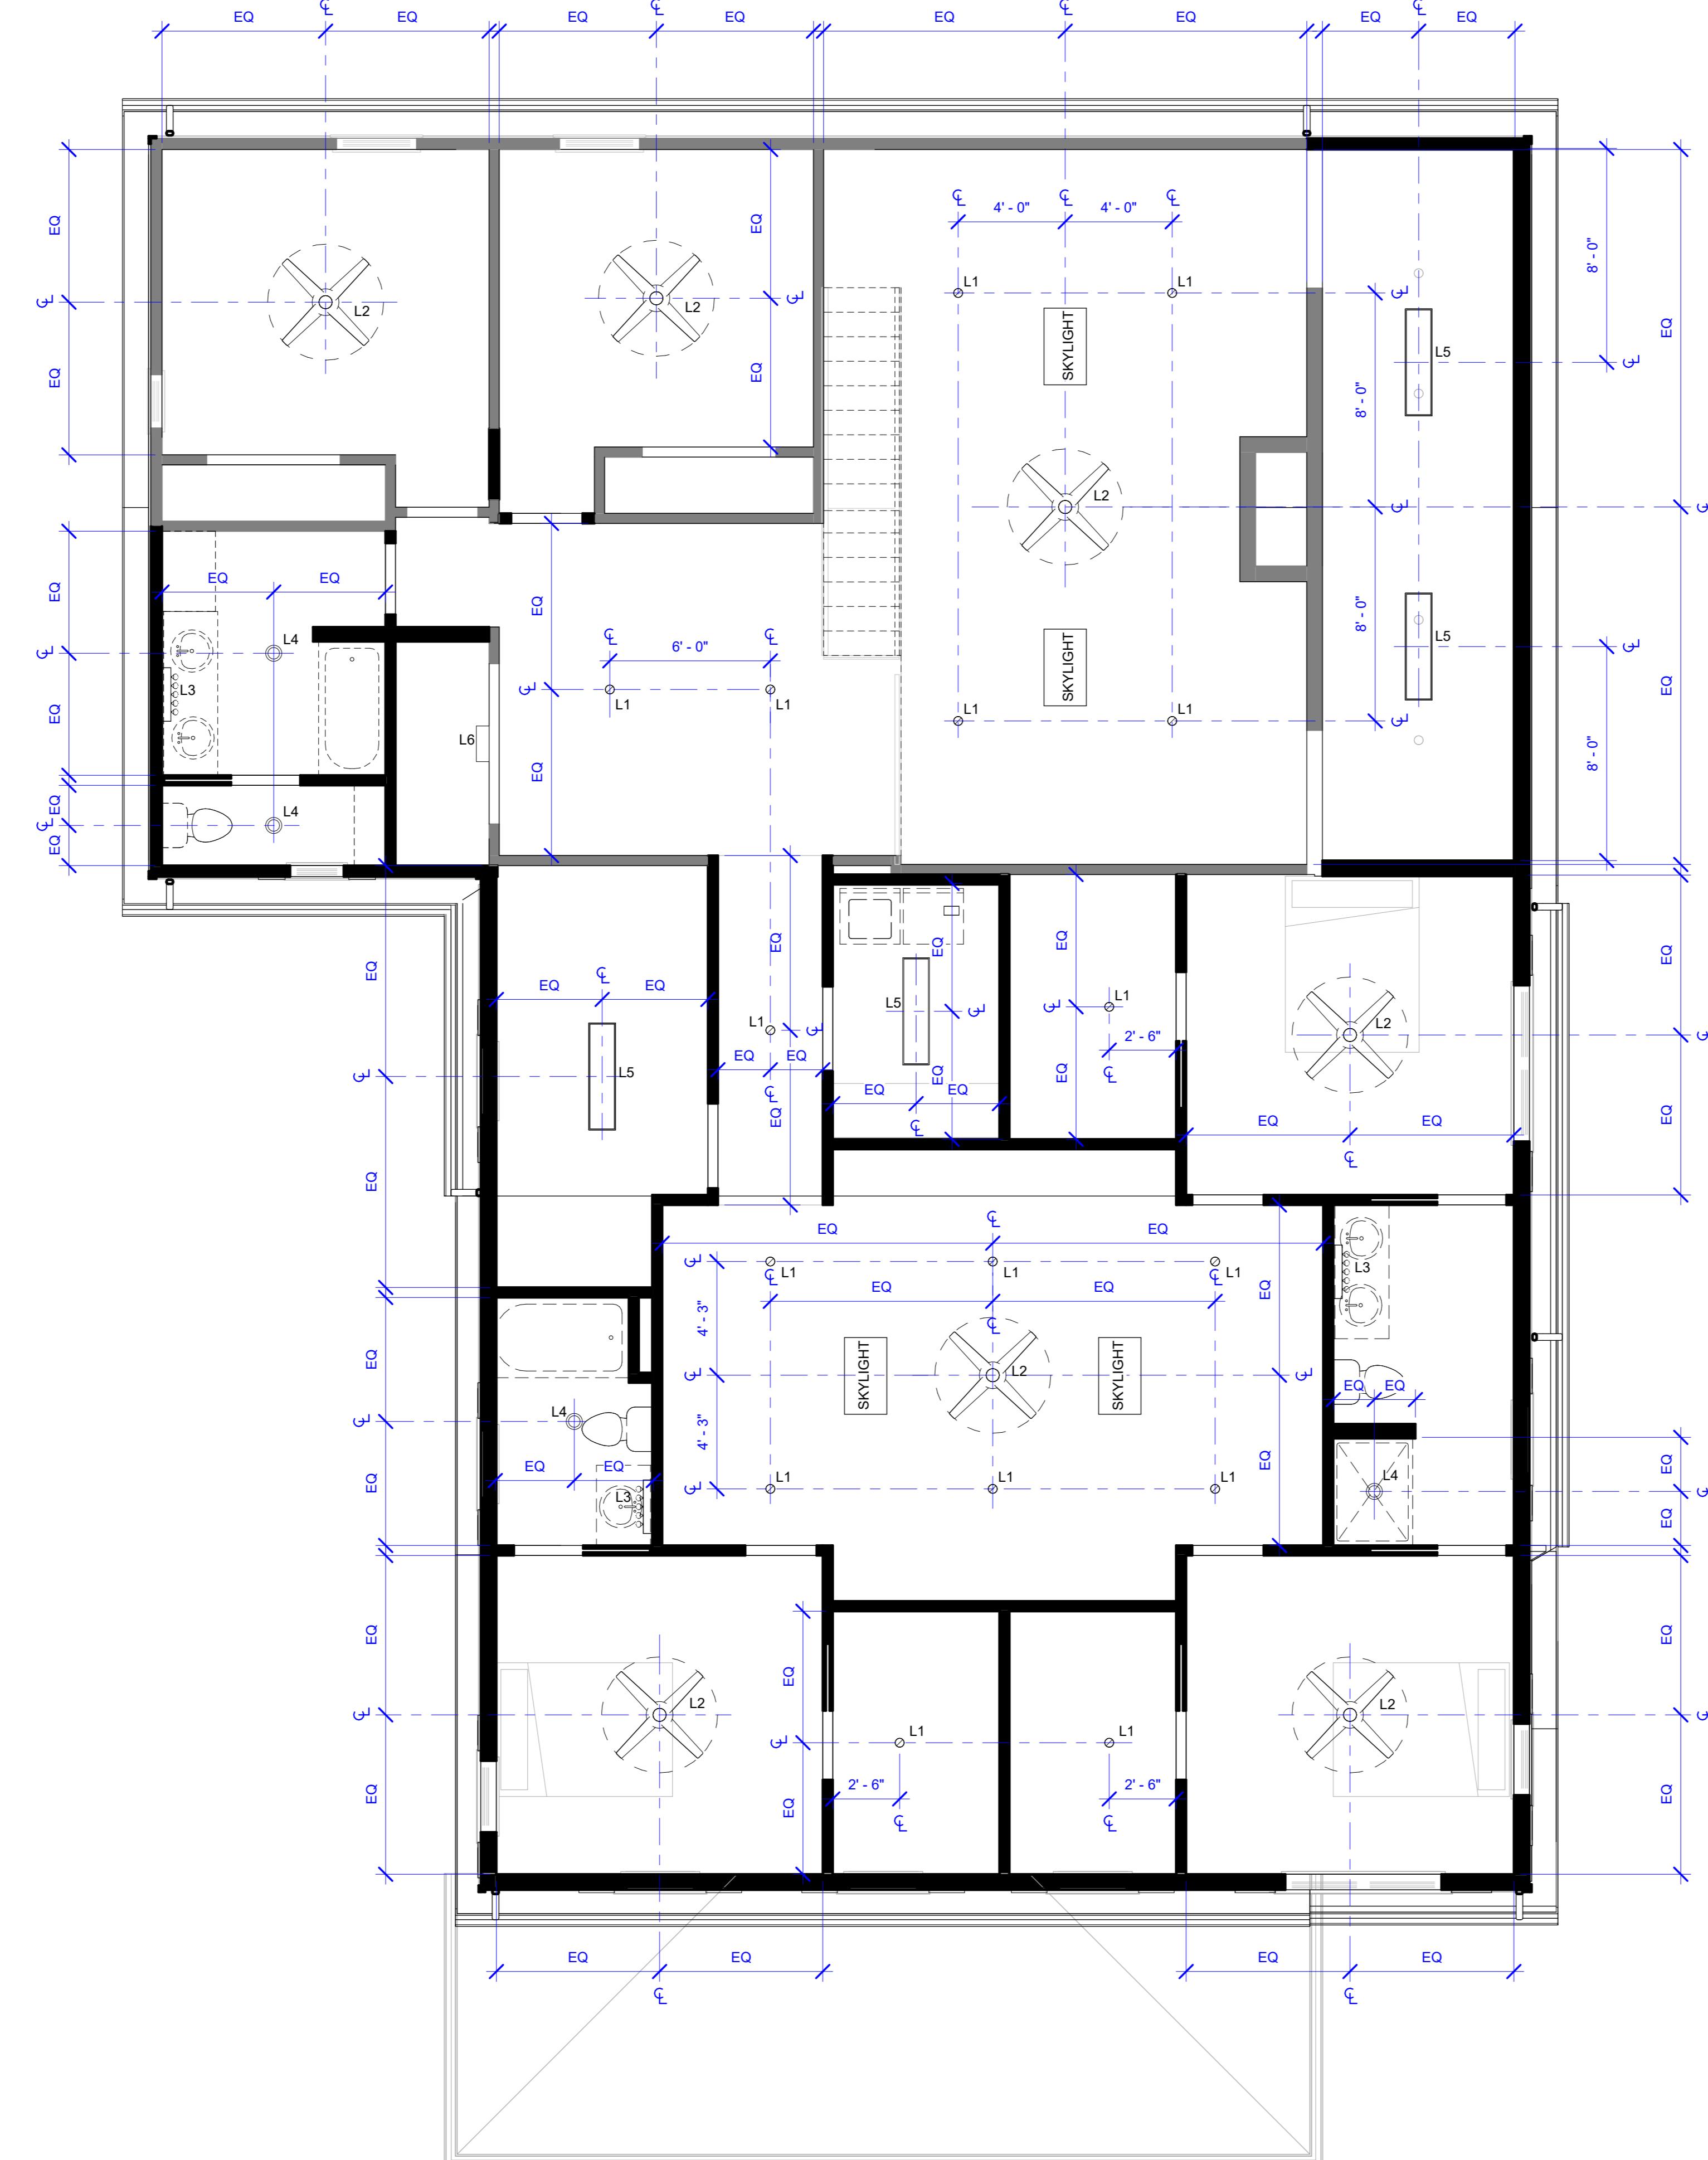

1 Second Floor
1/4" = 1'-0"

NEW UPPER LEVEL R.C.P.

number	20250505
	November 14, 2025
by	CM
ed by	CM


A202

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.com

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

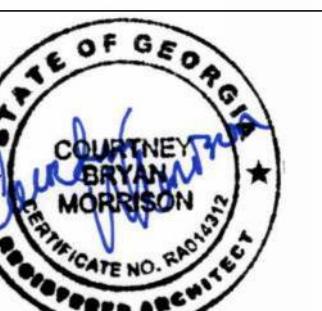

November 14, 2025

Issuances

No.	Description	Date
	Design Development	9/16/2025
	Historic Board Review	9/18/2025
	Issued for Permit	11/14/2025

ELEVATIONS

Project number	20250505
Date	November 14, 2025
Drawn by	CM
Checked by	CM

A401

Scale As indicated



② East - Color
1/4" = 1'-0"



ELEVATION NOTES
1. ALL TRIM TO BE 5/4" THICKNESS
2. INSTALL TRANSITION FLASHING AT EVERY HORIZONTAL CHANGE IN MATERIAL.

① East
1/4" = 1'-0"




PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

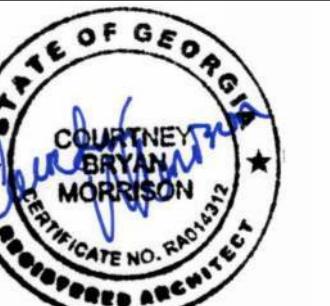

November 14, 2025

Issuances		
No.	Description	Date
	Design Development	9/16/2025
	Historic Board Review	9/18/2025
	Issued for Permit	11/14/2025



② North - Color
1/4" = 1'-0"



ELEVATION NOTES
1. ALL TRIM TO BE 5/4" THICKNESS
2. INSTALL TRANSITION FLASHING AT EVERY HORIZONTAL CHANGE IN MATERIAL.

① North
1/4" = 1'-0"

Project number	20250505
Date	November 14, 2025
Drawn by	CM
Checked by	CM
Scale	As indicated

A402

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com



2 South - Color F
1/4" = 1'-0"




November 14, 2025

Issuances		
No.	Description	Date
	Schematic Design	8/29/2025
	Design Development	9/16/2025
	Historic Board Review	9/18/2025
	Issued for Permit	11/14/2025



1 South
1/4" = 1

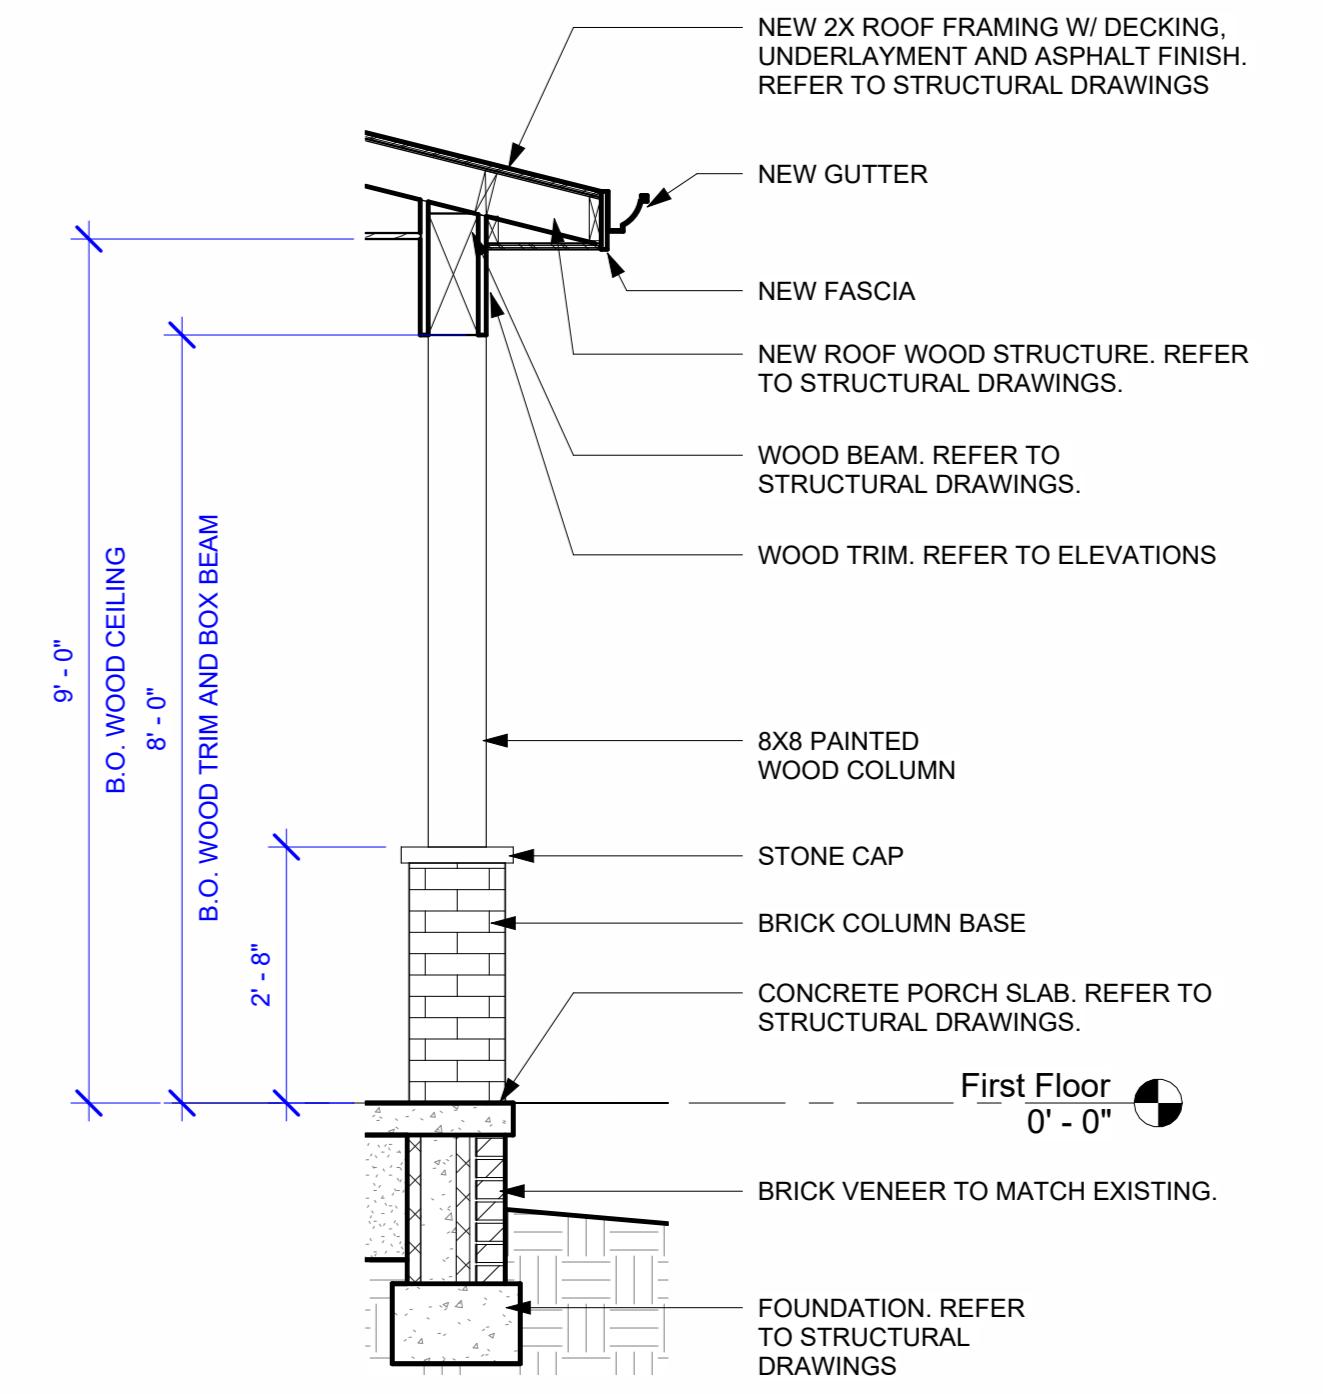

3 SECTION AT PORCH COLUMN
1/2" = 1'-0"

ELEVATIONS & DETAILS

Project number	20250505
Date	November 14, 2025
Drawn by	CM
Checked by	CM

A403

As indicated



2 West - C
1/4" = 1'



November 14, 2025

Issuances		
No.	Description	Date
	Design Development	9/16/2025
	Historic Board Review	9/18/2025
	Issued for Permit	11/14/2025



ELEVATION NOTES

1. ALL TRIM TO BE 5/4" THICKNESS
2. INSTALL TRANSITION FLASHING AT EVERY HORIZONTAL CHANGE IN MA

1 West
1/4" = 1

ELEVATIONS

Project number	20250505
Date	November 14, 2025
Drawn by	CM
Checked by	CM

A404

As indicated

1. DESIGN CRITERIA

A. CODE: 2018 INTERNATIONAL BUILDING CODE W/ GEORGIA AMENDMENTS 2018 INTERNATIONAL RESIDENTIAL CODE W/ GEORGIA AMENDMENTS	
B. RISK CATEGORY	II
C. GRAVITY	
RESIDENTIAL AREA DEAD LOADS	
ROOF	15 PSF
FLOORS	15 PSF
DECK	12 PSF
RESIDENTIAL AREA LIVE LOADS	
PITCHED ROOF (REDUCED)	12 PSF
FLAT ROOF	20 PSF
UNINHABITABLE ATTICS W/ NO STORAGE	10 PSF
UNINHABITABLE ATTICS W/ LIMITED STORAGE	20 PSF
HABITABLE ATTICS	10 PSF
DECKS	40 PSF
COMMON AREAS	40 PSF
SLEEPING AREAS	30 PSF
STAIRS	40 PSF
PASSENGER VEHICLE GARAGE	50 PSF
RESIDENTIAL AREA CONCENTRATED LOADS	
GUARDS	200 LB
GUARD IN-FILL COMPONENTS	50 LB
HANDRAIL	200 LB
STAIRS	300 LB
PASSENGER VEHICLE GARAGE	2.0 K
RESIDENTIAL WALL DEAD LOAD	
INTERIOR BEARING WALL	10 PSF
EXTERIOR W/ SIDING	15 PSF
EXTERIOR W/ BRICK	50 PSF
EXTERIOR W/ EIFS	20 PSF
SNOW	
GROUND SNOW LOAD (P_g)	5 PSF
EXPOSURE FACTOR (C_e)	0.9
THERMAL FACTOR (C_t)	1.1
IMPORTANCE FACTOR (I_a)	1.0
SLOPE FACTOR (C_s)	1.0
FLAT ROOF SNOW LOAD (P_f)	4.5 PSF
SLOPED ROOF SNOW LOAD (P_s)	5 PSF
MINIMUM ROOF SNOW LOAD (P_m)	5 PSF
RAIN	
60 MINUTE DURATION	3.3 IN/HR
A. LATERAL	
WIND	
BASIC WIND SPEED (V)	107 MPH
ALLOWABLE STRESS DESIGN WIND SPEED (V_{asd})	90 MPH
EXPOSURE CATEGORY (PLAN E-W)	B
EXPOSURE CATEGORY (PLAN N-S)	B
BUILDING CLASSIFICATION	ENCLOSED
INTERNAL PRESSURE COEFFICIENT, GC/PI	+0.18
COMPONENTS & CLADDING	SEE DWG S004
SEISMIC	
SEISMIC IMPORTANCE FACTOR (I_a)	1.0
SHORT PERIOD RESPONSE COEFF (S_a)	0.215g
1 SEC PERIOD RESPONSE COEFF (S_1)	0.090g
SOIL SITE CLASS	C
SHORT PERIOD RESPONSE COEFF (S_{0s})	0.186g
1 SEC PERIOD RESPONSE COEFF (S_{01})	0.090g
RESPONSE MODIFICATION FACTOR (R)	
WOOD SHEAR WALLS	6.5
DEFLECTION AMPLIFICATION FACTOR (C/d)	
WOOD SHEAR WALLS	4
ANALYSIS PROCEDURE	E.L.F.P.
SEISMIC DESIGN CATEGORY	B
DESIGN BASE SHEAR (V)	
SEISMIC FORCE RESISTING SYSTEM:	
LIGHT-FRAMED WALLS SHEATHED WITH STRUCTURAL PANELS	
SEISMIC RESPONSE COEFFICIENT (C_s):	
WOOD SHEAR WALLS	0.035
BASE SHEAR:	
WOOD SUPERSTRUCTURE	9.6 K

2. GENERAL

- A. THE FOLLOWING CONSTRUCTION SPECIFICATIONS ARE A SUPPLEMENT TO ALL OTHER REQUIREMENTS, WHERE CONFLICTS EXIST OR WHEN MANUFACTURER SPECIFICATIONS AND LOCAL CODE REQUIREMENTS ARE IN EXCESS OF THOSE CONTAINED HEREIN, THE STRICTEST REQUIREMENT SHALL GOVERN.
- B. IT IS THE CONTRACTOR'S RESPONSIBILITY TO REVIEW AND SUBMIT ALL SHOP DRAWINGS FOR DELEGATED DESIGN AND REPORT ALL DISCREPANCIES TO THE ENGINEER PRIOR TO FABRICATION OR ERECTION.
- C. ALL DIMENSIONS TO TAKE PRECEDENCE OVER SCALE SHOWN ON PLANS, SECTIONS, AND DETAILS.
- D. SPECIFIC NOTES AND DETAILS ON DRAWINGS SHALL TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS.
- E. WHERE A SECTION IS CUT ON THE DRAWINGS, IT SHALL APPLY AT ALL LIKE OR SIMILAR CONDITIONS UNO
- F. SEE ARCHITECTURAL DRAWINGS FOR THE FOLLOWING:
 1. SLAB EDGE & WALL DIMENSIONS.
 2. SIZE & LOCATION OF ALL DOOR AND WINDOW OPENINGS.
 3. ROOF, FLOOR & WALL FINISHES.
 4. DETAILS OF VENEER ATTACHMENT & WATERPROOFING.
 5. LOCATION & EXTENT OF INSULATION.
- G. THE STRUCTURAL DRAWINGS REPRESENT THE FINISHED STRUCTURE, UNLESS OTHERWISE INDICATED, THEY DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL ASSUME SOLE RESPONSIBILITY FOR ALL MEANS AND METHODS OF CONSTRUCTION AND SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT THE STRUCTURE, WORKMEN, OR OTHER PERSONS DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE, BUT NOT BE LIMITED TO: BRACING, SHORING FOR CONSTRUCTION EQUIPMENT, SHORING FOR THE BUILDING, SHORING FOR EARTH BANKS, FORMS, SCAFFOLDING, PLANKING, SAFETY NETS, SUPPORT, AND BRACING FOR CRANES, ETC.
- H. ALL SUBMITTALS SHALL BE REVIEWED AND APPROVED BY PROJECT ENGINEER OF RECORD PRIOR TO FABRICATION AND INSTALLATION.
- I. REVIEWED AND APPROVED SHOP DRAWINGS SHALL BE AVAILABLE AT THE JOB SITE DURING TIMES OF INSPECTION.

3. FOUNDATION

- A. NO CIVIL OR SURVEYING INFORMATION WAS FURNISHED FOR THIS PROJECT; THEREFORE, FINAL GRADING INFORMATION SHALL BE CONFIRMED IN THE FIELD BY THE GC. LOTS SHALL BE GRADED TO DRAIN SURFACE WATER AWAY FROM ALL FOUNDATIONS WITH A GRADE FALL OF NOT LESS THAN 6% WITHIN THE FIRST 10' (5% SLOPE) MEASURED PERPENDICULAR TO ALL EXTERIOR WALLS, OTHERWISE DRAINS OR SWALES SHALL BE CONSTRUCTED.
- B. FOUNDATIONS PLACED ON SLOPES EXCEEDING 1 VERTICAL UNIT TO 3 HORIZONTAL UNITS (33% SLOPE) SHALL HAVE A GEOTECHNICAL INVESTIGATION REPORT FURNISHED AND SUBMITTED TO THE ENGINEER, AND CONTAINING ADDITIONAL MINIMUM FOOTING WIDTH, FOOTING DEPTH AND ANY ADDITIONAL SLOPE STABILITY INFORMATION FOR REVIEW AND INCLUSION INTO THE FOUNDATION DESIGN CONTAINED WITHIN THESE DRAWINGS.
- C. MINIMUM FROST DEPTH = 12".
- D. NO GEOTECHNICAL EVALUATION REPORT WAS FURNISHED FOR THIS PROJECT; THEREFORE, BEARING CAPACITY AND LATERAL EARTH PRESSURES ARE ASSUMED AND BASED ON THE 2018 IBC & IRC U.N.O.
- E. FOUNDATION DESIGN CRITERIA:

FOUNDATION SYSTEM:
SHALLOW FOUNDATIONS BEARING ON RESIDUAL SOIL/ ENGINEERED FILL
- F. SEE GENERAL NOTE #5 FOR CONCRETE PROTECTION OF REINFORCEMENT OF CAST-IN-PLACE MEMBERS.
- G. SLEEVE PLUMBING OPENINGS IN SLABS BEFORE PLACING CONCRETE AND BEND REINFORCING AROUND SLEEVES, CORING NOT PERMITTED IN FLOOR SLABS, UNLESS APPROVED BY ENGINEER.
- H. THE FOLLOWING CHART SHALL BE USED TO DETERMINE MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, MAXIMUM WATER TO CEMENTITIOUS MATERIAL RATIO (W/CM), AND ENTRAINED AIR CONTENT UNLESS SPECIFICALLY NOTED OTHERWISE:

EXPOSURE CATEGORY						
STRUCTURAL COMPONENT	F ¹ CLASS	S ^{2,7} CLASS	P CLASS	C ⁸ CLASS	MIN ⁹ F _c (PSI)	MAX ¹⁰ W/CM
EXTERIOR WALLS	F1	S0	P0	C0	3500	N/A
FOOTINGS	ALL	F0	S0	P0	3500	N/A
SOG	INT	F0	S0	P0	3000	N/A
SOG	GARAGE	F0	S0	P0	4000	N/A

NOTES:

1. FOR F3 CLASS SEE ACI 318 TABLE 26.4.2.2(b) FOR ADDITIONAL CONCRETE MIXTURE REQUIREMENTS.
2. MINIMUM IS BASED ON MAXIMUM OF DESIGN AND GOVERNING EXPOSURE CLASS REQUIREMENTS.
3. MAXIMUM IS BASED ON GOVERNING EXPOSURE CLASS REQUIREMENTS.
4. BASED ON MAXIMUM 3/4" AGGREGATE SIZE.
5. SEE ACI 318 TABLE 19.3.2.1 FOR CEMENTITIOUS MATERIAL AND CALCIUM CHLORIDE ADMIXTURE RESTRICTIONS.
6. SEE ACI 318 TABLE 19.3.2.1 FOR MAXIMUM WATER-SOLUBLE CHLORIDE ION CONTENT.
7. SO EXPOSURE ASSUMED. GC SHALL VERIFY WITH GEOTECHNICAL REPORT.

- I. CONCRETE SLUMP SHALL BE AS FOLLOWS:
 1. REMOVABLE FORMS: 3" TO 5" AT TIME OF PLACEMENT ($\pm 1"$ MAX).
 2. STAY-IN-PLACE FORMS: GREATER THAN 6" PER ASTM C143.
- J. PLACED CONCRETE SHALL BE CONSOLIDATED BY SUITABLE MEANS TO BE WORKED AROUND EMBEDDED ITEMS, REINFORCEMENT AND INTO FORM CORNERS.
- K. CONCRETE MIX DESIGNS SHALL BE ESTABLISHED BY THE SUPPLIER IN ACCORDANCE WITH THE ABOVE REFERENCED STANDARDS. CONFORMANCE TO THE ABOVE MIX DESIGN REQUIREMENTS ARE THE RESPONSIBILITY OF THE CONCRETE SUPPLIER. CONCRETE SUPPLIER MAY SUBMIT PROPOSED MIX DESIGNS TO THE ENGINEER FOR REVIEW PRIOR TO CONCRETE PLACEMENT.

L.

WATER DRAINAGE SYSTEMS, ON THE BACK FILL SIDE OF RETAINING WALLS, ARE SHOWN AS REPRESENTATION ONLY. WALLS HAVE NOT BEEN DESIGNED TO SUPPORT HYDROSTATIC PRESSURES. DRAINAGE SYSTEMS SHALL BE PROVIDED IN ACCORDANCE THE ADOPTED BUILDING CODES LISTED IN NOTE #1 ABOVE.

4. CONCRETE

- A. PORTLAND CEMENT SHALL CONFORM TO ASTM C150, TYPE I.
- B. MIXING AND DELIVERY OF CONCRETE SHALL CONFORM TO ASTM C94 OR C685.
- C. FORMING MATERIAL, TIE MATERIAL, AND MEANS AND METHODS IS THE RESPONSIBILITY OF THE GC.
- D. REFER TO ARCHITECTURAL DRAWINGS FOR CLIPS, GROOVES, GROUNDS, ETC., TO BE CAST IN CONCRETE AND CONCRETE FINISHES.
- E. ALL REINFORCING BARS, ANCHOR BOLTS AND OTHER CONCRETE INSERTS SHALL BE SECURED IN POSITION PRIOR TO PLACING CONCRETE.
- F. SEE GENERAL NOTE #5 FOR CONCRETE PROTECTION OF REINFORCEMENT OF CAST-IN-PLACE MEMBERS.
- G. BARS SHALL BE IN CONTACT WHEN FORMING A LAP SPLICE, UNLESS NOTED OTHERWISE.
- H. PROVIDE CORNER BARS @ ALL TURN-DOWN SLAB CORNERS AND C.I.P. CONCRETE WALL CORNERS. PROVIDE 30" LAP BETWEEN CORNER BARS AND MAIN REINFORCING.
- I. LAP WELDED WIRE MESH ONE FULL MESH AT SIDE AND END LAPS.
- J. LONGITUDINAL REINFORCING IN EXTERIOR BUILDING FOUNDATIONS SHALL BE CONTINUOUS AND TIED TO BE IN CONTACT AT ALL SPLICE LOCATIONS. THE ELECTRICAL INSPECTOR SHALL INSPECT LONGITUDINAL REINFORCING IN EXTERIOR BUILDING FOUNDATIONS PRIOR TO CONCRETE PLACEMENT.
- K. STANDARD HOOKS SHALL BE 16 x BAR DIAMETER UNLESS NOTED OTHERWISE.
- L. CLEAR COVERAGE OF CONCRETE OVER OUTER REINFORCING BARS SHALL BE IN ACCORDANCE WITH ACI 318 AS SHOWN IN THE TABLE BELOW, UNLESS SPECIFICALLY DETAILED OTHERWISE ON THE DWGS.


5. REINFORCING STEEL

- A. REINFORCING BARS SHALL BE DEFORMED BARS CONFORMING TO ASTM A615, GRADE 60.
- B. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185.
- C. ALL REINFORCING BAR BENDS ARE TO BE MADE COLD AND IN COMPLIANCE WITH ACI 318.
- D. ALL REINFORCING SHALL BE SECURED IN THE PROPER LOCATION IN THE FORMS TIE WIRE OR OTHER BAR SUPPORTS TO PREVENT DISPLACEMENT DURING CONCRETE OPERATION.
- E. WALL REINFORCEMENT SHALL NOT VARY IN POSITION FROM THE SPECIFIED LOCATION MORE THAN 3/8".
- F. ALL REINFORCING SHALL BE INSPECTED FOR SIZE, PLACEMENT, AND CLEAR COVER PRIOR TO PLACING CONCRETE.
- G. BARS SHALL BE IN CONTACT WHEN FORMING A LAP SPLICE, UNLESS NOTED OTHERWISE.
- H. PROVIDE CORNER BARS @ ALL TURN-DOWN SLAB CORNERS AND C.I.P. CONCRETE WALL CORNERS. PROVIDE 30" LAP BETWEEN CORNER BARS AND MAIN REINFORCING.
- I. LAP WELDED WIRE MESH ONE FULL MESH AT SIDE AND END LAPS.
- J. LONGITUDINAL REINFORCING IN EXTERIOR BUILDING FOUNDATIONS SHALL BE CONTINUOUS AND TIED TO BE IN CONTACT AT ALL SPLICE LOCATIONS. THE ELECTRICAL INSPECTOR SHALL INSPECT LONGITUDINAL REINFORCING IN EXTERIOR BUILDING FOUNDATIONS PRIOR TO CONCRETE PLACEMENT.
- K. STANDARD HOOKS SHALL BE 16 x BAR DIAMETER UNLESS NOTED OTHERWISE.
- L. CLEAR COVERAGE OF CONCRETE OVER OUTER REINFORCING BARS SHALL BE IN ACCORDANCE WITH ACI 318 AS SHOWN IN THE TABLE BELOW, UNLESS SPECIFICALLY DETAILED OTHERWISE ON THE DWGS.

CONCRETE COVER FOR CAST-IN-PLACE NON-PRESTRESSED CONCRETE MEMBERS (UNO)			
CONCRETE EXPOSURE	MEMBER	REINFORCEMENT	SPECIFIED COVER, IN
CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND	ALL	ALL	3"
CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND	ALL	NO. 6 THROUGH NO. 16 BARS	2"
CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND	SLABS AND WALLS	NO. 5 BAR, W31 OR D31 WIRE, AND SMALLER	1 1/2"
CAST AGAINST AND PERMANENTLY IN CONTACT WITH GROUND	SLABS AND WALLS	NO. 11 BARS AND SMALLER	3/4"

M. LAP SPLICES SHALL BE AS FOLLOWS UNLESS OTHERWISE NOTED IN DETAILS. SEE DETAILS FOR CLASS "A" OR "B" CALLOUTS. ALL FOOTING LONGITUDINAL AND WALL HORIZONTAL REINFORCING SHALL BE CLASS "A" LAP SPLICE UNLESS OTHERWISE NOTED.

LAP SPLICE LENGTH	3000 PSI CONC	3500 PSI CONC	4000 PSI CONC	5000 PSI CONC
#4 BAR	CLASS "A" CLASS "B"			
	22" 30"	21" 28"	19" 25"	17" 22"
#5 BAR	CLASS "A" CLASS "B"			
	28" 36"	26" 33"	24" 32"	22" 28"
#6 BAR	CLASS "A" CLASS "B"			
	33" 43"	31" 40"	29" 37"	26" 34"
#7 BAR	CLASS "A" CLASS "B"	CLASS "A" CLASS "B"	CLASS "B" CLASS "A"	CLASS "B" CLASS "A"
	48" 63"	45" 58"	42" 54"	38" 49"

 **Fernz Structural**

www.fernz-structural.com

PROJECT: Fleeman Residence Remodel & Addition

245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

6. SILL PLATES

- A. PRESERVATIVE TREATED WOOD IN ACCORDANCE WITH AWPA U1 SHALL BE USED FOR ALL SILL PLATES IN CONTACT WITH CONCRETE OR MASONRY.
- B. SEE GENERAL NOTES "SOLID SAWN & ENGINEERED LUMBER" NOTE "F" FOR PRESERVATIVE TREATMENT REQUIREMENTS.
- C. SEE GENERAL NOTE "WOOD FASTENERS & HARDWARE" NOTE "D" FOR CORROSION RESISTANCE REQUIREMENTS.
- D. SILL PLATES SHALL BE ANCHORED TO CONCRETE OR MASONRY FOUNDATIONS WITH $\frac{1}{2}$ " DIAMETER ASTM A307 ANCHOR BOLTS @ 72" OC MAXIMUM WITH 7" MINIMUM CONCRETE EMBEDMENT. PROVIDE ANCHOR BOLTS AT NOT MORE THAN 12" NOR LESS THAN 4" FROM ENDS OF EACH PLATE WITH 2 ANCHOR BOLTS MINIMUM IN ANY PLATE.

EXCEPTIONS:

1. INTERIOR SILL PLATES MAY BE ANCHORED WITH POWDER ACTUATED FASTENERS. SPACE FASTENERS @ 18" OC MAXIMUM AND PROVIDE PINS @ 6" AND 10" FROM ENDS OF PLATE WITH 2 FASTENERS MINIMUM IN ANY PLATE. ACCEPTABLE FASTENERS INCLUDE:
 - a. HILTI X-CP 72 P8S23
 - b. RAMSET RAMGUARD 1524 SDE x 3" LONG
 - c. SIMPSON PAF PDPAWL287 X 2-7/8" LONG
2. SILL PLATES MAY BE ANCHORED TO MASONRY OR CONCRETE FOUNDATIONS WITH SIMPSON MASA OR MASAP ANCHORS AT 48" OC MAXIMUM. PLACE ANCHORS NO MORE THAN 12" FROM THE END OF EACH PLATE W/ 2 ANCHOR MINIMUM PER PLATE. USE ANCHOR WITH A FINISH COMPATIBLE WITH THE TYPE OF PRESERVATIVE TREATMENT USED ON THE SILL PLATES.
- E. BRACING WALL SILL PLATE ANCHORAGE SHALL GOVERN WITH REGARD TO ANCHOR TYPE AND SPACING. SEE WALL FRAMING PLANS (S2 SERIES) AND BRACING WALL SCHEDULES (S4 SERIES) FOR ADDITIONAL INFO.

7. SOLID SAWN & ENGINEERED LUMBER

- A. ALL SAWN LUMBER SHALL BE VISUALLY GRADED SOUTHERN YELLOW PINE (SYP)/SPRUCE PINE FIR (SPF) DIMENSION LUMBER, SEASONED AND WITH 19% MAX MOISTURE CONTENT. UNO, AND IN ACCORDANCE WITH THE FOLLOWING MINIMUM GRADE REQUIREMENTS:

STUDS.....	SYP/SYP STRUCT. GRADE NO. 2
JOISTS.....	SYP STRUCT. GRADE NO. 2
BEAMS (2"-4" THICK).....	SYP STRUCT. GRADE NO. 2
POSTS.....	SYP STRUCT. GRADE NO. 2
PLATE STOCK.....	SYP STRUCT. GRADE NO. 2
GLULAM.....	SYP (SEE GRADE BELOW)
- B. GRADES SHALL BE DETERMINED IN ACCORDANCE WITH SPIB GRADING RULES AGCY OR OTHER ACCREDITATION BODY COMPLYING WITH DOC PS 20.
- C. STRUCTURAL GLUED LAMINATED TIMBER OF SOFTWOOD SPECIES SHALL BE IN CONFORMANCE WITH ANSI STANDARD A190.1, AMERICAN NATIONAL STANDARD FOR STRUCTURAL GLUED LAMINATED TIMBER, OR OTHER CODE-APPROVED DESIGN, MANUFACTURING AND/OR QUALITY ASSURANCE PROCEDURES.
- D. END-JOINED STUDS ARE PERMITTED TO BE USED INTERCHANGEABLY WITH SOLID-SAWN STUDS OF THE SAME SPECIES AND GRADE SPECIFIED. AN END-JOINED STUDS SHALL HAVE THE DESIGNATION "HEAT RESISTANT ADHESIVE" OR "HRA" INCLUDED IN ITS GRADE MARK. END-JOINED STUDS SHALL ONLY BE USED AS VERTICAL MEMBERS IN STUD WALLS.
- E. USE PRESERVATIVE TREATED WOOD FOR ALL EXPOSED LUMBER OR LUMBER IN CONTACT WITH CONCRETE OR MASONRY.
- F. WOOD MEMBERS, INCLUDING WOOD SHEATHING, WHICH REST ON EXTERIOR FDN WALLS OR SLABS & ARE LESS THAN 8" FROM EXPOSED EARTH SHALL BE OF NATURALLY DURABLE OR PRESERVATIVE-TREATED WOOD.
- G. EXPOSED GLULAM BEAMS SHALL BE PRESERVATIVE TREATED AFTER MANUFACTURE IN ACCORDANCE WITH AMERICAN WOOD-PRESERVERS ASSOCIATION (AWPA) STANDARD U1 WITH PRESERVATIVES AS REQUIRED FOR ABOVE GROUND EXPOSURE.
- H. ALL EXPOSED, PRESERVATIVE TREATED LUMBER SHALL HAVE FIELD-CUT ENDS, NOTCHES, AND DRILLED HOLES TREATED IN THE FIELD IN ACCORDANCE WITH AWPA M4.
- I. INSTALL BEAMS WITH CROWN UP.
- J. ALL ENGINEERED LUMBER SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES (UNO):

MEMBER	F _b (PSI)	E (KSI)	COMMON NAME
LVL	2900	2000	N/A
LSL	1700	1300	N/A
PSL	2900	2000	N/A
GLULAM	2600	2000	26F-V2

- K. HANDRAILS, GUARDRAILS AND STAIRWAYS INCLUDING ALL COMPONENTS AND THEIR CONNECTIONS SHALL BE DESIGNED BY THE SUPPLIER IN ACCORDANCE WITH THE LOCAL BUILDING CODE.
- L. ALL MECHANICAL, PLUMBING, AND FINISHINGS SHALL ACCOMMODATE THE ESTIMATED SHRINKAGE/ EXPANSION VALUES INDICATED BELOW.

LEVEL	WOOD SHRINKAGE PER LEVEL	CUMULATIVE WOOD SHRINKAGE	BRICK EXPANSION PER LEVEL	CUMULATIVE BRICK EXPANSION	TOTAL DIFFERENTIAL SHRINKAGE (EXT W/ BRICK)
BASEMENT	-1/8"	-1/8"	1/16"	1/16"	3/16"
1ST LEVEL	-3/16"	-5/16"	1/16"	-1/8"	7/16"
2ND LEVEL	-3/16"	-1/2"	1/16"	-3/16"	11/16"

NOTES:

1. BRICK EXPANSION/LEVEL ASSUMES BRICK RUNS THE ENTIRE STORY HEIGHT
2. INSTALLERS & DESIGNERS MUST CALCULATE THE EXPANSION REQUIREMENTS AT GIVEN LOCATION IN BUILDING BY SUMMING STORY CUMULATIVE WOOD SHRINKAGE W/ CUMULATIVE BRICK EXPANSION AS REQUIRED.

8. WOOD SHEATHING

- A. ROOF DECK AND SUBFLOORS ARE DESIGNED AS UNBLOCKED DIAPHRAGMS UNO.
- 1. ROOF SHEATHING SHALL BE AS FOLLOWS:
 - a. RAFTER SPACING <= 24" OC: 7/16" THICK EXPOSURE 1 RATED WOOD SHEATHING WITH A PANEL SPAN INDEX (U.S.) NOT LESS THAN 24/16 AND BEARING THE TRADEMARK STAMP OF APA THE ENGINEERED WOOD ASSOCIATION, OR OTHER APPROVED AGENCY. PANELS SHALL BE FASTENED WITH 8d NAILS @ 6" OC AT ALL PANEL EDGES AND 12" OC AT ALL INTERIOR SUPPORTS UNLESS NOTED OTHERWISE ON PLAN.
 - b. RAFTER SPACING >24" & <= 36" OC: 1-1/2" TONGUE & GROOVE LUMBER WITH MINIMUM $F_t = 270$ AND $E = 340,000$. LUMBER SHALL BE FASTENED WITH (3) 16d NAILS AT ALL SUPPORTS UNLESS NOTED OTHERWISE ON PLAN.
 - c. ALL EXPOSED ROOF SHEATHING SHALL BE CDX OR CCX GRADE PLYWOOD UNLESS SPECIFICALLY DETAILED BY THE ARCHITECT.
- 2. FLOOR SHEATHING SHALL BE 23/32" THICK T & G, EXPOSURE 1 RATED WOOD SHEATHING WITH A PANEL SPAN INDEX (U.S.) NOT LESS THAN 48/24 AND BEARING THE TRADEMARK STAMP OF APA THE ENGINEERED WOOD ASSOCIATION, OR OTHER APPROVED AGENCY. PANELS SHALL BE NAILED WITH 10d NAILS @ 6" OC AT ALL PANEL EDGES AND 12" OC AT ALL INTERIOR SUPPORTS UNLESS NOTED OTHERWISE ON PLAN.

B. BRACING WALL SYSTEMS ARE AS FOLLOWS:

1. INTERIOR BRACING WALLS SHALL BE COMPRISED OF THE FOLLOWING:
 - a. 7/16" THICK EXPOSURE 1 RATED WOOD SHEATHING WITH A PANEL SPAN INDEX (U.S.) RATING NOT LESS THAN 24/16 AND BEARING THE TRADEMARK STAMP OF APA THE ENGINEERED WOOD ASSOCIATION, OR OTHER APPROVED AGENCY. PANELS SHALL BE NAILED IN ACCORDANCE WITH THE BRACING WALL SCHEDULE ON THE S4 SERIES DRAWINGS.
 - b. GYPSUM WALLBOARD PANELS WHERE INDICATED ON WALL FRAMING PLAN. SEE WALL FRAMING PLANS AND S4 SERIES DRAWINGS FOR TYPE, THICKNESS, AND FASTENER INFO.
2. EXTERIOR BRACING WALLS ARE COMPRISED OF 7/16" THICK EXPOSURE 1 RATED WOOD SHEATHING WITH A PANEL SPAN INDEX (U.S.) RATING NOT LESS THAN 24/16 AND BEARING THE TRADEMARK STAMP OF APA THE ENGINEERED WOOD ASSOCIATION, OR OTHER APPROVED AGENCY. PANELS SHALL BE NAILED IN ACCORDANCE WITH THE BRACING WALL SCHEDULE ON THE S4 SERIES DRAWINGS.
- C. REFER TO FOUNDATION AND WALL FRAMING PLANS FOR TYPE AND LOCATION OF ALL BRACING WALLS AND HOLD DOWN ANCHORAGE. REFER TO S4 SERIES DRAWINGS FOR BRACING SCHEDULES AND FASTENER REQUIREMENTS.
- D. FRAMING DETAILS INCORPORATE MINIMUM REQUIREMENTS FOR LATERAL LOAD TRANSFER, ANY CHANGE, MODIFICATION, OR SUBSTITUTION OF MATERIALS (INCLUDING GRADE OR SPECIES) OR FASTENERS MUST BE APPROVED BY THE ENGINEER OF RECORD PRIOR TO INSTALLATION.
- E. TEMPORARY BRACING OF THE BLDGS AND STUD WALLS IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND MUST REMAIN IN PLACE UNTIL ALL FRAMING DETAILS, ROOF AND FLOOR SHEATHING AND BRACING WALL CONSTRUCTION IS COMPLETE.
- F. TEMPORARY STACKING OF WOOD SHEATHING ON ELEVATED WOOD FLOOR FRAMING SHALL BE LIMITED TO FIFTEEN 3/4" THICK 4' WIDE SHEETS LAID FLAT OR 8 SHEETS ON EDGE W/ THE LONG DIMENSION PERPENDICULAR TO JOIST OR TRUSS SPAN. NO JOIST OR TRUSS SHALL SUPPORT MORE THAN ONE STACK OF SHEATHING ALONG ITS SPAN LENGTH.
- G. TEMPORARY STACKING OF GYPSUM SHEATHING ON ELEVATED WOOD FLOOR FRAMING SHALL BE LIMITED TO EIGHTEEN 5/8" THICK 4' WIDE SHEETS LAID FLAT OR TEN SHEETS ON EDGE W/ LONG DIMENSION PERPENDICULAR TO JOIST OR TRUSS SPAN. NO JOIST OR TRUSS SHALL SUPPORT MORE THAN ONE STACK OF SHEATHING ALONG ITS SPAN LENGTH.

9. WOOD FASTENERS & HARDWARE

- A. UNLESS SPECIFIED OTHERWISE, SCREWS SHALL BE EMBEDDED IN THE APPROPRIATE SUBSTRATE WITH A MINIMUM EMBEDMENT OF 10 TIMES THE SHANK DIAMETER OR THE EMBEDMENT REQUIRED TO SUPPORT THE INTENDED LOAD.
- B. WHERE MINIMUM EMBEDMENT DEPTHS ARE NOTED, SCREWS SHALL PROVIDE AN EMBEDMENT INTO THE MAIN MEMBER EQUAL TO OR GREATER THAN THE MINIMUM REQUIRED.
- C. SUBSTITUTION REQUESTS, FOR PRODUCTS OTHER THAN THOSE LISTED BELOW, SHALL BE SUBMITTED TO THE ENGINEER WITH CALCULATIONS THAT ARE PREPARED & SEALED BY A REGISTERED PROFESSIONAL ENGINEER SHOWING THAT THE SUBSTITUTED PRODUCT WILL ACHIEVE AN EQUIVALENT CAPACITY USING THE APPROPRIATE DESIGN PROCEDURE REQUIRED BY THE BUILDING CODE.
- D. AS A MINIMUM, ALL HARDWARE EXPOSED TO WEATHER SHALL HAVE A G185 (SIMPSON ZMAX OR EQUIVALENT) GALVANIZED FINISH.
- E. FASTENERS AT PRESERVATIVE TREATED LUMBER

1. THE FOLLOWING CHART SHALL BE USED IN DETERMINING FINISHES FOR HARDWARE IN CONTACT W/ PRESERVATIVE TREATED WOOD:

TREATMENT TYPE MEMBER	SBX (DOT)	ACQ-C ACQ-D	CBA-C CA-B
G90	X	—	—
G185	X	X	X
POST HOT DIP GALVANIZED	X	X	X
STAINLESS STL (TYPES 304 & 316)	X	X	X

2. FOR WOOD WITH ACTUAL RETENTION LEVELS GREATER THAN 0.40 PCF FOR ACQ, 0.41 PCF FOR CBA OR 0.21 FOR CA-B, STAINLESS STEEL CONNECTORS AND FASTENERS ARE RECOMMENDED. VERIFY ACTUAL RETENTION LEVEL WITH THE WOOD SUPPLIER/TREATER. WHEN USING STAINLESS STL CONNECTORS, USE STAINLESS STL FASTENERS. WHEN USING GALVANIZED CONNECTORS, USE GALVANIZED FASTENERS.
3. ALL FASTENERS IN CONTACT W/ PRESSURE TREATED LUMBER SHALL BE BATCH/POST-HOT-DIP GALVANIZED (PER ASTM A153) OR MECHANICALLY GALVANIZED (PER ASTM B695, CLASS 55 OR GREATER).
4. EXCEPTION: BOLTS & LAG SCREWS W/ SHANK DIAMETERS GREATER THAN 1/2" IN DIAMETER AND PROTECTED FROM THE WEATHER ARE NOT REQUIRED TO BE GALVANIZED.

F. ACCEPTABLE PRODUCTS

1. SIMPSON STRONG-TIE:
 - a. "SDS WOOD SCREWS" (HEAVY DUTY ALL PURPOSE FASTENER)
 - b. "SDW EWP-PLY SCREWS"
2. FASTENMASTER:
 - a. "LEDGERLOK" (CORROSION RESISTANT FASTENER)
 - b. "TIMBERLOK" (HEAVY DUTY ALL PURPOSE FASTENER)
 - c. "TRUSSLOK" (MULTI-PLY ENGINEERED WOOD FASTENER)

G. COMMON NAIL SIZES ARE AS FOLLOWS:

TYPE	PENNYWEIGHT					
	6d	8d	10d	12d	16d	20d
COMMON	LENGTH 2"	2-1/2"	3"	3-1/4"	3-1/2"	4"
	DIA. (SHANK)	0.113"	0.131"	0.148"	0.148"	0.162"
	BENDING YIELD STRENGTH (KSI)	100	100	90	90	80
BOX	LENGTH 2"	2-1/2"	3"	3-1/4"	3-1/2"	4"
	DIA. (SHANK)	0.099"	0.113"	0.128"	0.128"	0.135"
	BENDING YIELD STRENGTH (KSI)	100	100	100	100	90

10. POST-INSTALLED ANCHORS

- A. POST-INSTALLED ANCHORS SHALL ONLY BE USED WHERE SPECIFIED ON THE DRAWINGS.
- B. CONTRACTOR SHALL OBTAIN APPROVAL FROM ENGINEER OF RECORD PRIOR TO USING POST-INSTALLED ANCHORS FOR MISSING OR MISPLACED CAST-IN-PLACE ANCHORS.
- C. CARE SHALL BE GIVEN TO AVOID CONFLICTS WITH EXISTING REBAR. HOLES SHALL BE DRILLED AND CLEANED PER THE MANUFACTURER'S INSTRUCTIONS. ANCHORS SHALL BE INSTALLED PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AT NOT LESS THAN MINIMUM EDGE DISTANCES AND/OR SPACING INDICATED IN THE MANUFACTURER'S LITERATURE.
- D. UNLESS SPECIFIED OTHERWISE, ANCHORS SHALL BE EMBEDDED IN THE APPROPRIATE SUBSTRATE WITH A MINIMUM EMBEDMENT OF 8 TIMES THE NOMINAL ANCHOR DIAMETER OR THE EMBEDMENT REQUIRED TO SUPPORT THE INTENDED LOAD.
- E. SUBSTITUTION REQUESTS, FOR PRODUCTS OTHER THAN THOSE LISTED BELOW, SHALL BE SUBMITTED TO THE ENGINEER WITH CALCULATIONS THAT ARE PREPARED & SEALED BY A REGISTERED PROFESSIONAL ENGINEER SHOWING THAT THE SUBSTITUTED PRODUCT WILL ACHIEVE AN EQUIVALENT CAPACITY USING THE APPROPRIATE DESIGN PROCEDURE REQUIRED BY THE BUILDING CODE.

F. ACCEPTABLE PRODUCTS

1. EXPANSION ANCHORS:
 - a. "STRONG-BOLT 2" BY SIMPSON STRONG-TIE
 - b. "Kwik Bolt TZ" BY HILTI
 - c. "POWER-STUD+ SD1" BY DEWALT
2. ADHESIVE ANCHORS:
 - a. FOR CONCRETE APPLICATIONS:
 - 1. "SET-XP EPOXY" W/ "XP ANCHOR" RODS BY SIMPSON STRONG-TIE
 - 2. "HIT HY 200" W/ STANDARD HAS ANCHOR RODS BY HILTI
 - 3. "PURE110+" WITH THREADED RODS BY DEWALT (STANDARD CURE)
 - 4. "AUG200+" WITH THREADED RODS BY DEWALT (RAPID CURE)
 - b. FOR MASONRY APPLICATIONS
 - 1. "HIT HY 70" W/ STANDARD HAS ANCHOR RODS BY HILTI
3. SCREW ANCHORS:
 - 1. "TITEN HD" BY SIMPSON STRONG-TIE
 - 2. "SCREW BOLT+" BY DEWALT

11. STAIRS, HAND RAILS, GUARD RAILS & GRAB BARS

- A. SEE ARCH DWGS FOR STAIR CONFIGURATION AND CONSTRUCTION TYPE.
- B. UNLESS SPECIFICALLY DETAILED ON THE STRUCTURAL DRAWINGS, ALL STAIRS, LANDINGS, LANDING POSTS, GUARD RAILS, HAND RAILS AND THEIR CONNECTIONS TO THE SUPPORTING STRUCTURE SHALL BE DESIGNED BY THE CONTRACTOR/STAIR SUPPLIER/FABRICATOR TO SUPPORT THE DESIGN LOADS PRESCRIBED IN THE GOVERNING BUILDING CODE AND AS NOTED BELOW.
- C. GUARD RAIL INFORMATION INDICATED ON ARCHITECTURAL SECTIONS, DETAILS AND/OR BUILDING ELEVATIONS SHALL REPRESENT MINIMUM ARCHITECTURAL REQUIREMENTS. THE SUPPLIER SHALL PROVIDE LARGER MEMBERS AND/OR CLOSER MEMBER SPACING WHERE REQUIRED BY HIS/HER STRUCTURAL DESIGN OF THE GUARD RAIL SYSTEM. THE CONTRACTOR'S ORIGINAL BID PRICE SHALL ANTICIPATE ALL FINAL GUARDRAIL COSTS AND CONDITIONS. THE SUBMITTAL AND CONSTRUCTION OF MEMBER SIZES THAT ARE LARGER THAN THOSE INDICATED ON THE ARCHITECTURAL DRAWINGS SHALL NOT BE AN ACCEPTABLE BASIS FOR AN ADDITIVE CHANGE ORDER FROM THE CONTRACTOR. THE SUBMITTAL AND CONSTRUCTION OF MEMBER SPACING THAT IS CLOSER THAN THAT INDICATED ON THE ARCHITECTURAL DRAWINGS SHALL NOT BE AN ACCEPTABLE BASIS FOR AN ADDITIVE CHANGE ORDER FROM THE CONTRACTOR.
- D. GUARD RAIL TO SUPPORTING STRUCTURE CONNECTION DETAILS SHOWN ON THE STRUCTURAL DRAWINGS ARE SCHEMATIC IN NATURE AND ARE SHOWN FOR ILLUSTRATIVE PURPOSES ONLY.
- E. HANDRAIL ASSEMBLIES AND GUARDS SHALL BE DESIGNED TO RESIST A LOAD OF 50 PLF APPLIED IN ANY DIRECTION AT THE TOP AND TO TRANSFER THIS LOAD THROUGH THE SUPPORTS TO THE STRUCTURE.
- F. HANDRAIL ASSEMBLIES AND GUARDS SHALL BE ABLE TO RESIST A SINGLE CONCENTRATED LOAD OF 200 LBS APPLIED IN ANY DIRECTION AT ANY POINT ALONG THE TOP, AND SHALL HAVE ATTACHMENT DEVICES AND SUPPORTING STRUCTURE TO TRANSFER THIS LOADING TO APPROPRIATE STRUCTURAL ELEMENTS OF THE BUILDING. THIS LOAD NEED NOT BE ASSUMED TO ACT CONCURRENTLY WITH THE LOADS SPECIFIED IN THE PRECEDING NOTE.
- G. INTERMEDIATE RAILS (ALL THOSE EXCEPT THE HANDRAIL), BALUSTERS AND PANEL FILLERS SHALL BE DESIGNED TO WITHSTAND A HORIZONTALLY APPLIED NORMAL LOAD OF 50 LBS ON AN AREA EQUAL TO 1 SQUARE FOOT, INCLUDING OPENINGS AND SPACE BETWEEN RAILS. REACTIONS DUE TO THIS LOADING ARE NOT REQUIRED TO BE SUPERIMPOSED WITH REACTIONS DUE TO LOADS SPECIFIED IN THE PRECEDING NOTES.
- H. GRAB BARS SHALL BE DESIGNED TO RESIST A SINGLE CONCENTRATED LOAD OF 250 LBS APPLIED IN ANY DIRECTION AT ANY POINT.



12. MASONRY

- A. MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS (F'm) SHALL BE 1500 PSI.
- B. MATERIAL SHALL BE AS FOLLOWS: - CMU.....NORMAL WEIGHT, ASTM C-90 (UNIT STRENGTH = 1900 PSI) - MORTAR.....TYPE "S" FOR WALLS NOT IN CONTACT WITH EARTH, TYPE "M" FOR WALLS IN CONTACT WITH EARTH.
- C. GROUT FOR CONCRETE MASONRY WALL SHALL CONFORM TO ASTM C476. A MIN $f_c' = 3,000$ PSI GROUT SHALL BE CONSOLIDATED BY THOROUGHLY RODDING ALL CELLS.
- D. ROUT PLACEMENT SHALL BE LOW-LIFT. THE CONSTRUCTION JOINTS ARE CREATED BY THE LEVEL OF GROUT STOPPING 1-1/2" FROM TOP OF MASONRY AND THE STEEL REINFORCING PROJECTING ABOVE THE TOP COURSE FOR A SUFFICIENT HEIGHT TO PROVIDE A LAP AT THE SPLICING. SEE S6 SERIES FOR LAP SPLICE LENGTH. THE CONSTRUCTION JOINT SHALL BE LOCATED 3'-0" MINIMUM FROM TOP AND BOTTOM OF STRUCTURAL ELEMENTS SUCH AS SLABS, ROOFS, ETC.
- E. ALL CMU SHALL BE PLACED IN RUNNING BOND.
- F. CONCRETE MASONRY WALLS SHALL BE TEMPORARILY BRACED DURING ERECTION. REMOVE TEMPORARY BRACING ONLY AFTER WALLS ARE CONNECTED TO SUPPORTING ELEMENTS.
- G. EXCEPT FOR BASEMENT WALLS, ALL CONCRETE BLOCK BELOW GRADE SHALL HAVE ALL CELLS FILLED WITH GROUT.
- H. ALL CELLS CONTAINING REINFORCEMENT SHALL BE GROUTED SOLID.
- I. MAXIMUM CONTROL JOINT SPACING IN MASONRY WALL = 25'-0" UNLESS NOTED. SEE ARCHITECTURAL DRAWINGS FOR LOCATION.
- J. UNLESS SPECIFICALLY NOTED OTHERWISE, ALL CMU WALLS SHALL BE REINFORCED AS FOLLOWS:

13. TYPICAL FASTENING SCHEDULE U.N.C.

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER 1	SPACING AND LOCATION
ROOF		
BLOCKING BETWEEN CEILING JOISTS, RAFTERS OR TRUSSES TO TOP PLATE OR OTHER FRAMING BELOW	3-8d COMMON 3-10d BOX 3-3" x 0.131" NAILS	EACH END, TOENAIL
BLOCKING BETWEEN RAFTERS OR TRUSS NOT AT THE WALL TOP PLATE, TO RAFTER OR TRUSS	3-8d COMMON 2-3" x 0.131" NAILS	EACH END, TOENAIL
	2-16d COMMON 3-3" x 0.131" NAILS	END NAIL
FLAT BLOCKING TO TRUSS AND WEB FILLER	16d COMMON 3-3" x 0.131" NAILS	FACE NAIL, @ 6" o.c.
CEILING JOISTS TO TOP PLATE	3-8d COMMON 3-10d BOX 3-3" x 0.131" NAILS	EACH JOIST, TOENAIL
CEILING JOIST NOT ATTACHED TO PARALLEL RAFTER, LAPS OVER PARTITIONS (NO THRUST) (SEE IBC SECTION 2308.7.3.1, TABLE 2308.7.3.1)	3-16d COMMON 4-10d BOX 4-3" x 0.131" NAILS	FACE NAIL
CEILING JOIST ATTACHED TO PARALLEL RAFTER (HEEL JOINT) (SEE IBC SECTION 2308.7.3.1, TABLE 2308.7.3.1)	PER TABLE 2308.7.3.1	FACE NAIL
COLLAR TIE TO RAFTER	3-10d COMMON 4-10d BOX 4-3" x 0.131" NAILS	FACE NAIL
RAFTERS TO TOP PLATE (SEE IBC SECTION 2308.7.5, TABLE 2308.7.5)	3-10d COMMON 3-16d BOX 4-10d BOX 4-3" x 0.131" NAILS	TOENAIL
ROOF RAFTERS TO RIDGE VALLEY OR HIP RAFTERS; OR ROOF RAFTER TO RIDGE BEAM	2-16d COMMON 3-10d BOX 3-3" x 0.131" NAILS	END NAIL
	3-10d COMMON 4-16d BOX 4-10d BOX 4-3" x 0.131" NAILS	TOENAIL

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER 1	SPACING AND LOCATION
WALL		
STUD TO STUD (NOT AT BRACED WALL PANELS) 5	16d COMMON	16" o.c. FACE NAIL
	10d BOX 3" x 0.131" NAILS	12" o.c. FACE NAIL
STUD TO STUD AND ABUTTING STUDS AT INTERSECTING WALL CORNERS (AT BRACED WALL PANELS) ⁵	16d COMMON	6" o.c. FACE NAIL
	16d BOX 3" x 0.131" NAILS	6" o.c. FACE NAIL
BUILT-UP SOLID SAWN HEADERS 4	16d COMMON	16" o.c. EACH EDGE, FACE NAIL
	16d BOX	12" o.c. EACH EDGE, FACE NAIL
CONTINUOUS HEADER TO STUD	4-10d COMMON 4-10d BOX	TOENAIL
TOP PLATE TO TOP PLATE	16d COMMON	16" o.c. FACE NAIL
	10d BOX 3" x 0.131" NAILS	12" o.c. FACE NAIL
TOP PLATE, LAPS AT CORNERS AND INTERSECTIONS	2-16d COMMON 3-10d BOX 3-3" x 0.131" NAILS	FACE NAIL
TOP PLATE SPLICE @ NON-SHEAR WALL	8-16d COMMON 12-10d BOX 12-3" x 0.131" NAILS	EACH SIDE OF END JOINT FACE NAIL (MINIMUM 24" SPLICE LENGTH EACH SIDE END JOINT)
TOP PLATE SPLICE @ BRACING WALL (UNIFORM WALL THICKNESS)		
TOP PLATE SPLICE @ BRACING WALL (2x4/2x6 TRANSITION @ SINGLE INTERIOR/NON-DEMISING)		
BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST OR BLOCKING (NOT AT BRACING WALL PANELS)		16" o.c. FACE NAIL
	16d BOX 3" x 0.131" NAILS	12" o.c. FACE NAIL
BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST OR BLOCKING AT BRACING WALL PANELS		
STUD TO TOP OR BOTTOM PLATE (2x4 WALL)	2-10d BOX 2-3" x 0.131" NAILS	TOENAIL
	2-16d COMMON 2-10d BOX 2-3" x 0.131" NAILS	END NAIL
STUD TO TOP OR BOTTOM PLATE (2x6 WALL)	3-10d BOX 3-3" x 0.131" NAILS	TOENAIL
	2-16d COMMON 3-10d BOX 3-3" x 0.131" NAILS	END NAIL
STUD TO TOP OR BOTTOM PLATE (2x8 WALL)	4-10d BOX 4-3" x 0.131" NAILS	TOENAIL
	4-16d COMMON 5-10d BOX 5-3" x 0.131" NAILS	END NAIL
TOP PLATE, LAPS AT CORNERS AND INTERSECTIONS	2-16d COMMON 3-10d BOX 3-3" x 0.131" NAILS	FACE NAIL

14. SECTION NOT USED

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER 1	SPACING AND LOCATION
FLOOR		
JOIST TO SILL, TOP PLATE, OR GIRDER	3-8d COMMON 3-10d BOX 3-3" x 0.131" NAILS	TOENAIL
RIM JOIST, BAND JOIST, OR BLOCKING TO TOP PLATE, SILL OR OTHER FRAMING BELOW	8d COMMON 10d BOX 3" x 0.131" NAILS	6" o.c. TOENAIL
1" x 6" SUBFLOOR OR LESS TO EACH JOIST	2-8d COMMON 2-10d BOX	FACE NAIL
2" SUBFLOOR TO JOIST OR GIRDER	2-16d COMMON	FACE NAIL
2" PLANKS (PLANK & BEAM - FLOOR & ROOF)	2-16d COMMON	EACH BEARING, FACE NAIL
BUILT-UP SOLID SAWN GIRDERS AND BEAMS 4	20d COMMON	32" o.c. FACE NAIL AT TOP AND BOTTOM STAGGERED ON OPPOSITE SIDES
	10d BOX 3" x 0.131" NAILS	24" o.c. FACE NAIL AT TOP AND BOTTOM STAGGERED ON OPPOSITE SIDES
	2-20d COMMON 3-10d BOX 3-3" x 0.131" NAILS	ENDS AND AT EACH SPLICING, FACE NAIL
LEDGER STRIP SUPPORTING JOISTS OR RAFTERS	3-16d COMMON 4-10d BOX 4-3" x 0.131" NAILS	EACH JOIST OR RAFTER, FACE NAIL
JOIST TO BAND JOIST OR RIM JOIST	3-16d COMMON 4-10d BOX 4-3" x 0.131" NAILS	END NAIL
BRIDGING OR BLOCKING TO JOIST, RAFTER OR TRUSS	2-8d COMMON 2-10d BOX 2-3" x 0.131" NAILS	EACH END, TOENAIL

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER ¹	SPACING AND LOCATION	
WOOD STRUCTURAL PANELS AT NON-SHEAR WALL CONDITIONS, SUBFLOOR, AND ROOF			
		EDGES (INCHES)	INTERMEDIATE SUPPORTS (INCHES)
3/8" - 1/2" WOOD STRUCTURAL PANELS AT NON-BRACING WALL CONDITIONS ³	6d COMMON OR DEFORMED (SUBFLOOR AND WALL)	6	12
	8d COMMON OR DEFORMED (ROOF) OR RSRS-01 (2 3/8" x 0.113") NAIL (ROOF)	6	12
	2 3/8" x 0.113" NAIL (SUBFLOOR AND WALL)	6	12
	2 3/8" x 0.113" NAIL (ROOF)	4	8
19/32" - 3/4" WOOD STRUCTURAL PANELS AT NON-BRACING WALL CONDITIONS ³	8d COMMON 6d DEFORMED (2" x 0.113") (SUBFLOOR AND WALL)	6	12
	8d COMMON OR DEFORMED (ROOF) OR RSRS-01 (2 3/8" x 0.113") NAIL (ROOF)	6	12
	2 3/8" x 0.113" NAIL (ROOF)	4	8
7/8" - 1 1/4" WOOD STRUCTURAL PANELS AT NON-BRACING WALL CONDITIONS ³	10d COMMON 8d DEFORMED (2 1/2" x 0.131")	6	12
ROOF SHEATHING	SEE GENERAL NOTES 8.A.1		
FLOOR SHEATHING	SEE GENERAL NOTES 8.A.2		
NON-STRUCTURAL PANEL SIDING TO FRAMING			
1/2" OR LESS	6d CORROSION-RESISTANT SIDING (1 7/8" x 0.106") 6d CORROSION-RESISTANT CASING (2" x 0.099")	6	12
5/8"	8d CORROSION-RESISTANT SIDING (2 3/8" x 0.128") 8d CORROSION-RESISTANT CASING (2 1/2" x 0.113")	6	12

FOOTNOTES:

1. COMMON OR BOX NAILS ARE PERMITTED TO BE USED EXCEPT WHERE OTHERWISE STATED.
2. SEE GENERAL NOTES 12 FOR ADDITIONAL INFORMATION ON WOOD FASTENERS.
3. SEE 1/S401 FOR ADDITIONAL INFORMATION REGARDING WOOD BRACING WALL FASTENING.
4. SEE SHEET 2/S402 BEAM/HEADER SCHEDULE NOTES FOR LVL BEAM FASTENING PATTERNS AND INFORMATION.
5. SEE SHEET 2/S402 BUILT UP COLUMN NOTES FOR BUILT UP COLUMN FASTENING



A circular Georgia Registered Professional Engineer seal. The outer ring contains the words "GEORGIA" at the top and "REGISTERED" at the bottom. The inner circle contains "No. PE045304" at the top and "PROFESSIONAL" at the bottom. The name "MICHAEL R. FERNANDEZ" is written across the bottom of the inner circle. The seal is surrounded by a blue, wavy, hand-drawn style signature.

APPENDIX 11, 1970


Issued for Construction

GENERAL NOTES	
Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF
S003	

15. TYPICAL ABBREVIATIONS


ADD'L ADD	ADDITIONAL	GA	GAGE	GAUGE	PT	POST TENSIONED	PRESERVATIVE	
AB, ABOLT	ANCHOR BOLT	GALV	GALVANIZED		PTL	TREATED LUMBER		
ARCH	ARCHITECTURAL	GC	GENERAL	CONTRACTOR	PTS	POINTS		
@	AT							
BM	BEAM	HD	HEAD		REF	REFERENCE		
BRG	BEARING	HDR	HEADER		RET	RETAINING		
BLK	BLOCK	HGT	HEIGHT		REV	REVISION		
BLKNG	BLOCKING	HI	HIGH		REINF	REINFORCING		
BOTT, B	BOTTOM, BOTTOM	HK	HOOK		REQD	REQUIRED		
BLDG	BUILDING	HORIZ	HORIZONTAL		REQS	REQUIREMENTS		
BTWN	BETWEEN	HR	HOUR		REBAR	REINFORCING BAR		
CANT	CANTILEVER	INFO	INFORMATION					
CG	CENTER OF GRAVITY	INT	INTERIOR					
CL, CLR	CLEAR	JG	JOIST GIRDER					
COL	COLUMN	JST	JOIST					
CONC	CONCRETE	JT	JOINT					
COND	CONDITION	K-FT	KIP-FEET					
CONN	CONNECTION	K/FT	KIPS PER FOOT					
CMU	CONCRETE MASONRY	K	KIPS					
CONST	CONSTRUCTION	LG	ANGLE					
CONT	CONTINUOUS	LLO	LONG LEG OUT					
CONTR	CONTRACTOR	LLV	LONG LEG VERTICAL					
DB	DROP BEAM	LO	LOW					
DET, DT'L	DETAIL	LOC'N	LOCATION					
DIA	DIAMETER							
DIAG	DIAGRAM							
DIM	DIMENSION							
DSN	DESIGN							
DWG	DRAWING							
DWL	DOWEL							
EA	EACH	MFG, MFR	MANUFACTURER					
EF	EACH FACE	MFG'R	MANUFACTURER					
ELEV, EL	ELEVATION	MECH	MECHANICAL					
EMBED	EMBEDMENT	MAT'L	MATERIAL					
EOS	EDGE OF SLAB	MAX	MAXIMUM					
EQ	EQUAL	MIN	MINIMUM					
ETC	ET CETERA	MISC	MISCELLANEOUS					
ET	EACH WAY	NA	NEUTRAL AXIS					
EXIST	EXISTING	NIC	NOT IN CONTRACT					
EXP	EXPANSION	NOM	NOMINAL					
EJ	EXPANSION JOINT	No.	NUMBER					
EXT	EXTERIOR	NTS	NOT TO SCALE					
F/	FACE OF	OC	ON CENTER					
F/WALL	FACE OF WALL	OPNG	OPENING					
FB	FLUSH BEAM	OH	OPPOSITE HAND					
FIN FL	FINISHED FLOOR	PAF	POWDER ACTUATED					
FFE	ELEVATION	PL, PLT	FASTENER					
FL, FLR	FLOOR	PSF	PLATE					
FRT	FIRE RETARDANT	PSI	POUNDS PER SQ. FOOT					
FRG	FRAMING		POUNDS PER SQ. INCH					
FTG	FOOTING							
FT	FEET, FOOT							
FLG	FLANGE							

16. COMPONENTS & CLADDING SCHEDULE

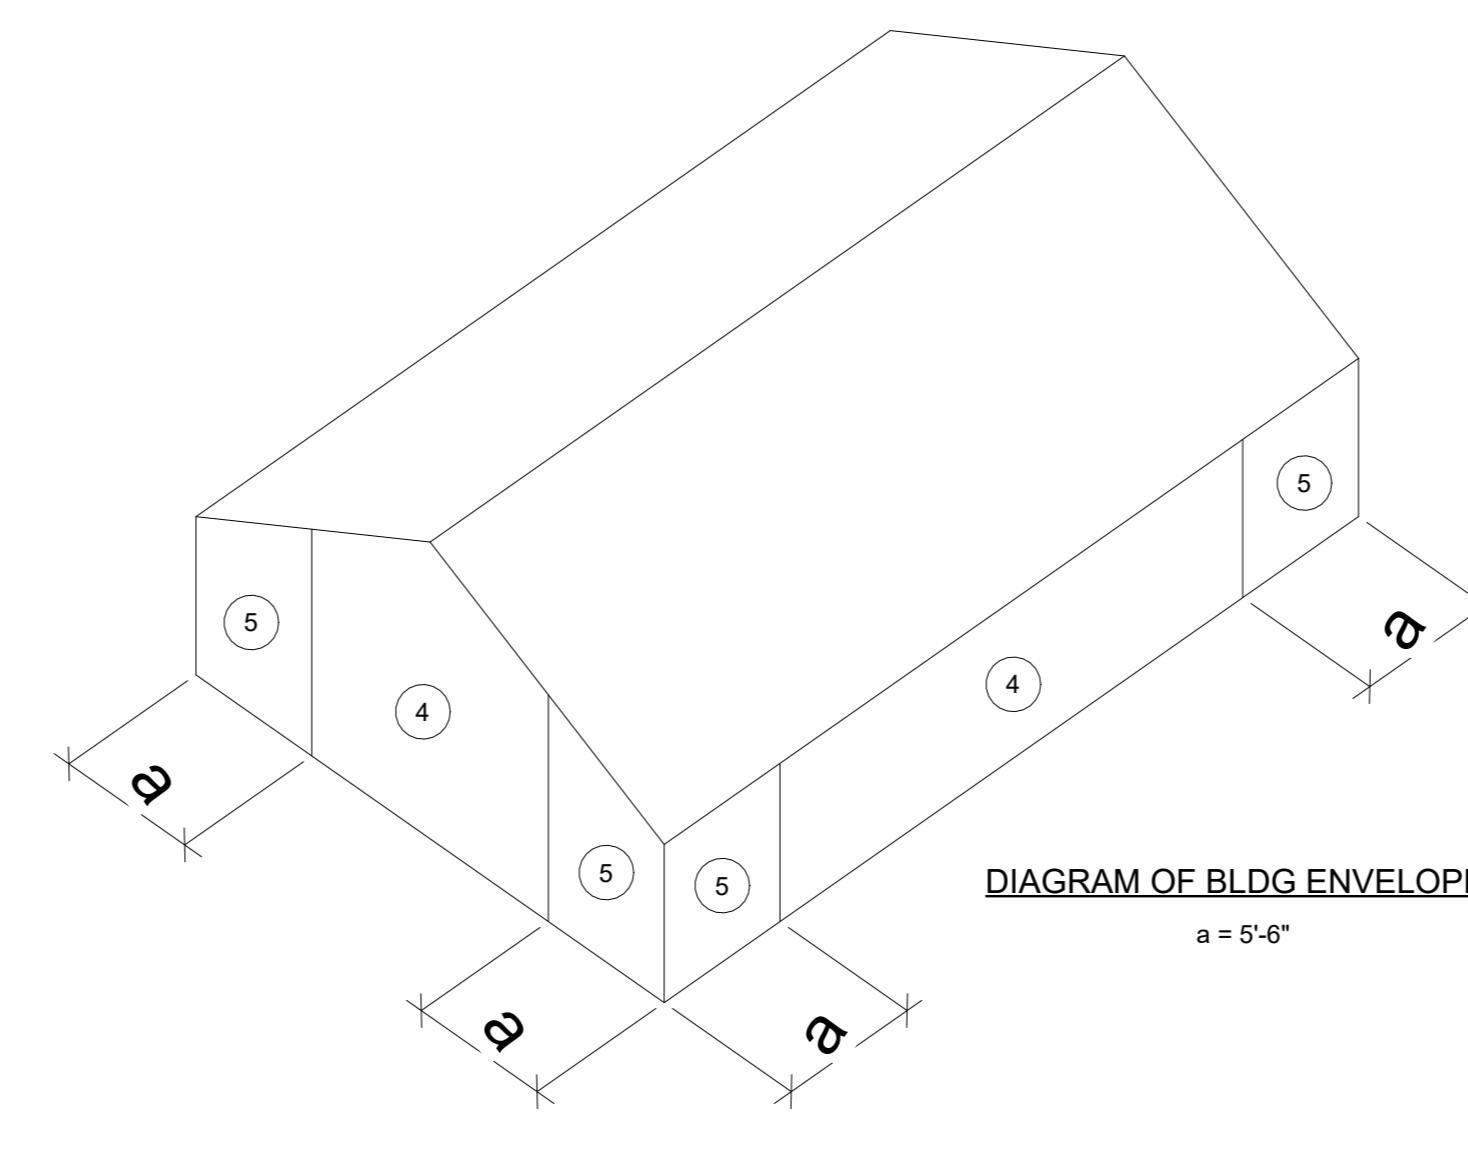

COMPONENT & CLADDING DESIGN WIND PRESSURES FOR EXTERIOR WALLS (ULTIMATE/SERVICE) (PSF)				
LOCATION	EFFECTIVE WIND AREA			
	10 FT ²	50 FT ²	100 FT ²	200 FT ²
NEGATIVE ZONE 4	-28.8 / -17.3	-26.6 / -16.0	-25.7 / -25.7	-24.8 / -24.8
POSITIVE ZONE 5	+34.0 / +20.4	+29.7 / +17.8	+27.9 / +27.9	+26.0 / +26.0
POSITIVE ZONE 4 & 5	+27.1 / +16.2	+24.9 / +14.9	+24.0 / +24.0	+23.0 / +23.0

NOTES:
1. POSITIVE PRESSURE DENOTES WIND TOWARD WALL SURFACE, AND NEGATIVE PRESSURE DENOTES WIND AWAY FROM WALL SURFACE.

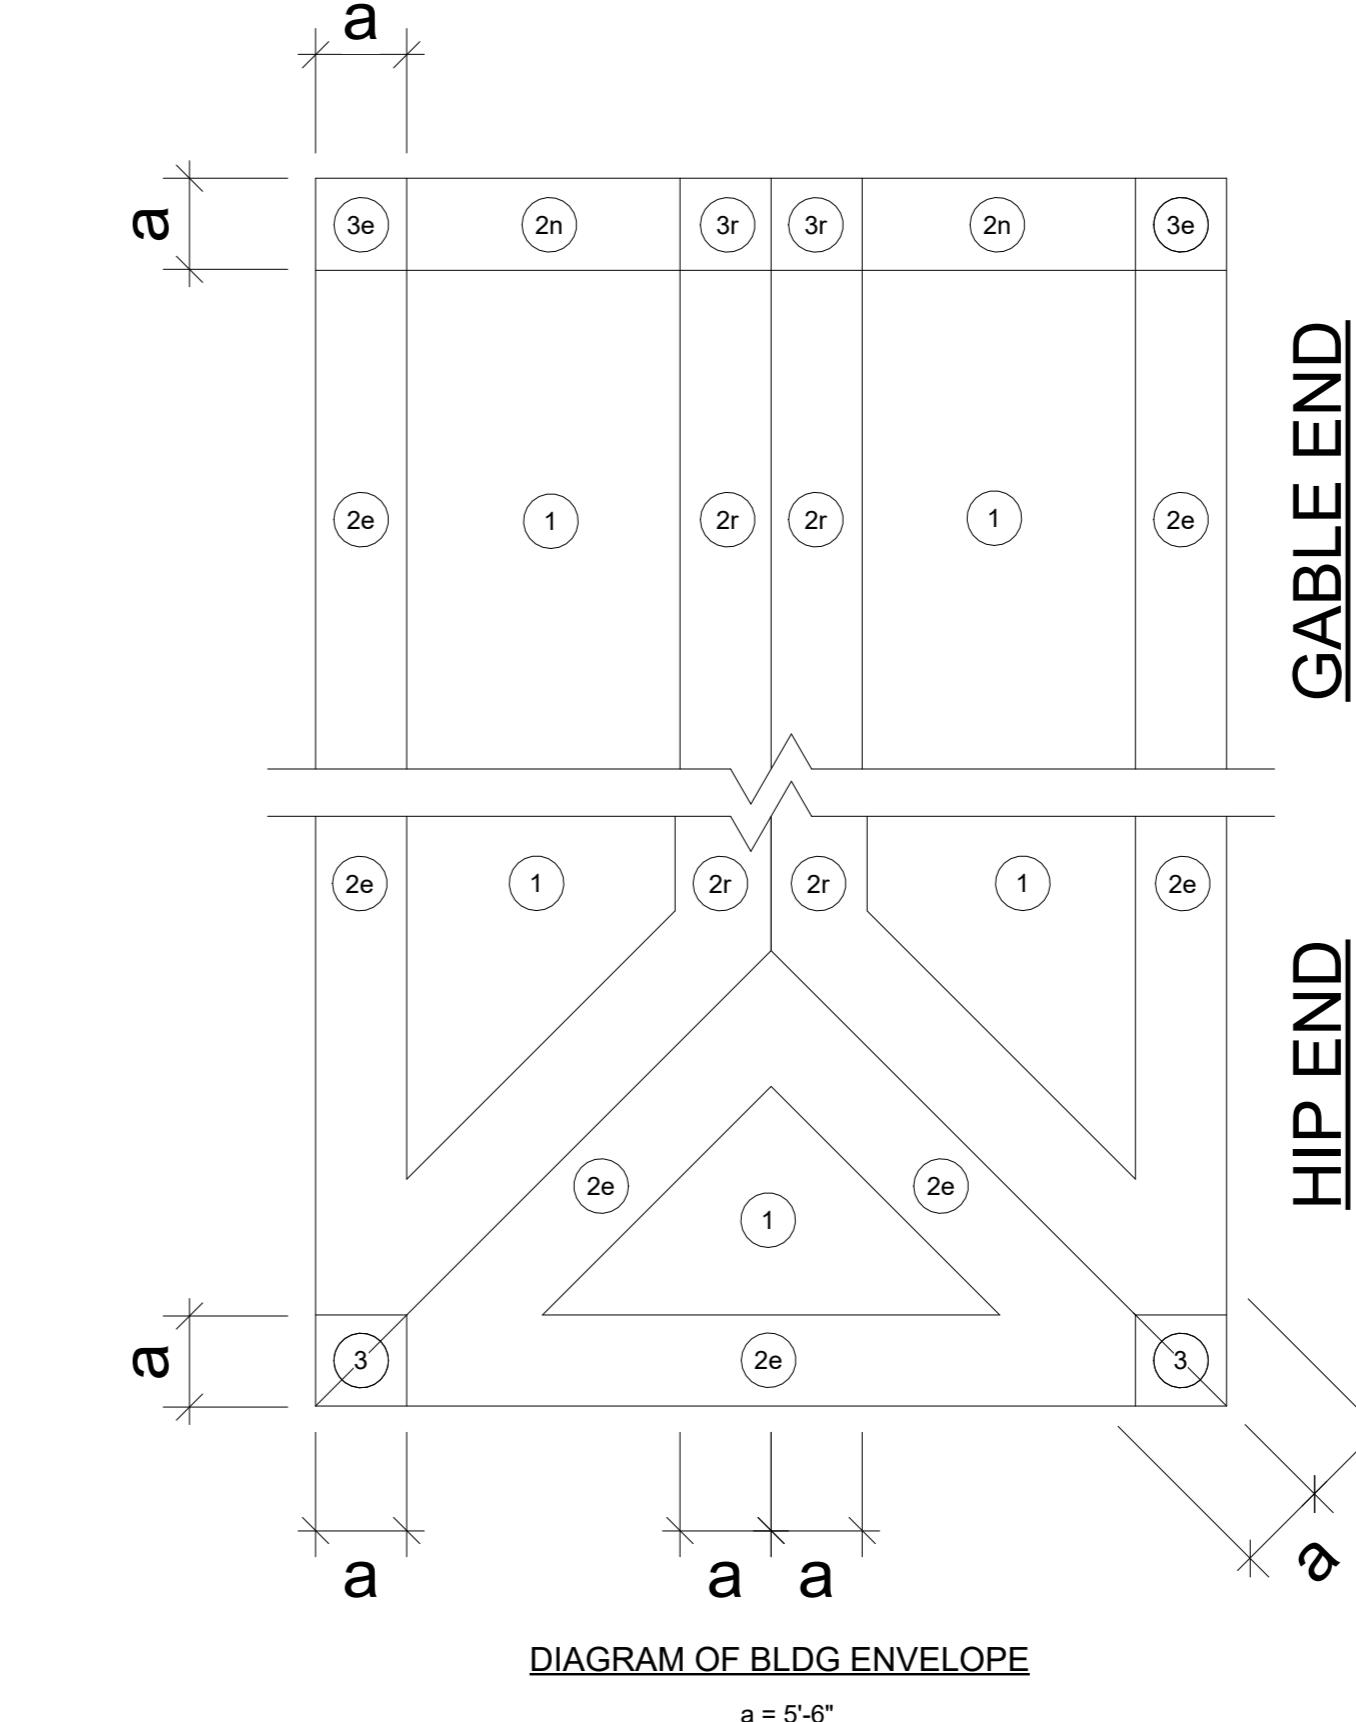

COMPONENT & CLADDING GROSS DESIGN WIND PRESSURES ALONG ROOF (ULTIMATE/SERVICE) (PSF)				
LOCATION	EFFECTIVE WIND AREA			
	10 FT ²	50 FT ²	100 FT ²	
NEGATIVE ZONE 1 & 2e	-41.0 / -24.6	-28.8 / -17.3	-16.0 / -14.1	
NEGATIVE ZONE 2n, 2r & 3e	-44.5 / -24.7	-35.1 / -21.1	-36.5 / -18.7	
NEGATIVE ZONE 3r	-53.1 / -26.7	-40.8 / -24.5	-41.3 / -21.3	
POSITIVE ALL ZONES	+25.3 / +15.2	+20.4 / +12.2	+16.0 / +11.0	
POSITIVE ZONE 1,2e,2r	-45.4 / -27.2	-33.2 / -19.9	-31.3 / -16.8	
OVERHANG ZONE 2n & 3r	-48.9 / -29.3	-39.5 / -23.7	-50.7 / -21.3	
OVERHANG ZONE 3e	-57.5 / -34.5	-45.1 / -27.1	-46.8 / -23.9	

NOTES:
1. POSITIVE PRESSURE DENOTES WIND TOWARD ROOF SURFACE, AND NEGATIVE PRESSURE DENOTES WIND AWAY FROM ROOF SURFACE.



www.fernz-structural.com

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.com

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundary
2179 Sumter Lake Drive
Marietta, GA 30062
470.357.5865
office@cleverhomellc-gc.com



November 14, 2025

Issuances

No.	Description	Date
	Issued for Permit	11/14/25

Issued for
Construction

GENERAL NOTES

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S004



PROJECT: Fleeman Residence Remodel & Addition
5 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
3 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
morrison@madearch.design

WNERS: Roy and Kate Fleeman
0 Hunt Street NE
arietta, GA 30060
y: 770.274.9559
kfleeman@gmail.com
katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
8 Thomas Road
Cleveland, GA 30528
6.969.5636
ke@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Earls Mundaray
79 Sumter Lake Drive
Marietta, GA 30062
0.357.5865
ice@cleverhomellc-gc.com

FOUNDATION NOTES

1. ALL FOOTINGS SHALL BE CENTERED BELOW COLUMNS AND WALLS UNLESS SPECIFICALLY SHOWN OTHERWISE ON PLAN OR DETAILS.
2. SEE 2/S601 FOR TYPICAL PIPE BELOW WALL FOOTING DETAIL. PRESSURIZED LIQUID PIPES SHALL NOT PASS BELOW FOOTING. NO PIPES SHALL PASS BELOW COLUMN FOOTINGS.
3. WARP FINISHED CONCRETE SURFACE AT BLDG ENTRANCES AS REQ'D.
4. SEE GENERAL NOTES FOR LUMBER SPECIES & GRADE INFO.
5. GEOTECHNICAL ENGINEER SHALL VERIFY EXISTING ALLOWABLE BEARING PRESSURE AT ALL FTG EXCAVATIONS PRIOR TO FTG PLACEMENT.
6. SEE ARCHITECTURAL UNIT PLANS FOR EXACT DIMS TO INTERIOR BEARING WALLS, SLAB RECESSES, SLOPED AREAS.
7. SEE ARCH DWGS FOR TOP OF SLAB ELEVATIONS, SLAB STEPS, AND SLOPES.
8. SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

FOUNDATION LEGEND

298

DENOTES TOP OF SLAB ELEVATION. SLAB SLOPES ARE NOT SHOWN ON STRUCTURAL DWGS. SEE ARCH DWGS FOR SLAB SLOPES.

DENOTES 8" OR 12" CMU WALL. SEE GEN NOTES & S9.1 FOR TYP REINF UNO.

DENOTES CIP CONC WALL.

TOF

DENOTES TOP OF FOOTING ELEVATION. TOP OF COL FOOTING SHALL MATCH TOP OF ADJACENT WALL FOOTING UNO.

TOW

DENOTES TOP OF WALL ELEVATION.

DENOTES FOOTING STEP. SEE 10/S6.1 FOR TYP DETAIL

+298

DENOTES APPROXIMATE EXTERIOR SPOT ELEVATION. THESE ELEV'S WERE USED AS THE BASIS FOR SETTING THE TOP OF FOOTING ELEV'S SHOWN ON PLAN. SPOT ELEV'S ON STRUCT DWGS ARE NOT TO BE USED FOR EARTHWORK AND GRADING OPERATIONS. IF FINAL GRADES SHOWN ON CIVIL DWGS DEVIATE FROM SPOT ELEV'S SHOWN ON STRUCT DWGS THE GC SHALL NOTIFY THE STRUCTURAL ENGINEER BEFORE FTG PLACEMENT. IF GRADES SHOWN ON CIVIL ARE LOWER, FOOTING ELEVATIONS SHALL BE LOWERED TO MAINTAIN BOTT OF FOOTINGS AT 18" MIN BELOW GRADE

INDICATES SLAB STEP. SEE ARCH DWGS FOR EXACT STEP DIMENSION.

INDICATES RECESS OR SLOPING SLAB AREAS. SEE ARCH FOR RECESS DIM & SLOPE LENGTH.

INDICATES CONTROL JOINT OR CONSTRUCTION JOINT. SEE 1/S601 FOR DETAILS.

DENOTES FOUNDATION ANCHOR LOCATION. ANCHOR TYPE, INSTALLATION, AND ATTACHMENT IS THE RESPONSIBILITY OF THE CONTRACTOR. SEE 7/S601 FOR ADDITIONAL INFO.

A circular Georgia Registered Professional Engineer seal. The outer ring contains the words "GEORGIA" at the top and "REGISTERED" on the left, with "PROFESSIONAL" on the right and "ENGINEER" at the bottom. The inner circle contains "No. PE045304" and "PROFESSIONAL". Below the seal, the name "MICHAEL E. FERNANDEZ" is handwritten in blue ink.

November 14, 2022


November 11, 2018

Issued for Construction

FOUNDATION PLAN

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S101

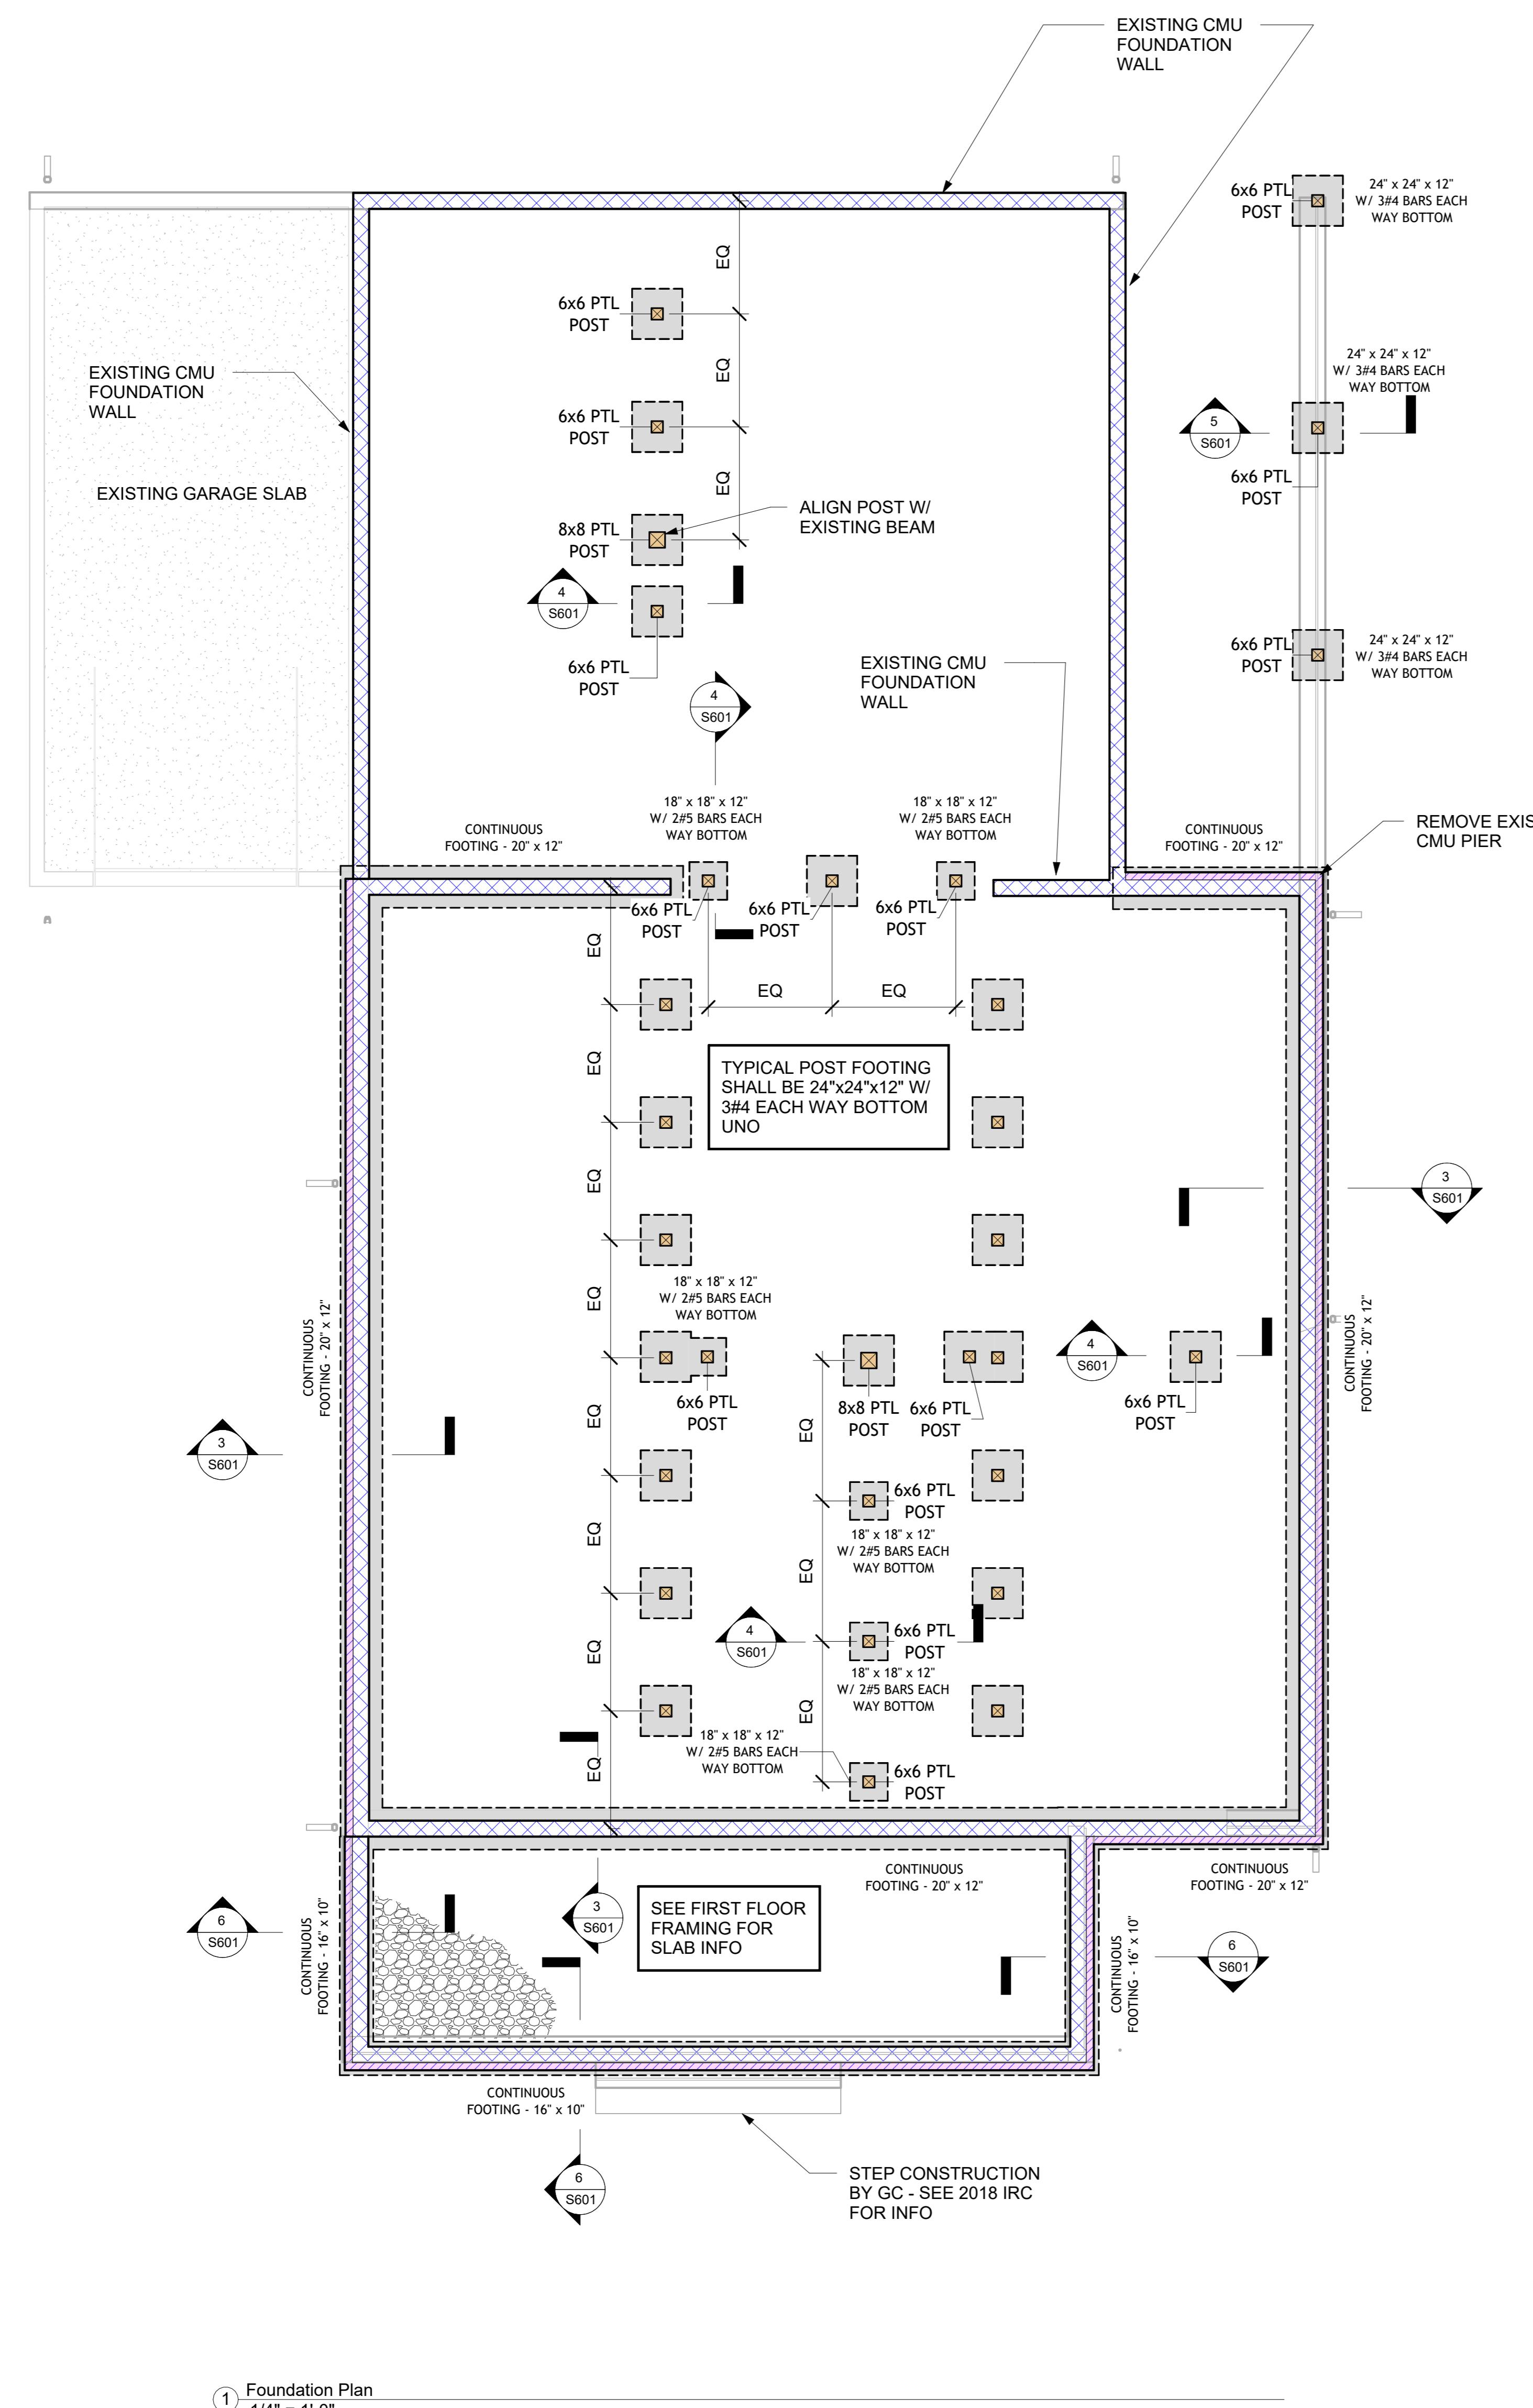

1 Foundation Plan
1/4" = 1'-0"



PROJECT: Fleeman Residence Remodel & Addition
5 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
3 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
morrison@madearch.design

OWNERS: Roy and Kate Fleeman
10 Hunt Street NE
Marietta, GA 30060
Phone: 770.274.9559
Email: rfleeman@gmail.com
Email: katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
8 Thomas Road
Cleveland, GA 30528
6.969.5636
ke@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Earls Mundaray
79 Sumter Lake Drive
Marietta, GA 30062
(0.357.5865
ice@cleverhomelc-gc.com

FLOOR FRAMING NOTES

1. FLOOR FRAMING SHALL BE 2x10'S @ 16" O.C. MAX UNLESS OTHERWISE NOTED ON PLAN.
2. DECK FLOOR FRAMING SHALL BE PRESERVATIVE TREATED 2x8'S @ 16" OC MAX UNLESS OTHERWISE NOTED ON PLAN.
3. TYP SLAB ON GRADE SHALL BE 4" THK CONCRETE SLAB OVER VAPOR BARRIER & COMPACTED SUBGRADE. REINFORCE SLAB WITH FLAT SHEET WWF 6x6-W1.4xW1.4 LOCATED 11/2" FROM TOP OF SLAB.
4. FLOOR FRAMING PLAN IS INTENDED TO DENOTE FLOOR FRAMING BEARING WALLS, BEAMS / HEADERS AND SECTION INFO.
5. SEE S402 FOR THE MIN NUMBER OF WALL STUDS AT BEAM OR GT BEARING POINTS UNLESS NOTED OTHERWISE ON PLAN.
6. THE CENTERLINE OF THE BEAM OR GT SHALL MATCH THE CENTERLINE OF THE SUPPORTING WALL STUDS.
7. ALL JOIST/TRUSS TO BEAM CONNECTIONS SHALL BE LUS SERIES HANGERS TO MATCH JOIST DEPTH AND NUMBER OF PLY'S.
8. ALL BUILT-UP STUD COL'S MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING AT FLOOR CAVITY LOCATIONS AND CONTINUE TO FDN OR BEAM SUPPORT BELOW.
9. ALL CONNECTOR TYPES REFER TO SIMPSON STRONG-TIE SPECIFICATIONS. SEE GENERAL NOTES FOR ADD'L INFO.
10. SEE GENERAL NOTES FOR LUMBER SPECIES AND GRADE INFO.
11. SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

FLOOR FRAMING LEGEND

210-2 LVL10-2	DENOTES WOOD BEAM/HEADER DESIGNATION. FOR ADD'L INFO SEE BEAM/HEADER SCHEDULE ON 2 / S402
2K/1J	DENOTES QUANTITY OF KING STUDS (K) & JAMB STUDS (J) PER HEADER END. FOR STUD INFO SEE 3 / S402
	DENOTES BEARING WALL.
FL 	DENOTES FLUSH BEAM WITH TOP OF BEAM AT TOP OF FLOOR JOIST/TRUSS.
	DENOTES HEADER WITHIN WALL FRAMING. SEE WALL FRAMING PLAN.
DB 	DENOTES DROP BEAM WITH TOP OF BEAM AT OR BELOW JOIST/TRUSS BEARING.
	DENOTES JOIST.
	DENOTES JOIST/BEAM SUPPORT HANGER.
	DENOTES SLOPING SLAB AREAS. SEE ARCH FOR SLOPE LENGTH.
	INDICATES CONTROL JOINT OR CONSTRUCTION JOINT. SEE 1/S601 FOR DETAILS

A circular Georgia Registered Professional Engineer seal. The outer ring contains the word "GEORGIA" at the top and "REGISTERED" at the bottom, separated by a horizontal line. The inner circle contains "No. PE045304" at the top and "PROFESSIONAL" at the bottom, also separated by a horizontal line. The name "MICHAEL FERNANDEZ" is written in the center. The seal is set against a background of blue and white wavy lines.


November 14, 2025

Issued for Construction

FIRST FLOOR FRAMING PLAN

st number	25-060
	10/15/2025
n by	MRF
ed by	MRF

S201

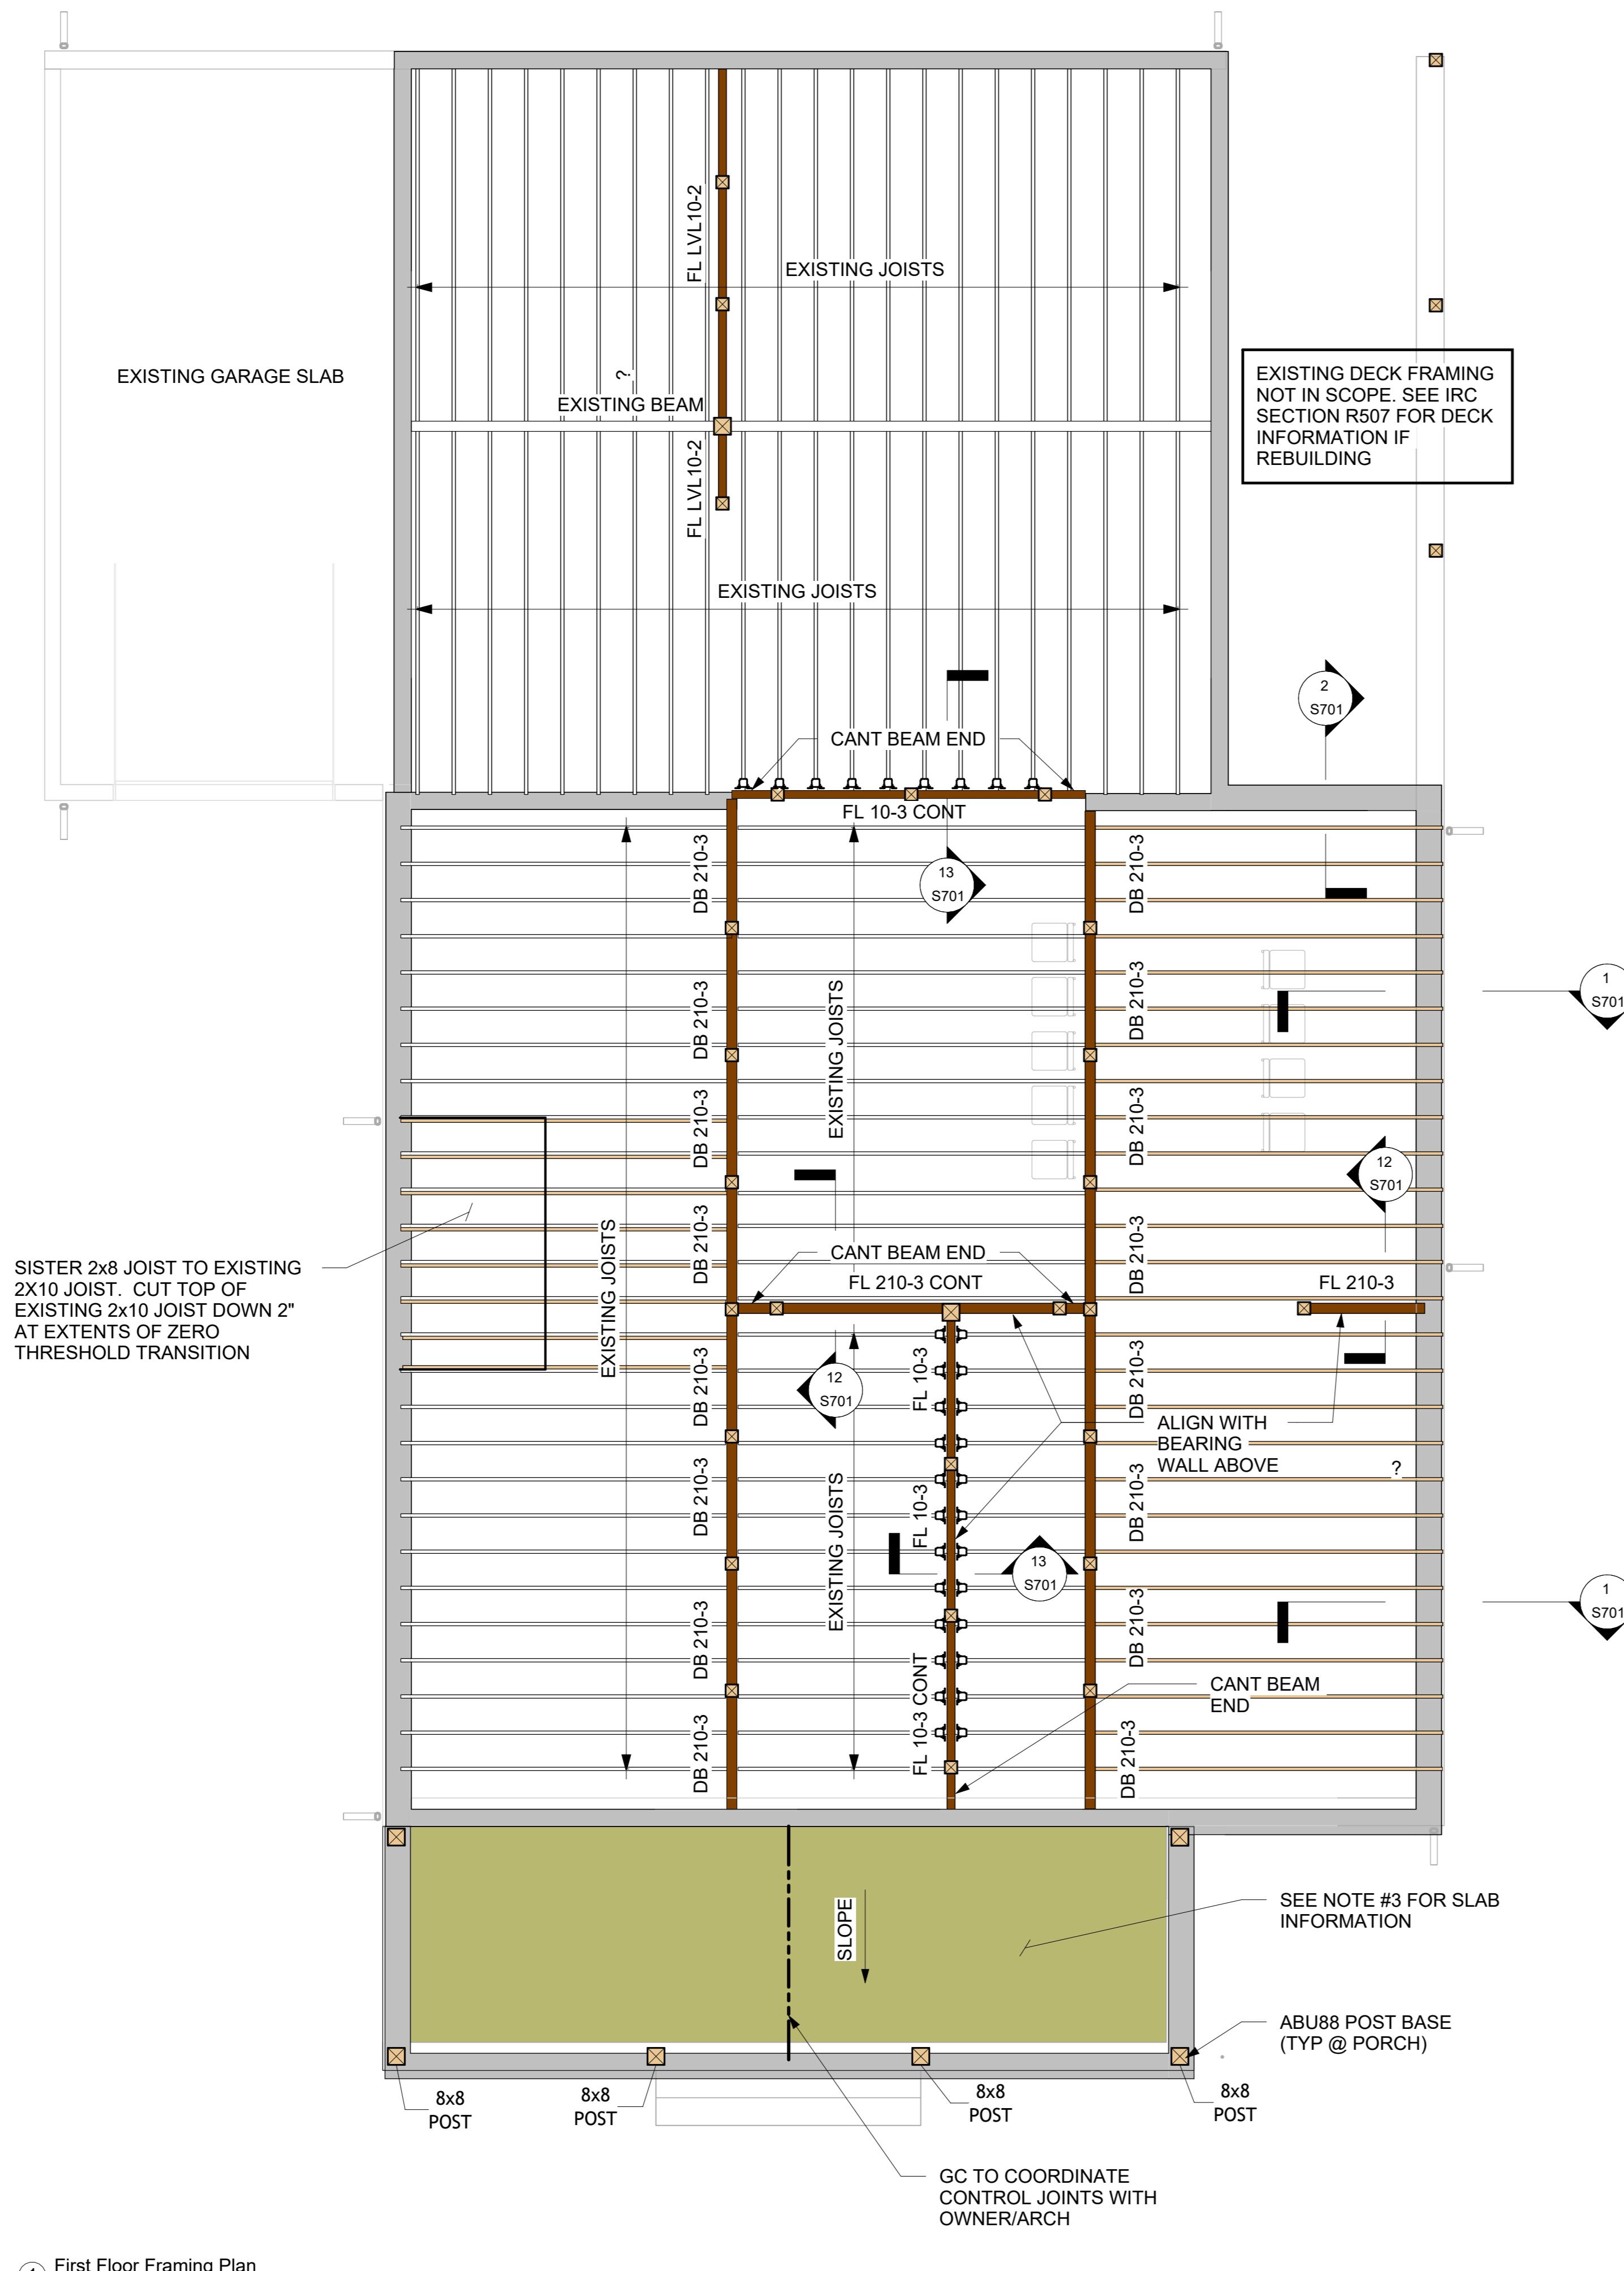

1 First Floor Framing Plan
1/4" = 1'-0"



PROJECT: Fleeman Residence Remodel & Addition
5 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
3 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
morrison@madearch.design

OWNERS: Roy and Kate Fleeman
10 Hunt Street NE
Marietta, GA 30060
Ph: 770.274.9559
kfleeman@gmail.com
katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
8 Thomas Road
Cleveland, GA 30528
6.969.5636
mke@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Jrds Mundaray
79 Sumter Lake Drive
Marietta, GA 30062
0.357.5865
ice@cleverhomellc-gc.com

WALL FRAMING NOTES

1. SEE WALL FRAMING LEGEND BELOW AND PLAN FOR STUD SIZE AND SPACING AT EACH BEARING WALL. ALL STUD WALL OPENINGS SHALL HAVE 1-KING & 1-JAMB STUD EACH END MINIMUM UNLESS OTHERWISE NOTED ON PLAN.
2. FOR THE MIN NUMBER OF ^{2/}WALL STUDS AT BEAM OR GT BEARING POINTS UNO ON PLAN SEE ^{2/}S402
3. THE CENTERLINE OF THE BEAM OR GT SHALL MATCH THE CENTERLINE OF THE SUPPORTING WALL STUDS.
4. FOR ALLOWABLE WALL PLATE & STUD PENETRATIONS AT BRACING AND NON-BRACING WALLS SEE ^{4/}S403
5. WHERE STUD ALIGNMENT IS REQUIRED, FOR ALLOWABLE OFFSET DISTANCE ^{5/}_{BETWEEN} S403 FLOOR/ROOF MEMBER FRAMING AND WALL STUDS SEE ^{5/}S403

4 / S401

6. FOR INTERSECTING BRACING WALL ^{1/}_{FRAMING} DETAILS SEE ^{1/}S401
7. FOR ADD'L BRACING INFO SEE DWG
8. ALL SHEAR WALLS SHALL BE TEMPORARILY BRACED DURING ALL PHASES OF CONSTRUCTION UNTIL PROPERLY SHEATHED PER GENERAL NOTES, S2, & S4 SERIES DRAWINGS.
9. SEE ARCH DWGS FOR EXACT FINISHED FLOOR ELEVATIONS.
10. DO NOT CORE BEAMS OR HEADERS UNLESS SPECIFIED BY EOR.
11. ALL BUILT-UP STUD COL'S MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING AT FLOOR CAVITY LOCATIONS AND CONTINUE TO FDN OR BEAM SUPPORT BELOW.
12. ALL CONNECTOR TYPES REFER TO SIMPSON STRONG-TIE SPECIFICATIONS. SEE GENERAL NOTES FOR ADD'L INFO.
13. SEE GENERAL NOTES FOR LUMBER SPECIES AND GRADE INFO.
14. SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

WALL FRAMING LEGEND

210-2 LVL10-2	INDICATES WOOD HEADER DESIGNATION. SEE BEAM/HEADER SCHEDULE FOR ADD'L INFO ON 2 / S402
2K/1J	DENOTES QUANTITY OF KING STUDS (K) & JAMB STUDS (J) PER HEADER END. SEE STUD INFO SEE 3 / S402
	DENOTES FLUSH BEAM WITH BOTTOM OF BEAM AT FLOOR JOIST/TRUSS BEARING. SEE FLOOR FRAMING PLAN.
	DENOTES HEADER WITHIN WALL FRAMING.
	DENOTES DROP BEAM WITH TOP OF BEAM AT OR BELOW JOIST/TRUSS BEARING.
WS6 GS7	DENOTES BRACING WALL MARK. FOR BRACING WALL SCHEDULES AND CONSTRUCTION REQUIREMENTS SEE 1 / S401
	DENOTES DESIGNATED BRACING WALL EXTENTS. ALL OTHER EXTERIOR WALLS SHALL BE SHEATHING AND FASTENED PER MINIMUM SHEATHING REQUIREMENTS.
	DENOTES 2x6 WALL WITH STUDS @ 16" OC MAX.
	DENOTES 2x6 WALL WITH STUDS @ 12" OC MAX.
	DENOTES 2x4 WALL WITH STUDS @ 16" OC MAX.
	DENOTES 2x4 WALL WITH STUDS @ 12" OC MAX.

A circular Georgia Registered Professional Engineer stamp. The outer ring contains the words "GEORGIA" at the top and "REGISTERED" on the left, with "PROFESSIONAL" on the right. The center contains "No. PE045304" and a five-pointed star. Below the stamp, a blue ink signature of "MICHAEL P. FERNANDEZ" is written, with "ENGINEER" written above "FERNANDEZ".

November 14, 2025


Issued for Construction


FIRST LEVEL WALL FRAMING PLAN

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S202

1 First level Wall Framing Plan

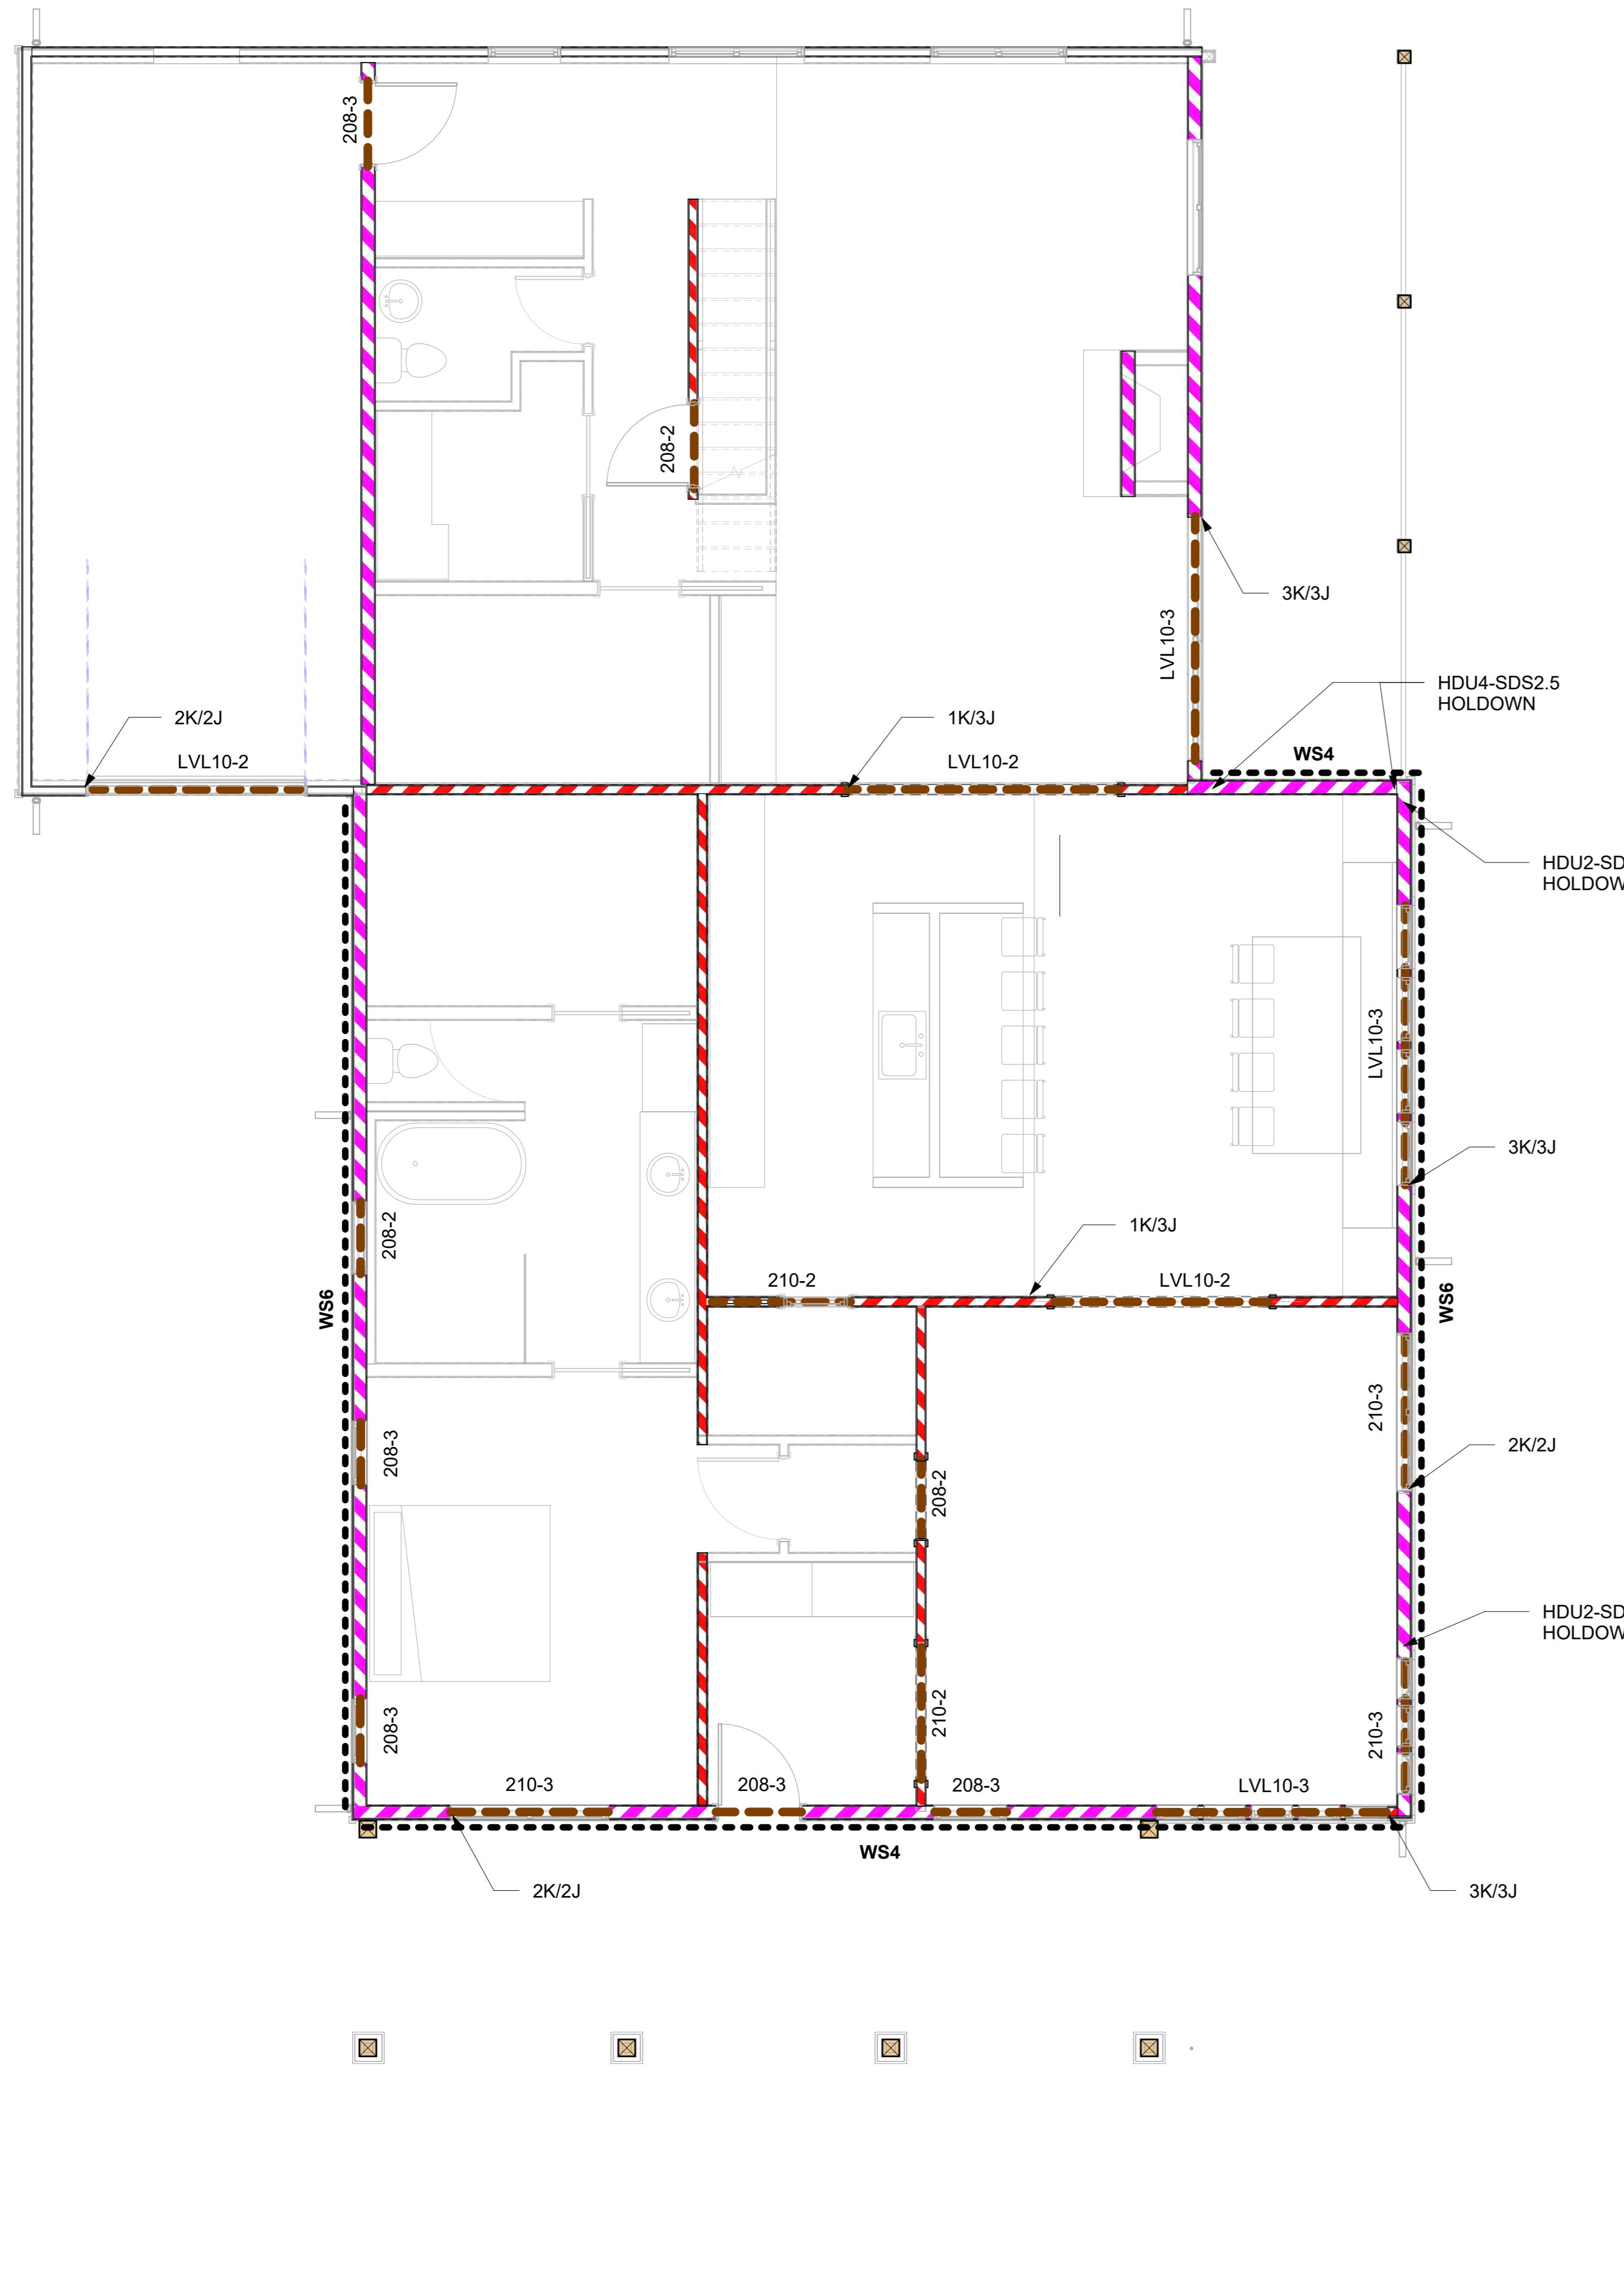



PROJECT: Fleeman Residence Remodel & Addition
5 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
3 Maple Avenue, NW
Marietta, GA 30064
4.735.2132
morrison@madearch.design

OWNERS: Roy and Kate Fleeman
0 Hunt Street NE
Marietta, GA 30060
p: 770.274.9559
kfleeman@gmail.com
katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
8 Thomas Road
Cleveland, GA 30528
6.969.5636
mke@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Jrds Mundaray
79 Sumter Lake Drive
Marietta, GA 30062
0.357.5865
ice@cleverhomellc-gc.com



November 14, 2025

FLOOR FRAMING NOTES

1. FLOOR FRAMING SHALL BE BCI 90s 2.0 SERIES 11-7/8" DEEP ENGINEERED I-JOISTS UNLESS OTHERWISE NOTED ON PLAN. SEE PLAN FOR SPACING.
2. DECK FLOOR FRAMING SHALL BE PRESERVATIVE TREATED 2x8'S @ 16" OC MAX UNLESS OTHERWISE NOTED ON PLAN.
3. SEE I-JOIST MANUFACTURER FOR ALL ALLOWABLE JOIST PENETRATIONS AND ADDITIONAL FRAMING REQUIREMENTS.
4. FLOOR FRAMING PLAN IS INTENDED TO DENOTE FLOOR FRAMING BEARING WALLS, BEAMS / HEADERS AND SECTION INFO.
5. SEE S402 FOR THE MIN NUMBER OF WALL STUDS AT BEAM OR GT BEARING POINTS UNLESS NOTED OTHERWISE ON PLAN.
6. THE CENTERLINE OF THE BEAM OR GT SHALL MATCH THE CENTERLINE OF THE SUPPORTING WALL STUDS.
7. ALL JOIST/TRUSS TO BEAM CONNECTIONS SHALL MATCH JOIST DEPTH AND NUMBER OF PLY'S. SEE DETAILS FOR HANGER SERIES.
8. ALL BUILT-UP STUD COL'S MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING AT FLOOR CAVITY LOCATIONS AND CONTINUE TO FDN OR BEAM SUPPORT BELOW.
9. ALL CONNECTOR TYPES REFER TO SIMPSON STRONG-TIE SPECIFICATIONS. SEE GENERAL NOTES FOR ADD'L INFO.
10. SEE GENERAL NOTES FOR LUMBER SPECIES AND GRADE INFO.
11. SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

FLOOR FRAMING LEGEND


210-2	DENOTES WOOD BEAM/HEADER DESIGNATION. FOR ADD'L INFO SEE BEAM/HEADER SCHEDULE ON 2 / S402	
LVL10-2		
2K/1J	DENOTES QUANTITY OF KING STUDS (K) & JAMB STUDS (J) PER HEADER END. FOR STUD INFO SEE 3 / S402	
	DENOTES BEARING WALL.	
FL		DENOTES FLUSH BEAM WITH TOP OF BEAM AT TOP OF FLOOR JOIST/TRUSS.
	DENOTES HEADER WITHIN WALL FRAMING. SEE WALL FRAMING PLAN.	
DB		DENOTES DROP BEAM WITH TOP OF BEAM AT OR BELOW JOIST/TRUSS BEARING.
	DENOTES JOIST.	
	DENOTES JOIST/BEAM SUPPORT HANGER.	

Issued for Construction

SECOND FLOOR FRAMING PLAN

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S203

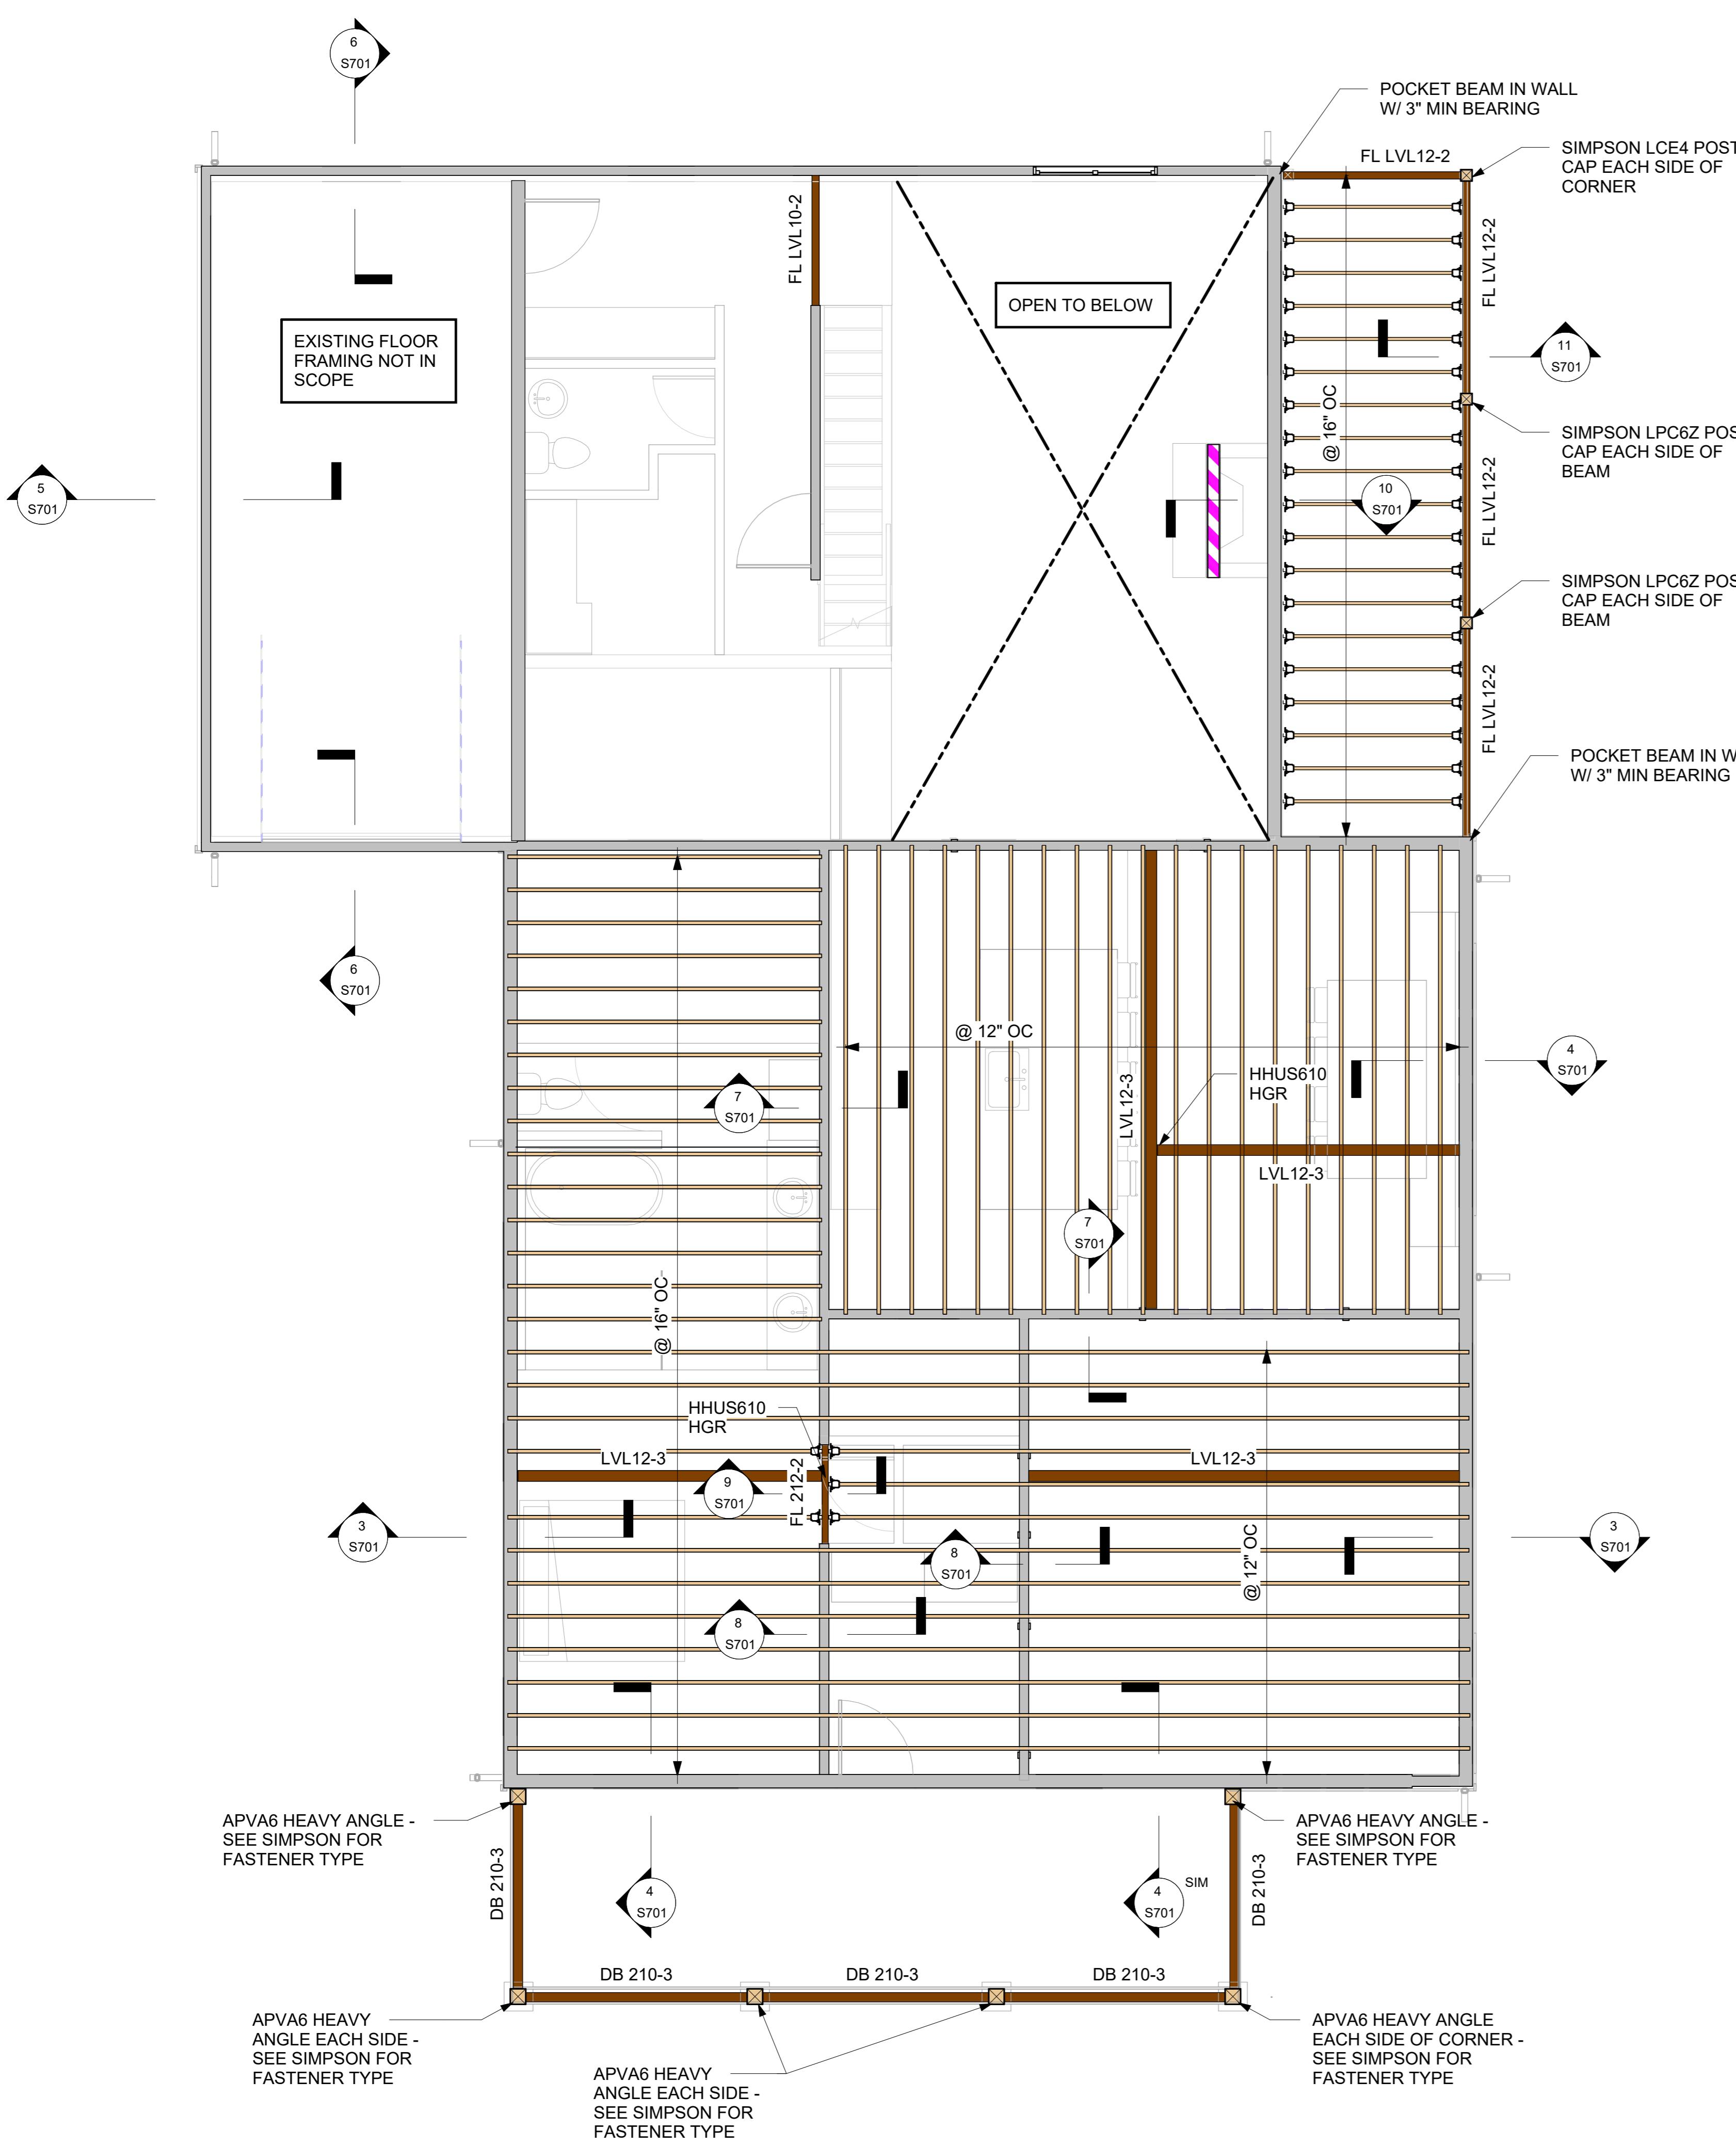

1 Second Floor Framing Plan
1/4" = 1'-0"



PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepetri@gmail.com


STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundaray
2179 Sumter Lake Drive
Marietta, GA 30062
470.357.5865
office@cleverhomellc-gc.com

WALL FRAMING NOTES

1. SEE WALL FRAMING LEGEND BELOW AND PLAN FOR STUD SIZE AND SPACING AT EACH BEARING WALL. ALL STUD WALL OPENINGS SHALL HAVE 1-KING & 1-JAMB STUD EACH END MINIMUM UNLESS OTHERWISE NOTED ON PLAN.
2. FOR THE MIN NUMBER OF WALL STUDS AT BEAM OR GT BEARING POINTS UNO ON PLAN SEE ^{2 / S402}
3. THE CENTERLINE OF THE BEAM OR GT SHALL MATCH THE CENTERLINE OF THE SUPPORTING WALL STUDS.
4. FOR ALLOWABLE WALL PLATE & STUD PENETRATIONS AT BRACING AND NON-BRACING WALLS SEE 1- ^{4 / S403}
5. WHERE STUD ALIGNMENT IS REQUIRED, FOR ALLOWABLE OFFSET DISTANCE ^{5 / S403} BETWEEN FLOOR/ROOF MEMBER FRAMING AND WALL STUDS SEE ^{4 / S401}
6. FOR INTERSECTING BRACING WALL ^{1 / S401} FRAMING DETAILS SEE 2-
7. FOR ADD'L BRACING INFO SEE DWG
8. ALL SHEAR WALLS SHALL BE TEMPORARILY BRACED DURING ALL PHASES OF CONSTRUCTION UNTIL PROPERLY SHEATHED PER GENERAL NOTES, S2, & S4 SERIES DRAWINGS.
9. SEE ARCH DWGS FOR EXACT FINISHED FLOOR ELEVATIONS.
10. DO NOT CORE BEAMS OR HEADERS UNLESS SPECIFIED BY EOR.
11. ALL BUILT-UP STUD COL'S MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING AT FLOOR CAVITY LOCATIONS AND CONTINUE TO FDN OR BEAM SUPPORT BELOW.
12. ALL CONNECTOR TYPES REFER TO SIMPSON STRONG-TIE SPECIFICATIONS. SEE GENERAL NOTES FOR ADD'L INFO.
13. SEE GENERAL NOTES FOR LUMBER SPECIES AND GRADE INFO.
14. SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

WALL FRAMING LEGEND

210-2 LVL10-2	INDICATES WOOD HEADER DESIGNATION. SEE BEAM/HEADER SCHEDULE FOR ADD'L INFO ON 2 / S402
2K/1J	DENOTES QUANTITY OF KING STUDS (K) & JAMB STUDS (J) PER HEADER END. SEE STUD INFO SEE 3 / S402
	DENOTES FLUSH BEAM WITH BOTTOM OF BEAM AT FLOOR JOIST/TRUSS BEARING. SEE FLOOR FRAMING PLAN.
	DENOTES HEADER WITHIN WALL FRAMING.
DB 	DENOTES DROP BEAM WITH TOP OF BEAM AT OR BELOW JOIST/TRUSS BEARING.
WS6 GS7	DENOTES BRACING WALL MARK. FOR BRACING WALL SCHEDULES AND CONSTRUCTION REQUIREMENTS SEE 1 / S401
	DENOTES DESIGNATED BRACING WALL EXTENTS. ALL OTHER EXTERIOR WALLS SHALL BE SHEATHING AND FASTENED PER MINIMUM SHEATHING REQUIREMENTS.
	DENOTES 2x6 WALL WITH STUDS @ 16" OC MAX.
	DENOTES 2x6 WALL WITH STUDS @ 12" OC MAX.
	DENOTES 2x4 WALL WITH STUDS @ 16" OC MAX.
	DENOTES 2x4 WALL WITH STUDS @ 12" OC MAX.

A circular Georgia Registered Professional Engineer seal. The outer ring contains the words "GEORGIA" at the top and "REGISTERED" on the left, with "PROFESSIONAL" on the right and "ENGINEER" at the bottom. The inner circle contains "No. PE045304" and "PROFESSIONAL". The name "MICHAEL E. FERNANDEZ" is handwritten across the bottom of the seal.

November 14, 2025

Issued for Construction

SECOND LEVEL WALL FRAMING PLAN

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S204

This architectural floor plan illustrates a building section with the following key features and room labels:

- Rooms and Fixtures:** The plan shows multiple rooms, including a bathroom with a bathtub, sink, and toilet, and a kitchen area. The rooms are labeled with codes such as 208-2, 208-3, 210-3, and WS6.
- Walls:** The exterior walls are marked with vertical patterns: red and white diagonal stripes, pink and white diagonal stripes, and black and white dashed lines.
- Doors:** Several doors are indicated by white outlines with small arrows, some labeled with codes like 208-2, 208-3, and 210-3.
- Stairs:** A vertical staircase is located in the center-right area.
- Labels:** The labels WS6 and 2K/2J are present at the bottom of the plan.

1 Second Floor Wall Framing Plan
1/4" = 1'-0"



PROJECT: Fleeman Residence Remodel & Addition
45 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
53 Maple Avenue, NW
Marietta, GA 30064
04.735.2132
morrison@madearch.design

OWNERS: Roy and Kate Fleeman
70 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
88 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundaray
1179 Sumter Lake Drive
Marietta, GA 30062
70.357.5865
office@cleverhomelc-gc.com

CEILING JOIST FRAMING NOTES

1. CEILING JOIST FRAMING SHALL BE AS FOLLOWS:
SPAN UP TO 8'-0", 2x4'S @ 16" OC.
SPAN UP TO 12'-0", 2x6'S @ 16" OC.
SPAN UP TO 15'-0", 2x8'S @ 16" OC.
2. ALL JOIST TO BEAM CONNECTIONS SHALL BE LUS SERIES HANGERS TO MATCH JOIST DEPTH AND # OF PLY'S UNO.
3. SEE S402 FOR THE MIN NUMBER OF WALL STUDS AT BEAM OR GT BEARING POINTS UNLESS NOTED OTHERWISE ON PLAN.
4. THE CENTERLINE OF THE BEAM OR GT SHALL MATCH THE CENTERLINE OF THE SUPPORTING WALL STUDS.
5. ALL JOIST/TRUSS TO BEAM CONNECTIONS SHALL BE LUS SERIES HANGERS TO MATCH JOIST DEPTH AND NUMBER OF PLY'S.
6. ALL BUILT-UP STUD COL'S MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING AT FLOOR CAVITY LOCATIONS AND CONTINUE TO FDN OR BEAM SUPPORT BELOW.
7. ALL CONNECTOR TYPES REFER TO SIMPSON STRONG-TIE SPECIFICATIONS. SEE GENERAL NOTES FOR ADD'L INFO.
8. SEE GENERAL NOTES FOR LUMBER SPECIES AND GRADE INFO.
9. SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

CEILING JOIST FRAMING LEGEND

210-2	DENOTES WOOD BEAM/HEADER DESIGNATION. FOR ADD'L INFO SEE BEAM/HEADER SCHEDULE ON 2 / S402
LVL10-2	
2K/1J	DENOTES QUANTITY OF KING STUDS (K) & JAMB STUDS (J) PER HEADER END. FOR STUD INFO SEE 3 / S402
	DENOTES BEARING WALL.
FL	
	DENOTES FLUSH BEAM WITH BOTTOM OF BEAM AT FLOOR JOIST/TRUSS BEARING.
	DENOTES HEADER WITHIN WALL FRAMING. SEE WALL FRAMING PLAN.
DB	
	DENOTES DROP BEAM WITH TOP OF BEAM AT OR BELOW JOIST/TRUSS BEARING.
	DENOTES JOIST.
	DENOTES JOIST/BEAM SUPPORT HANGER.

A circular Georgia Registered Professional Engineer seal. The outer ring contains the word "GEORGIA" at the top and "REGISTERED" at the bottom. The inner circle contains "No. PE045304" at the top and "PROFESSIONAL" at the bottom. Below the inner circle, the name "MICHAEL FERNANDEZ" is written in a stylized font. The entire seal is set against a background of blue and white wavy lines.

November 14, 2025

Issued for Construction

CEILING JOIST FRAMING PLAN

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S301

1 Ceiling Joist Framing
1/4" = 1'-0"



www.fernz-structural.com

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundary
2179 Sumter Lake Drive
Marietta, GA 30062
470.357.5865
office@cleverhomellc-gc.com




November 14, 2025

Issuances		
No.	Description	Date
	Issued for Permit	11/14/25

Issued for
Construction

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF
S302	

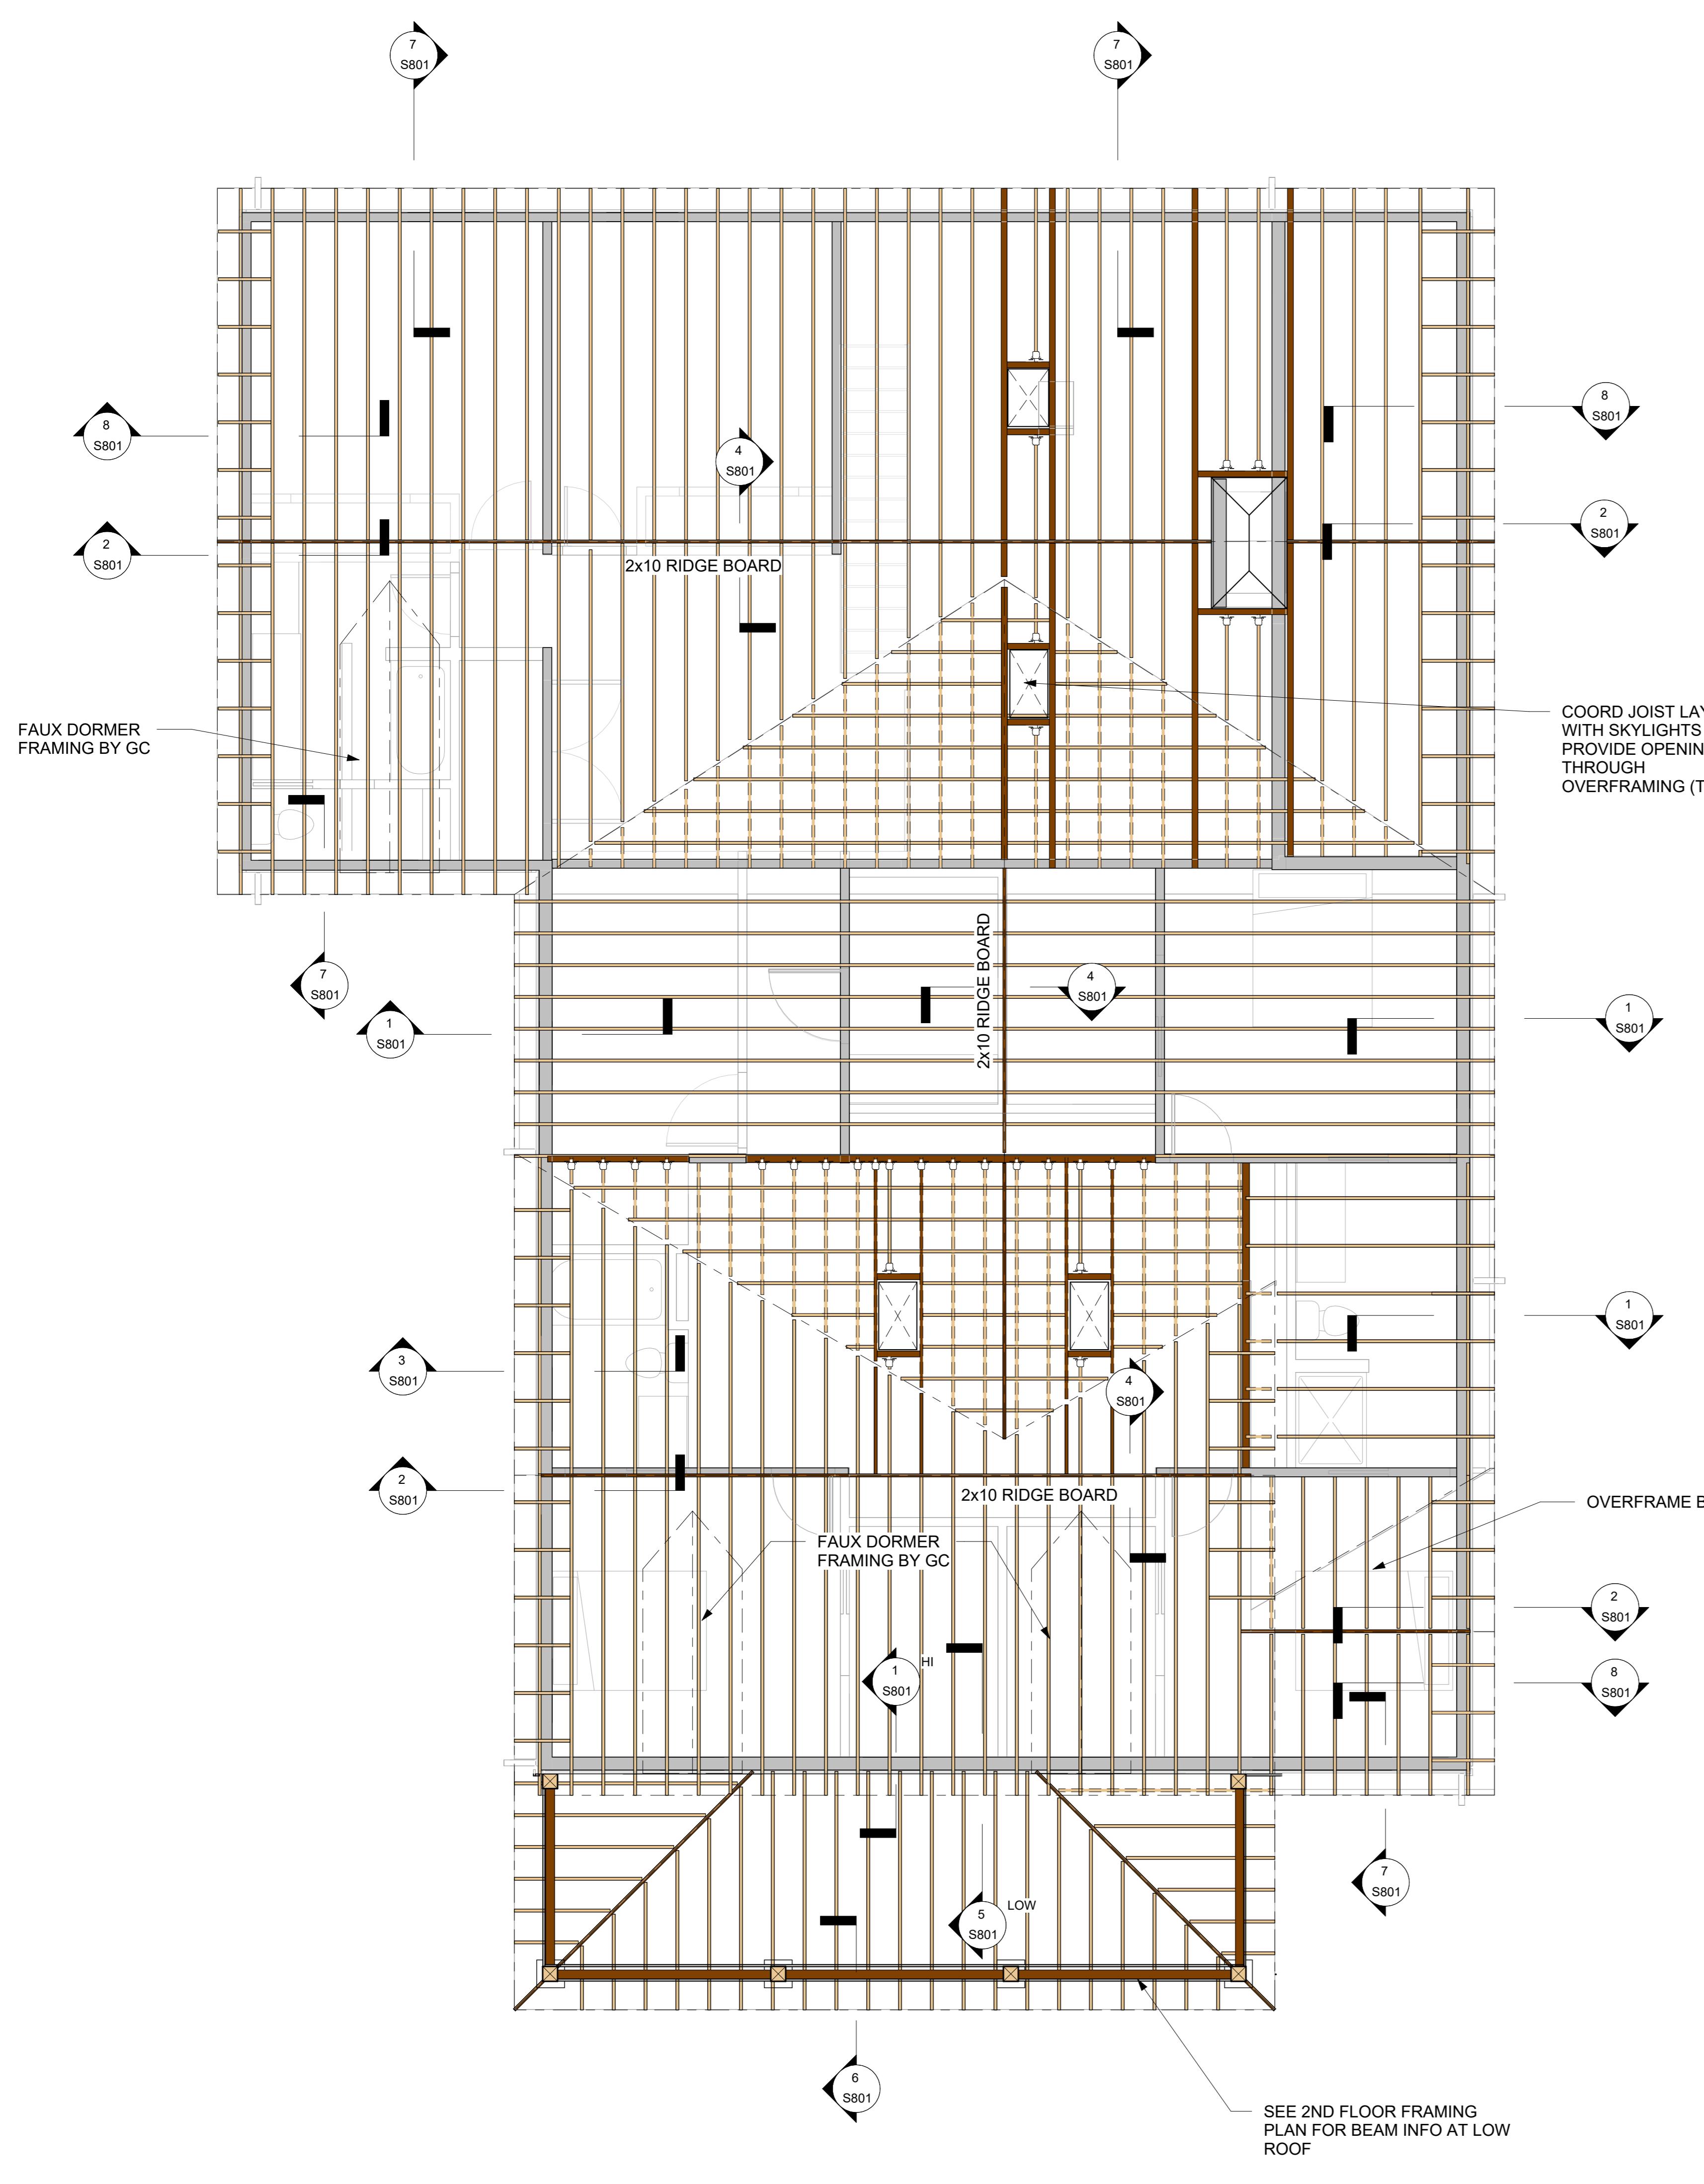

① Roof Framing Plan
1/4" = 1'-0"

ROOF FRAMING NOTES

- MAIN ROOF FRAMING SHALL BE SYP #2 GRADE 2x8'S @ 16" OC MAX UNO.
- FRONT PORCH ROOF FRAMING SHALL BE SYP #2 GRADE 2x6'S @ 16" OC MAX.
- ROOF FRAMING PLAN IS INTENDED TO DENOTE ROOF FRAMING, BEARING WALLS, BEAMS AND SECTION INFO.
- SEE S402 FOR THE MIN NUMBER OF WALL STUDS AT BEAM OR GT BEARING POINTS UNO ON PLAN.
- ALL TRUSS-TO-TRUSS CONNECTIONS ARE BY TRUSS DESIGNER.
- THE CENTERLINE OF THE BEAM OR GT SHALL MATCH THE CENTERLINE OF THE SUPPORTING WALL STUDS.
- ALL BUILT-UP STUD COL'S MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING AT FLOOR CAVITY LOCATIONS AND CONTINUE TO FDN OR BEAM SUPPORT BELOW.
- ALL CONNECTOR TYPES REFER TO SIMPSON STRONG-TIE SPECIFICATIONS. SEE GENERAL NOTES FOR ADDL INFO.
- SEE GENERAL NOTES FOR LUMBER SPECIES AND GRADE INFO.
- SEE S00# SERIES FOR GENERAL NOTES
SEE S10# SERIES FOR FOUNDATION PLANS
SEE S20# SERIES FOR WALL & FLOOR FRAMING PLANS
SEE S30# SERIES FOR ROOF FRAMING PLANS
SEE S40# SERIES FOR WALL FRAMING DETAILS & SCHEDULES
SEE S60# SERIES FOR FOUNDATION/RETAINING WALL DETAILS
SEE S70# SERIES FOR FLOOR FRAMING DETAILS
SEE S80# SERIES FOR ROOF FRAMING DETAILS

ROOF FRAMING LEGEND

210-2 LVL10-2	INDICATES WOOD BEAM/HEADER DESIGNATION. SEE BEAM/HEADER SCHEDULE ON S402 FOR ADDL INFO.
2K/1J	DENOTES QUANTITY OF KING STUDS (K) & JAMB STUDS (J) PER HEADER END. SEE S402 FOR STUD INFO.
HB/HT	DENOTES HIP BEAM OR HIP TRUSS.
VB/VT	DENOTES VALLEY BEAM OR VALLEY TRUSS.
GT	DENOTES GIRDER TRUSS.
	DENOTES BEARING WALL.
FL	DENOTES FLUSH BEAM WITH BOTTOM OF BEAM AT FLOOR JOIST/TRUSS BEARING.
	DENOTES HEADER WITHIN WALL FRAMING. SEE WALL FRAMING PLAN.
DB	DENOTES DROP BEAM WITH TOP OF BEAM AT OR BELOW JOIST/TRUSS BEARING.
	DENOTES TRUSS/RAFTER.
	DENOTES JOIST/BEAM SUPPORT HANGER.

ROOF FRAMING PLAN



PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundary
2179 Sumter Lake Drive
Marietta, GA 30062
470.357.5865
office@cleverhomelc-gc.com



November 14, 2025

Issuances		
No.	Description	Date
	Issued for Permit	11/14/25

Issued for
Construction

BRACING WALL SCHEDULES & DETAILS

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF


S401

SHEAR WALL MARK	SHEATHING	NAILING (1),(2),(3),(4),(5)	BLOCKED PANEL EDGES	ASD ALLOW. CAPACITY (W/ NO WINDLOAD INCREASE)	BASE PLATE FASTENING	SILL PLATE ANCHORAGE (7),(8)	
						RECOMMENDED	ALTERNATE
7/16" PLYWOOD OR OSB	5/8 INCH GYPSUM WALLBOARD OR WALL SHEATHING	EDGE NAILING	FIELD NAILING	APPLIED DIRECTLY TO STUD MATERIAL	SIMPSON SDWC15450 SCREWS	A307 HEADED ANCHOR BOLT	PAF PINS SEE GEN NOTES, SEE GEN NOTES, NOTE #10
WS2 (6)	•	8d @ 2" OC	8d @ 2" OC	YES	589 PLF	4" OC	1/2" Ø @ 3-0" OC 1/2" x 2-1/4" EMBED @ 14" OC
WS3	•	8d @ 3" OC	8d @ 3" OC	YES	451 PLF	5" OC	1/2" Ø @ 4-0" OC 1/2" x 2-1/4" EMBED @ 14" OC
WS4	•	8d @ 4" OC	8d @ 4" OC	YES	350 PLF	7" OC	1/2" Ø @ 5-0" OC 1/2" x 2-1/4" EMBED @ 14" OC
WS6	•	8d @ 6" OC	8d @ 6" OC	YES	239 PLF	10" OC	1/2" Ø @ 6-0" OC 1/2" x 2-1/4" EMBED @ 14" OC
GS4B	•	8d @ 4" OC	8d @ 4" OC	YES	161 PLF	15" OC	1/2" Ø @ 7-0" OC 1/2" x 2-1/4" EMBED @ 14" OC
GS4	•	8d @ 4" OC	8d @ 4" OC	NO	133 PLF	18" OC	1/2" Ø @ 7-0" OC 1/2" x 2-1/4" EMBED @ 14" OC
GS7	•	8d @ 7" OC	8d @ 7" OC	NO	106 PLF	20" OC	1/2" Ø @ 7-0" OC 1/2" x 2-1/4" EMBED @ 14" OC


FOOTNOTES:

1. INTERIOR 5/8" GYPSUM SHEATHING REQUIRES 6d COOLER NAILS (0.092" Ø x 1-7/8" LONG, 1/4" HEAD) OR WALLBOARD NAILS (0.0915" Ø x 1-7/8" LONG, 19/64" HEAD).
2. DRYWALL SCREWS ARE PERMITTED AS A SUBSTITUTE FOR 6d COOLER NAILS PROVIDED THE DIMENSIONS OF THE DRYWALL SCREWS ARE NOT LESS THAN THE DIMENSIONS OF THE 6d COOLER NAIL THEY ARE REPLACING.
3. END JOINTS OF ADJACENT GYPSUM BOARD COURSES SHALL NOT OCCUR OVER THE SAME STUD.
4. ALL PLYWOOD AND OSB SHEATHING SHALL BE FASTENED WITH COMMON OR GALVANIZED NAILS.
5. SEE GENERAL NOTES, NOTE #9 FOR MINIMUM FASTENER DIMENSIONS.
6. FRAMING AT ADJOINING PANEL EDGES SHALL BE 3" NOMINAL OR WIDER AND NAILS AT PANEL EDGES SHALL BE STAGGERED. AT THE CONTRACTOR'S OPTION, (2) 2x STUDS FASTENED TOGETHER WITH 12d NAILS AT 4" OC STAGGERED MAY BE USED IN LIEU OF 3" NOMINAL OR WIDER MEMBER.
7. FOUNDATION ANCHOR BOLTS SHALL HAVE A STEEL PLATE WASHER UNDER EACH NUT NOT LESS THAN 0.229" x 3" x 3" IN SIZE UNO. THE HOLE IN THE PLATE WASHER SHALL BE PERMITTED TO BE DIAGONALLY SLOTTED WITH A WIDTH OF UP TO 3/16" LARGER THAN THE BOLT DIAMETER WITH SLOT LENGTH NOT TO EXCEED 1-3/4", PROVIDED A STANDARD CUT WASHER IS PLACED BETWEEN THE PLATE WASHER AND NUT.
8. THE PLATE WASHER SHALL EXTEND WITHIN 1/2" OF THE EDGE OF THE BOTTOM PLATE ON THE SIDE WITH SHEATHING.



BRACING WALL SHEATHING &
FASTENING SCHEDULE
① 1/8" = 1'-0"

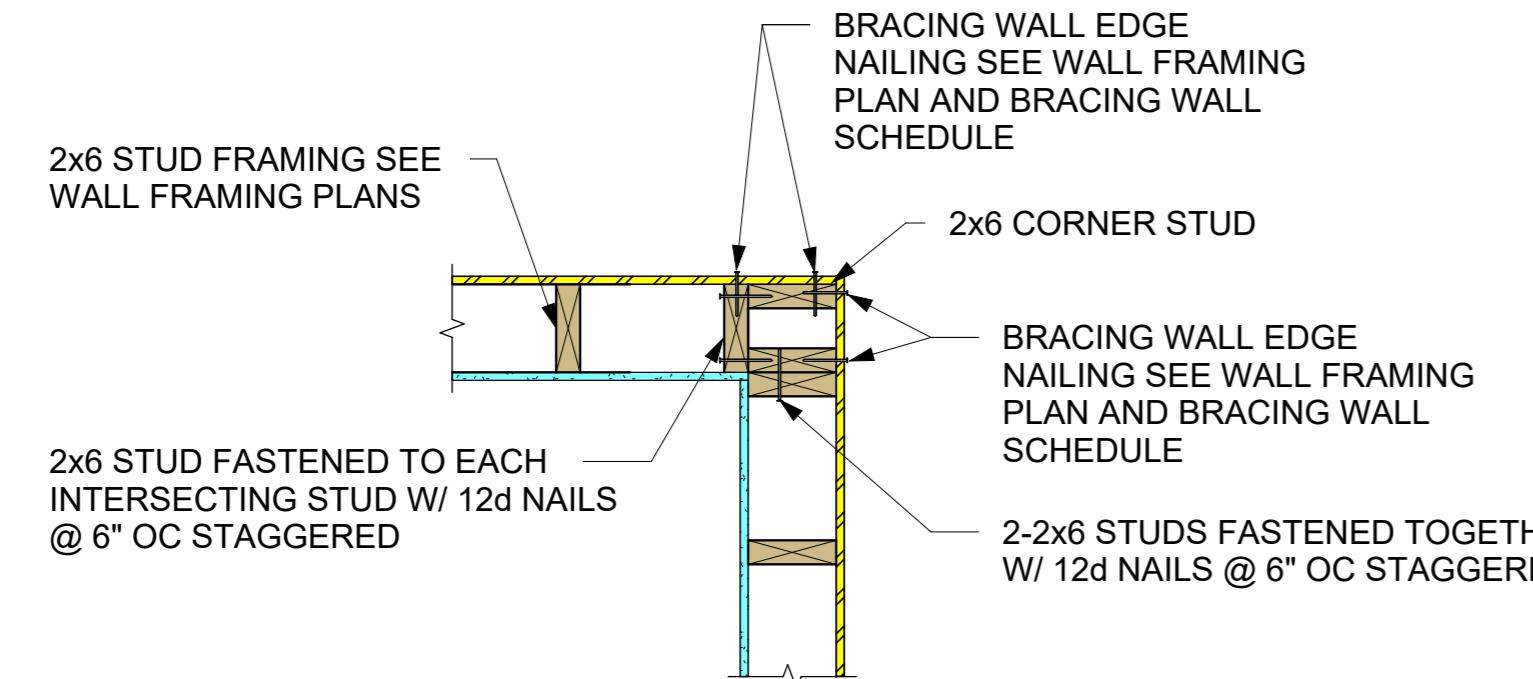

2x6 BRACING WALL

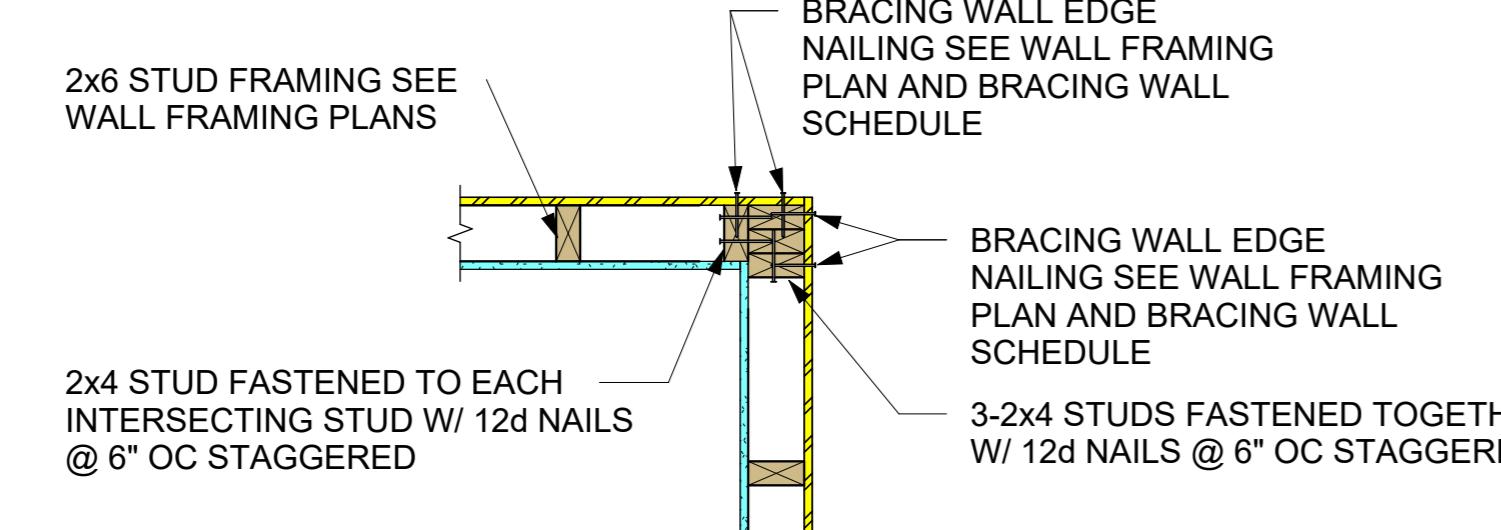


TYPICAL CORNER FASTENING DETAIL
② 1" = 1'-0"

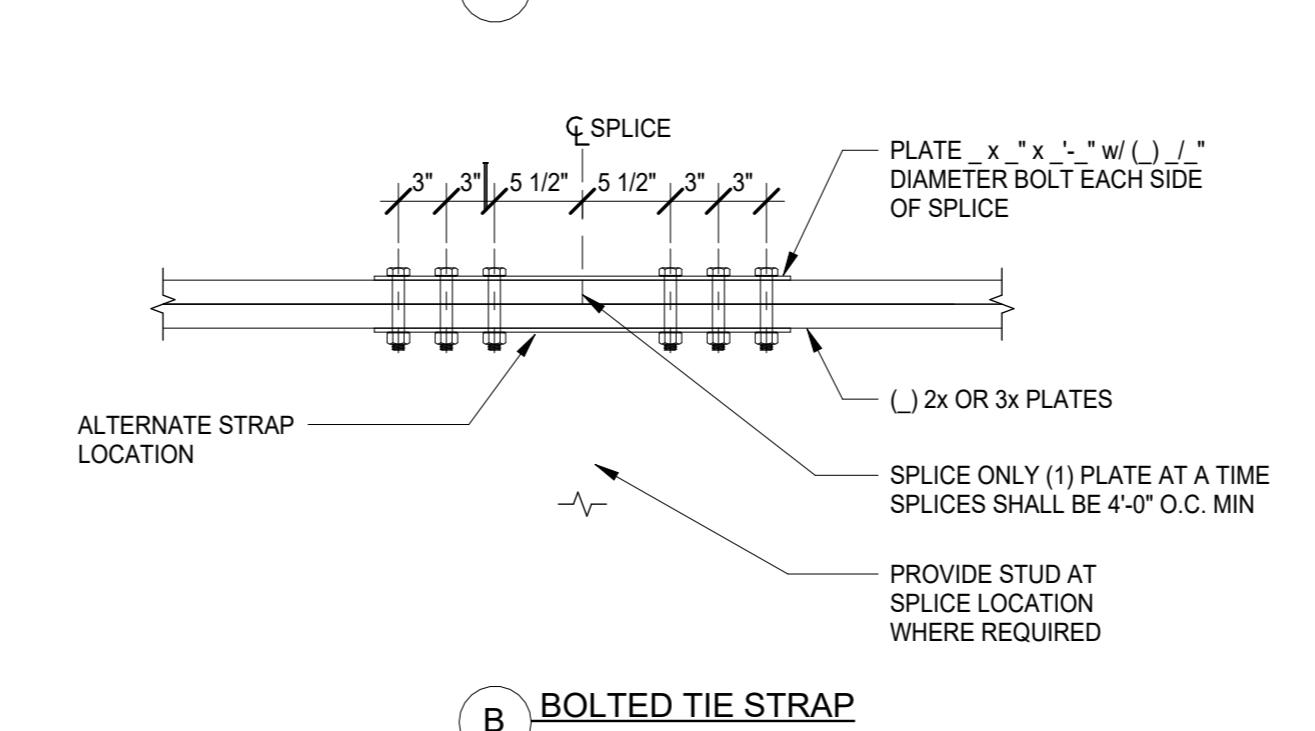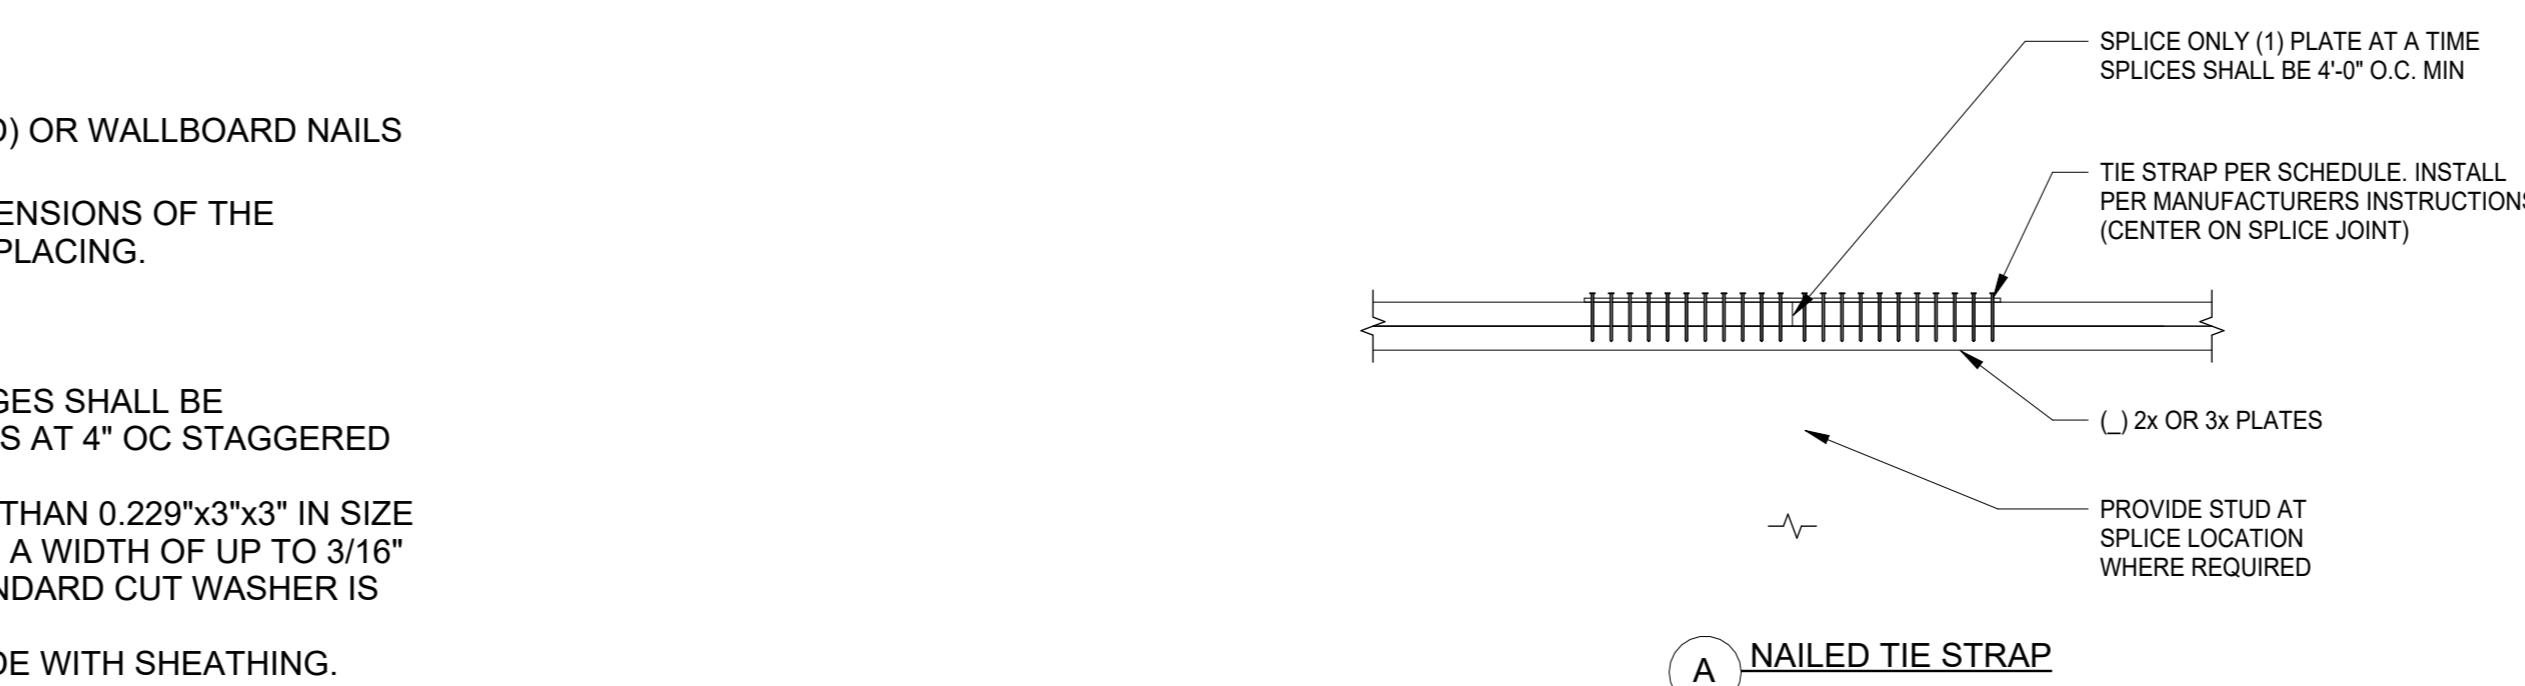


⑤ LAP SPLICING DETAIL
1" = 1'-0"

NOTE:
BOLT SPACING SHOWN
FOR 3/4" DIAMETER BOLTS.
SPACING=4D, END=D

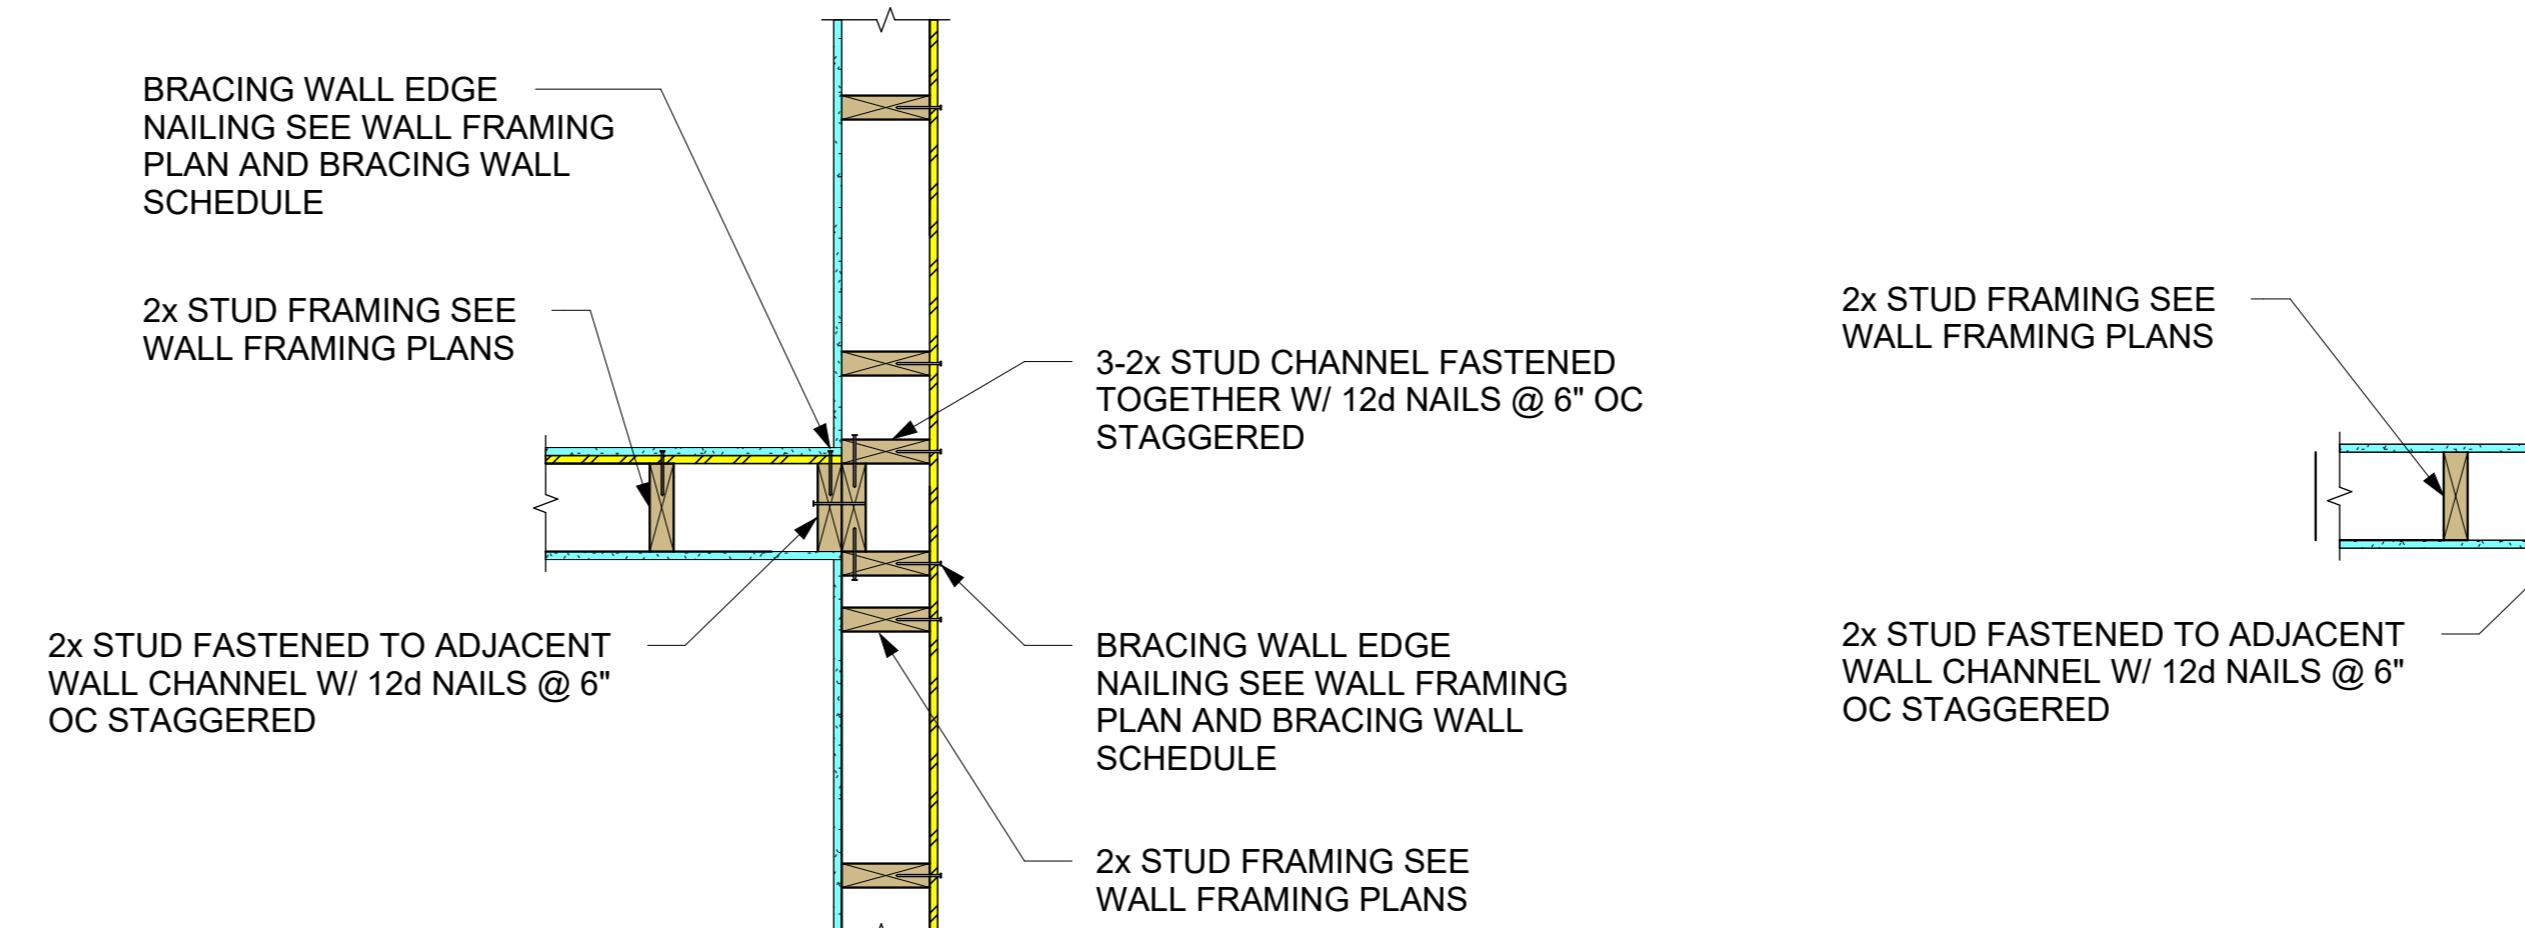

TYPICAL FASTENING DETAIL AT
PARTITION WALL INTERSECTING
BRACING WALLS
④ 1" = 1'-0"

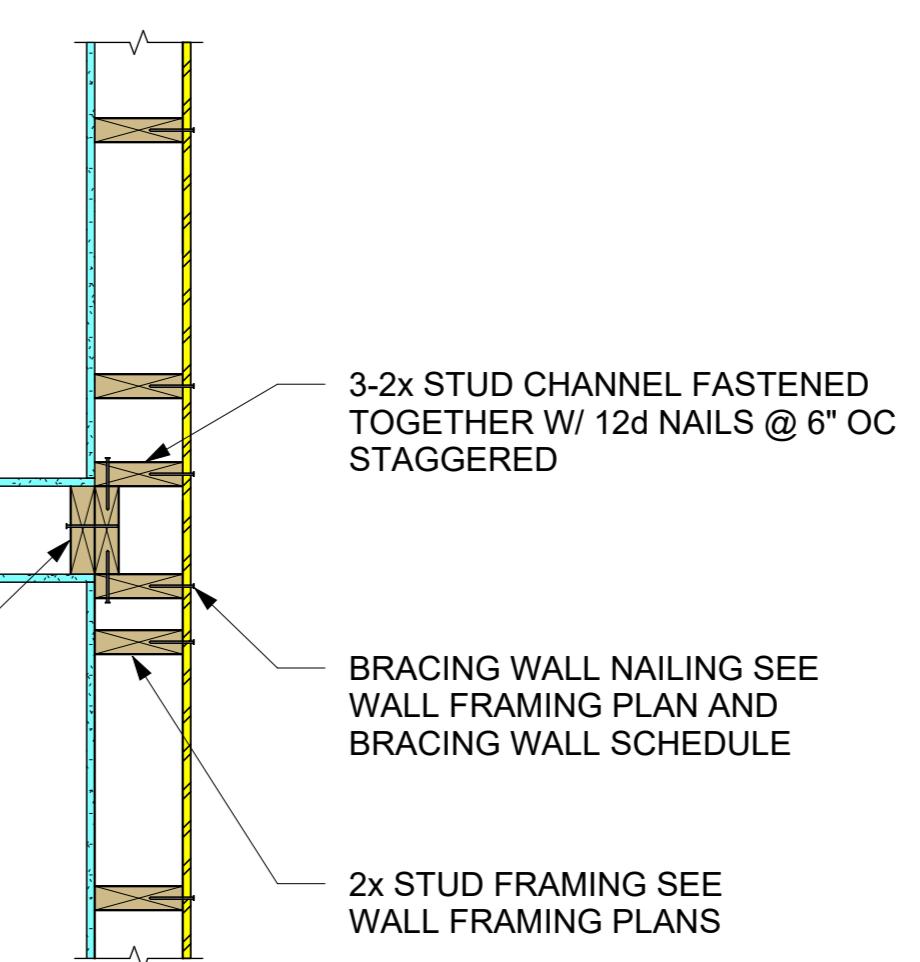

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF



PROJECT: Fleeman Residence Remodel & Addition
45 Forest Avenue NE
Marietta, GA 30060


RCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
53 Maple Avenue, NW
Marietta, GA 30064
04.735.2132
morrison@madearch.design

OWNERS: Roy and Kate Fleeman
70 Hunt Street NE
Marietta, GA 30060
oy: 770.274.9559
oyfleeman@gmail.com
ate: katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
88 Thomas Road
Cleveland, GA 30528
06.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Carls Mundaray
179 Sumter Lake Drive
Marietta, GA 30062
70.357.5865
[ffice@cleverhomelc-gc.com](mailto:office@cleverhomelc-gc.com)

BUILT-UP COLUMN DETAILS

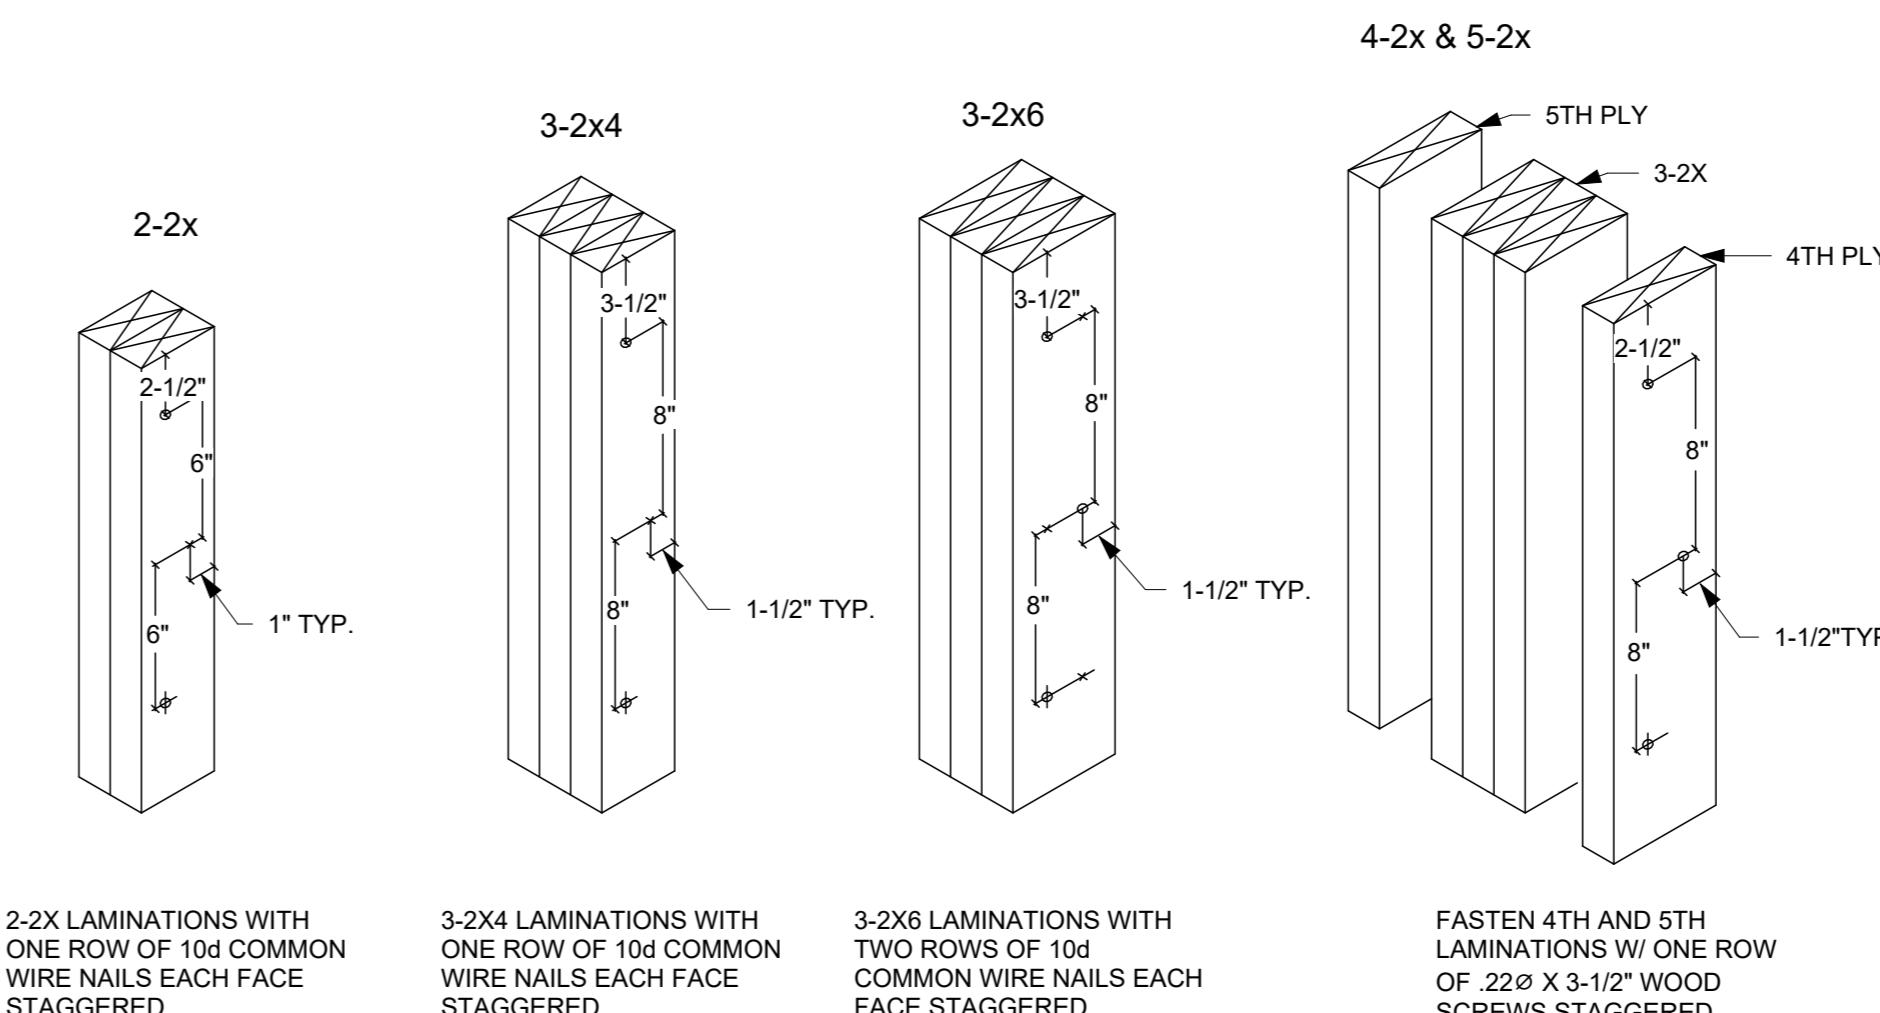


BUILT UP EXTERIOR HEADER FASTENING PATTERNS (UNO)

BEAM SIZE	FASTENING PATTERN
2x8	3-3"x0.131" NAILS EACH END + 2 ROWS OF 3"x0.131" NAILS @ 6" OC EACH FACE
2x10	3-3"x0.131" NAILS EACH END + 3 ROWS OF 3"x0.131" NAILS @ 6" OC EACH FACE
2x12	3-3"x0.131" NAILS EACH END + 3 ROWS OF 3"x0.131" NAILS @ 6" OC EACH FACE

NOTES:

1. SEE GENERAL NOTES FOR BEAM / HEADER MATERIAL SPECIES AND GRADE INFO, AS WELL AS ADDITIONAL FASTENER INFORMATION.
2. "S" DENOTES NAIL SPACING SPECIFIED IN TABLE ABOVE.
3. ROWS SHALL BE EVENLY SPACED OVER DEPTH OF BEAM.
4. PROVIDE 1-1/4" MIN EDGE DISTANCE TO NAILS.

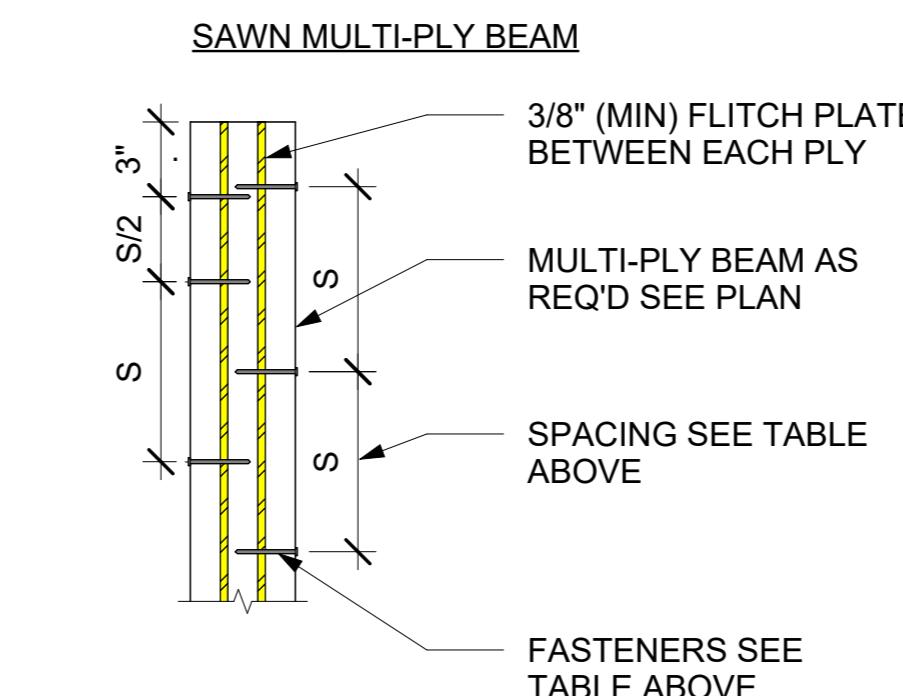


Issued for Construction

WALL FRAMING SCHEDULES & DETAILS

Project number	25-06
Date	10/15/2022
Drawn by	MR
Checked by	MR

S402



PROJECT: Fleeman Residence Remodel & Addition
5 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
3 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
morrison@madearch.design

OWNERS: Roy and Kate Fleeman
10 Hunt Street NE
Marietta, GA 30060
Ph: 770.274.9559
kfleeman@gmail.com
katepetri@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
8 Thomas Road
Cleveland, GA 30528
6.969.5636
ke@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Jr. Mundaray
79 Sumter Lake Drive
Marietta, GA 30062
0.357.5865
ice@cleverhomellc-gc.com



November 14, 2025

The image contains four separate plan view diagrams, each showing a horizontal wood wall top with a central plate penetration. The diagrams are arranged in a 2x2 grid.

- Top Left:** Labeled @ 2x6 BRACING WALL. The wall is 1'-0" wide. The plate penetration is 4" max width. Two circular holes are shown, with a dimension of 1'-0" MIN between them. A note indicates "¢ PLATE ¢ HOLE". Below the diagram is a circular fastener detail labeled "2 S403".
- Top Right:** Labeled @ 2x6 NON-BRACING WALL. The wall is 1'-0" wide. The plate penetration is 4" max width. Two circular holes are shown, with a dimension of 1'-0" MIN between them. A note indicates "¢ PLATE ¢ HOLE". Below the diagram is a circular fastener detail labeled "2 S403".
- Bottom Left:** Labeled @ 2x4 BRACING WALL. The wall is 1'-0" wide. The plate penetration is 2" max width. Two circular holes are shown, with a dimension of 1'-0" MIN between them. A note indicates "¢ PLATE ¢ HOLE". Below the diagram is a circular fastener detail labeled "2 S403".
- Bottom Right:** Labeled @ 2x4 NON-BRACING WALL. The wall is 1'-0" wide. The plate penetration is 3" max width. Two circular holes are shown, with a dimension of 1'-0" MIN between them. A note indicates "¢ PLATE ¢ HOLE". Below the diagram is a circular fastener detail labeled "2 S403".

The diagram illustrates a wall bottom plate connection. On the left, a vertical wall is shown with a horizontal wood stud or column at the top. The bottom plate is labeled 'WALL BOTTOM PLATE'. A dimension line indicates the 'MAX NOTCH DIMENSION SEE SCHEDULE IN 4 / S403' at the top of the stud. The stud is labeled 'WOOD STUD OR COL SEE WALL FRAMING PLAN'. On the right, a detailed view shows two circular holes in the stud. The top hole is labeled '5/8" CLR MAX'. The bottom hole is labeled 'MAX HOLE SEE SCHED ON 4 / S403'. The distance between the holes is labeled 'MIN HOLE SPACING SCHED ON 4 / S403'. The bottom of the stud is labeled 'MIN END DISTANCE SEE SCHED ON 4 / S403'. The bottom plate is labeled 'WALL BOTTOM PLATE'. Arrows point from the text labels to the corresponding features in the diagram.

2 NOTCHING DETAIL AT LOAD BEARING STUD WALLS
1 1/2" = 1'-0"

3 BORING DETAIL AT LOAD BEARING STUD WALLS
1 1/2" = 1'-0"

STUD COLUMN PER PLAN	MAX Ø HOLE IN STUD PACK	# HOLES/ STUD COL	HOLE-TO-HOLE SPACING	END DIST (TOP & BOTT)	ADD'L STUDS REQ'D ¹	NOTCH DIMENSION
4-2x4	3/4" 1-1/2" 2"	4 1 1	6" - -	12" 24" 24"	0 2 4	7/8"
3-2x4	3/4" 1-1/2" 2"	4 1 1	6" - -	12" 24" 24"	0 2 3	7/8"
2-2x4	3/4" 1-1/2" 2"	4 1 1	6" - -	12" 24" 24"	0 1 2	7/8"
1-2x4	3/4" 1-1/2" 2"	4 1 1	6" - -	12" 24" 24"	0 1 1	7/8"
4-2x6	3/4" 2" 3"	4 2 1	6" 24" -	12" 24" 24"	0 2 4	1-3/8"
3-2x6	3/4" 2" 3"	4 2 1	6" 24" -	12" 24" 24"	0 1 3	1-3/8"
2-2x6	3/4" 2" 3"	4 2 1	6" 24" -	12" 24" 24"	0 1 2	1-3/8"
1-2x6	3/4" 2" 3"	4 2 1	6" 24" -	12" 24" 24"	0 1 1	1-3/8"

N

1. LAMINATE ADDITIONAL STUDS TO EXISTING STUDS PER PLY LAMINATION REQUIREMENTS ON 3 / S402

TRUSS/JOIST
SEE FLOOR
FRAMING PLAN

TOP PLATE PENETRATION
SEE 3 / S403 FOR INFO

3" MIN

1 1/2" MAX

TOP PLATE SEE
GEN NOTES

WOOD STUD OR COL SEE
WALL FRAMING PLANS

ADD ADD'L STUD COL
ADJACENT TO PENETRATION
WHEN TRUSS IS LOCATED
CLOSER TO THE
PENETRATION THAN THE
STUD COL. SEE S4 SERIES
DWGS FOR STUD QUANTITY

TOP PLATE PENETRATION
SEE 3 / S403 FOR INFO

TRUSS/JOIST
SEE FLOOR
FRAMING PLAN

TOP PLATE SEE
GEN NOTES

WOOD STUD OR
COL SEE WALL
FRAMING PLANS

3" MAX













STUD COLUMN ALLOWABLE
PENETRATIONS SCHEDULE

Issued for Construction

WALL FRAMING & BEAM PENETRATIONS

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S403

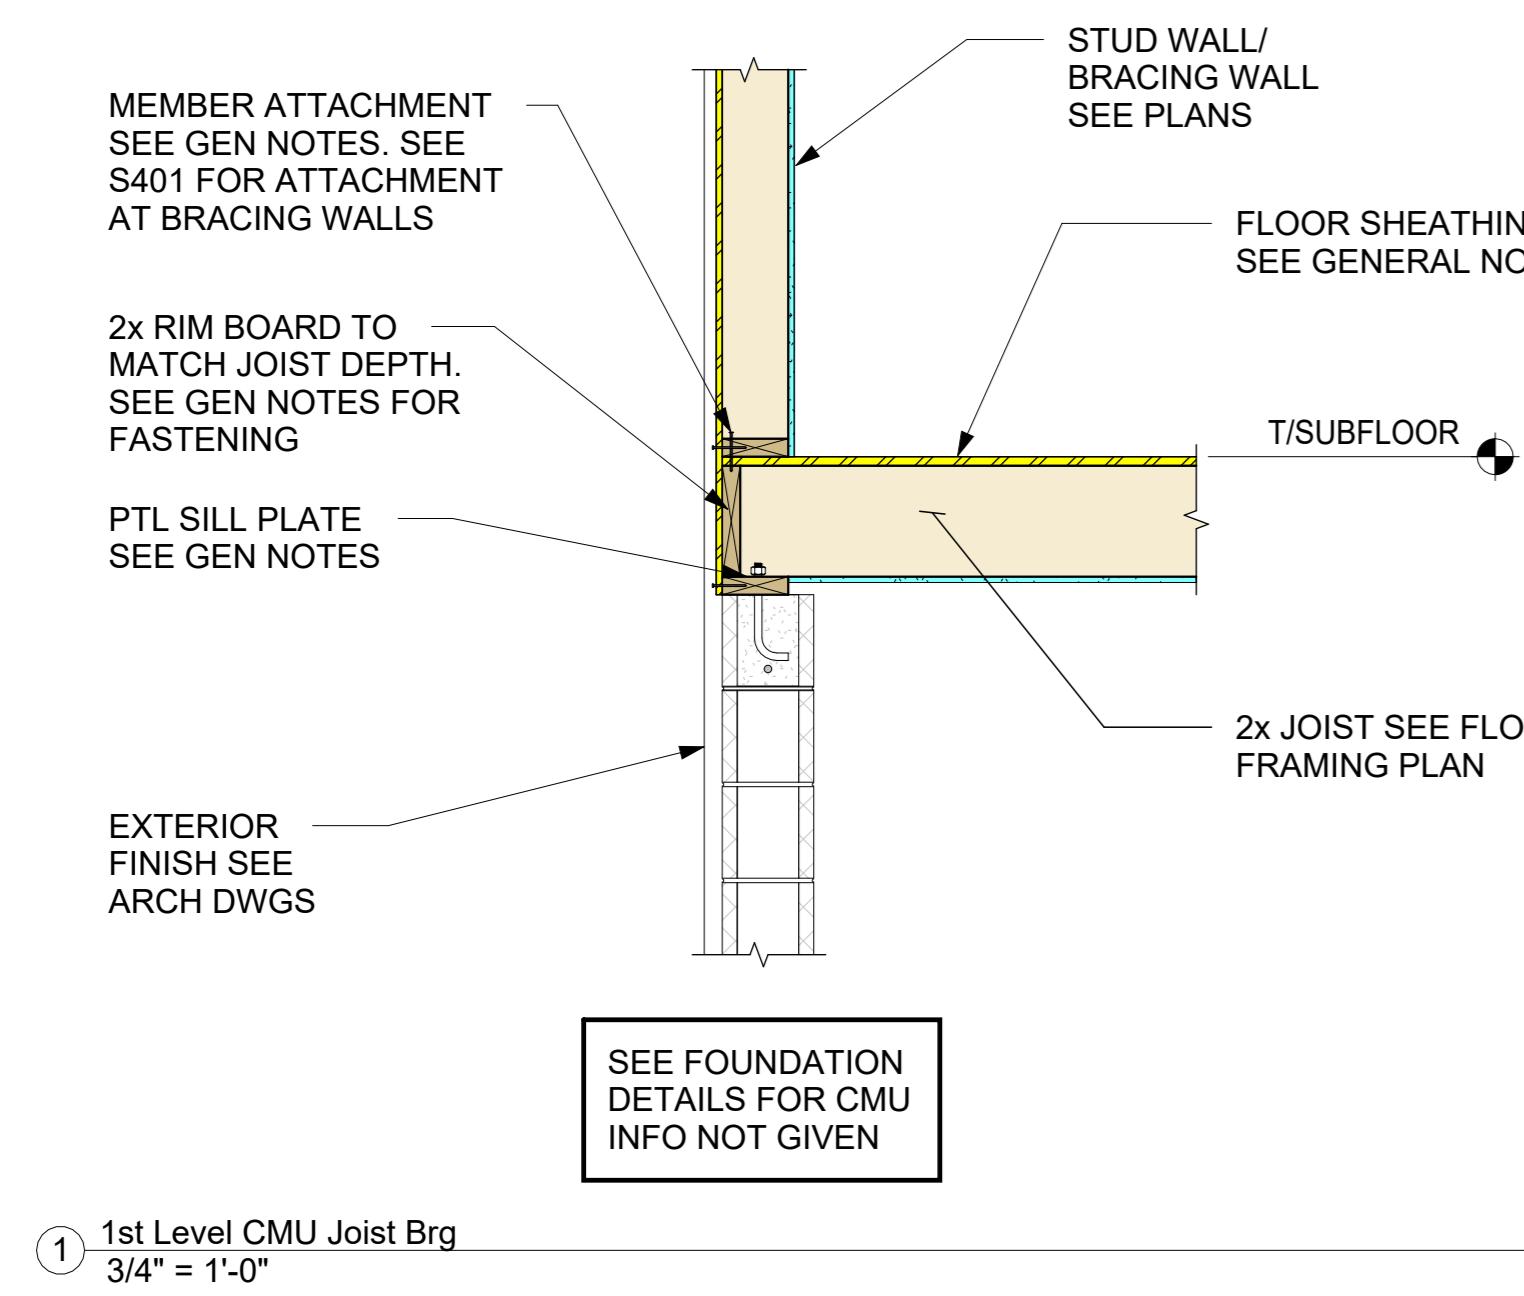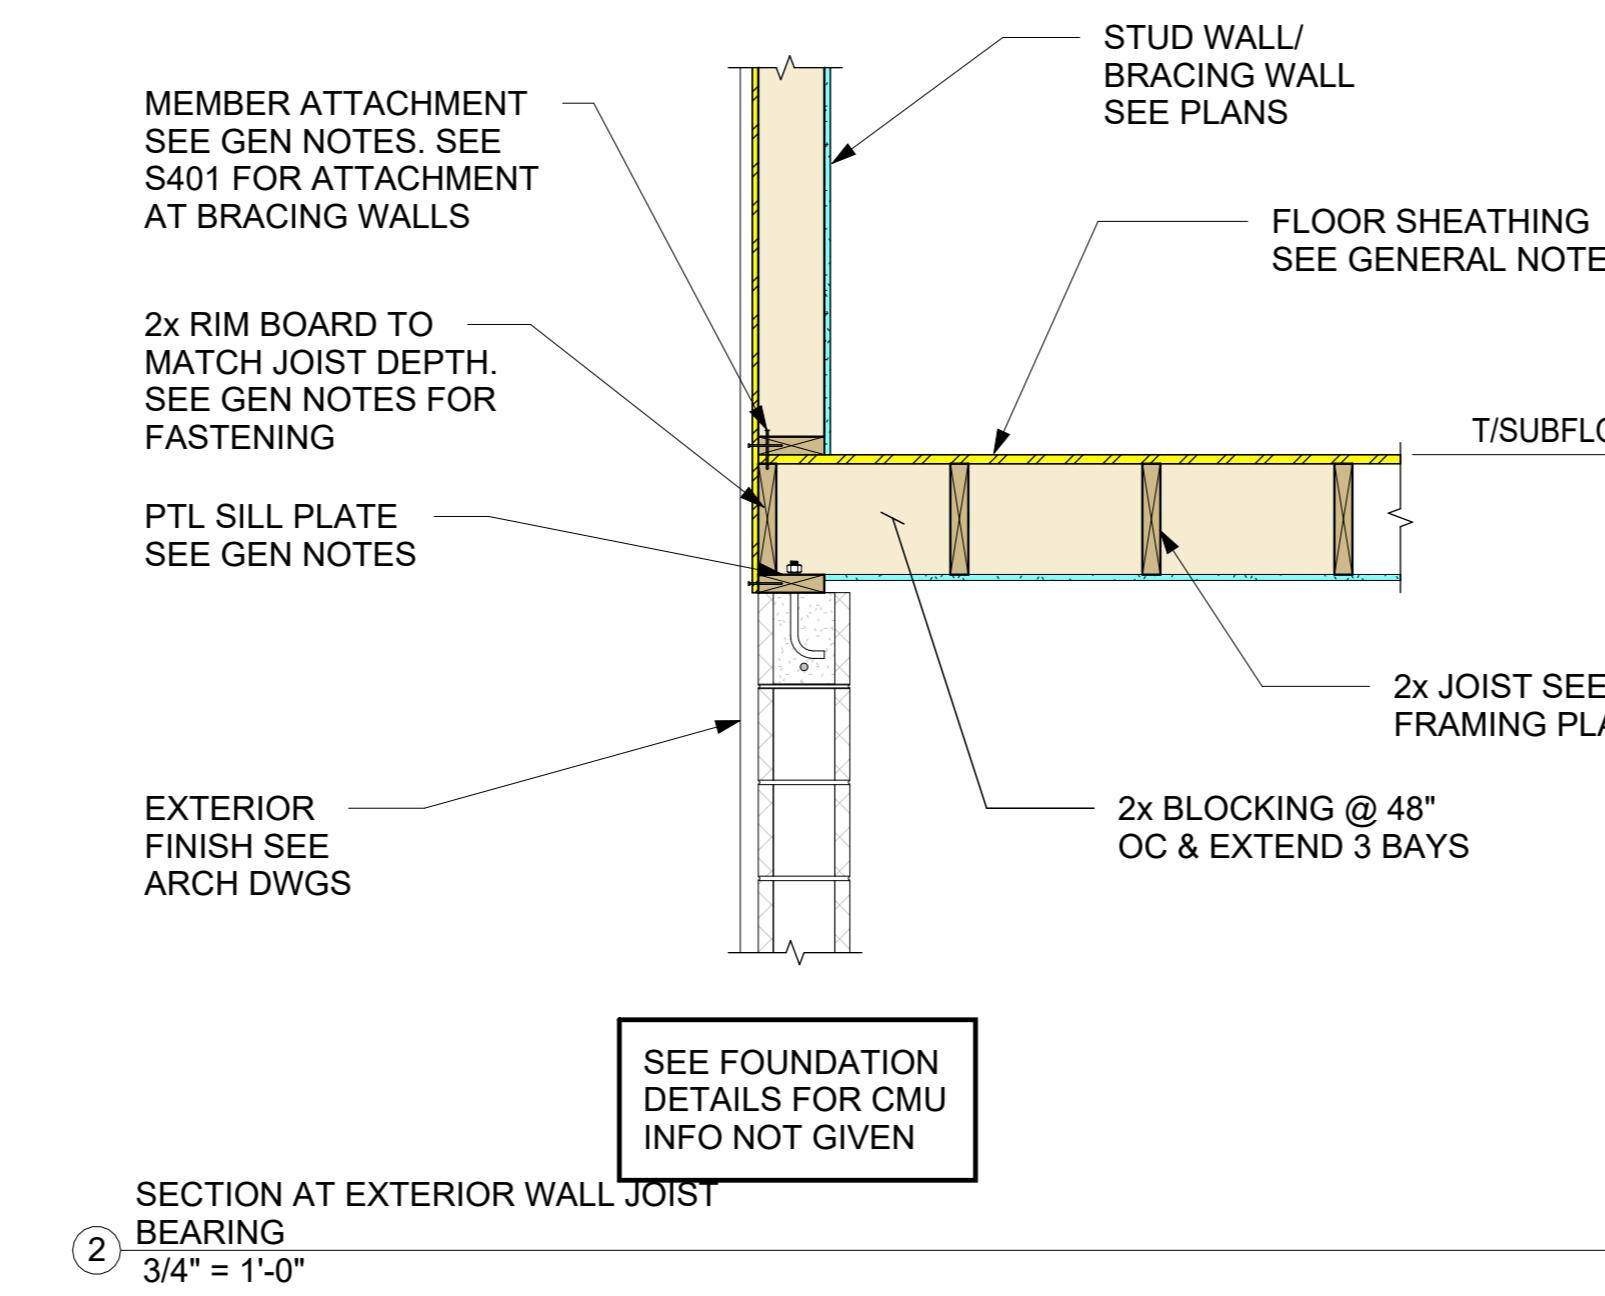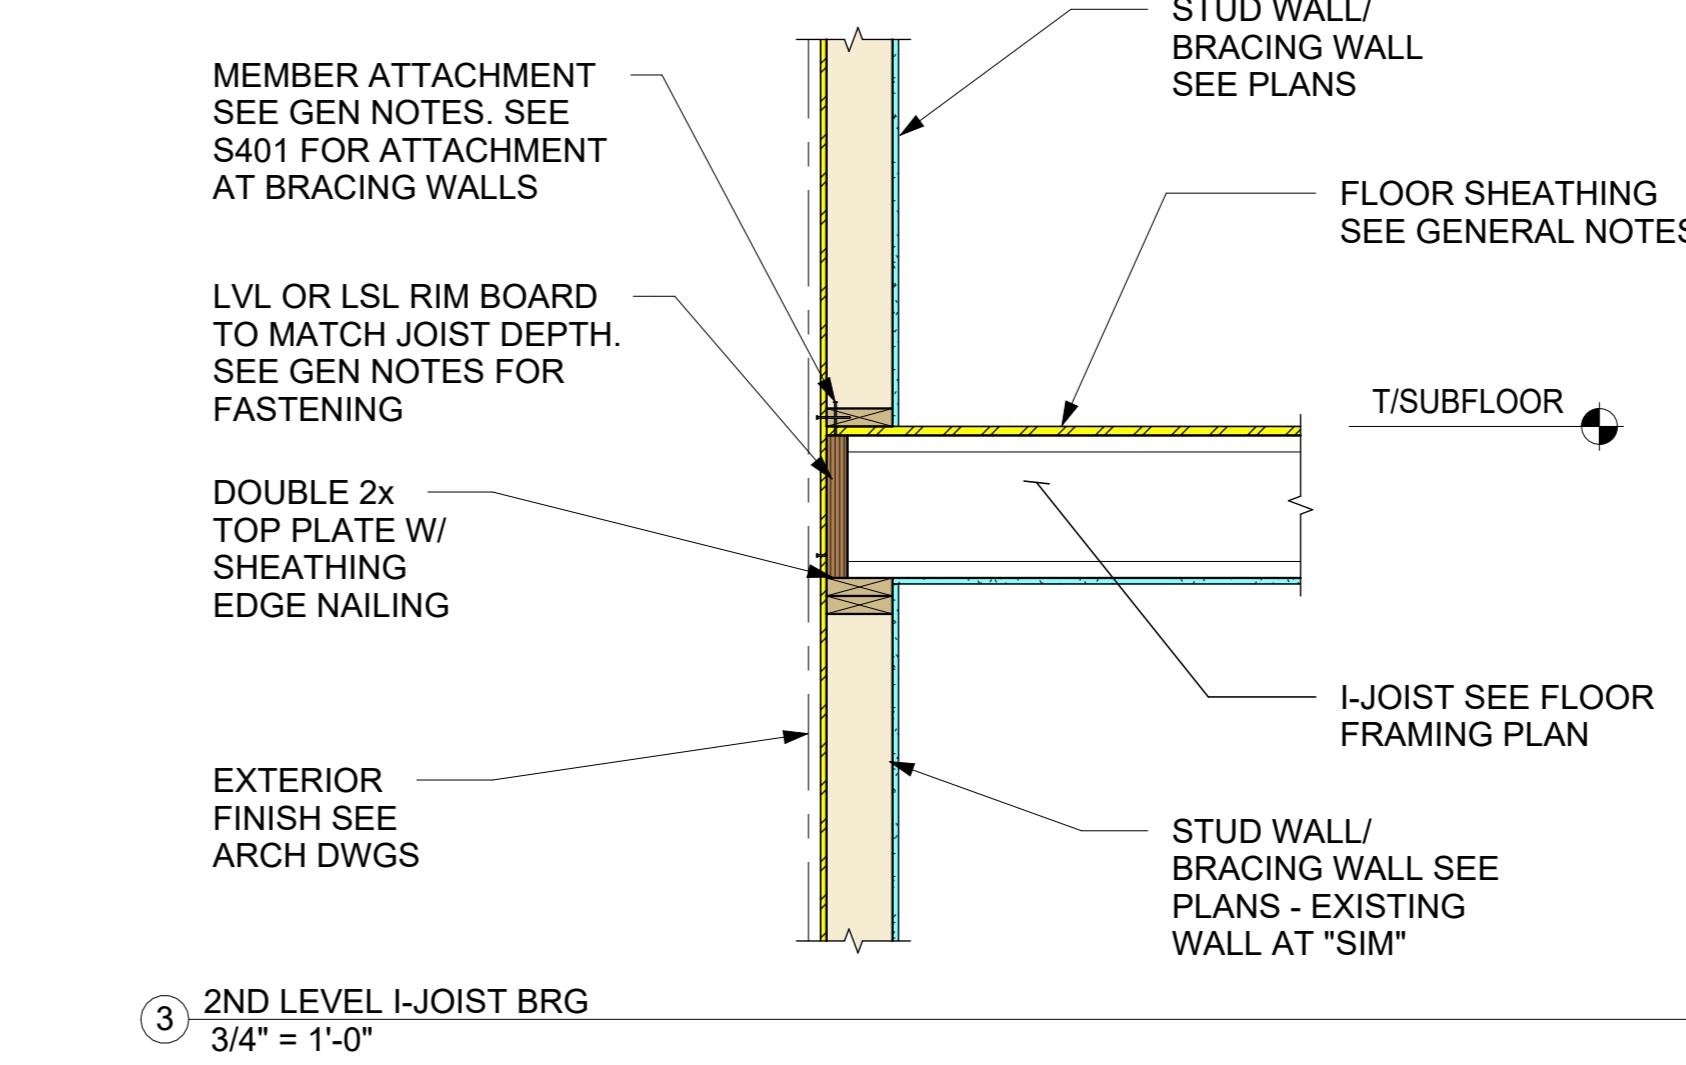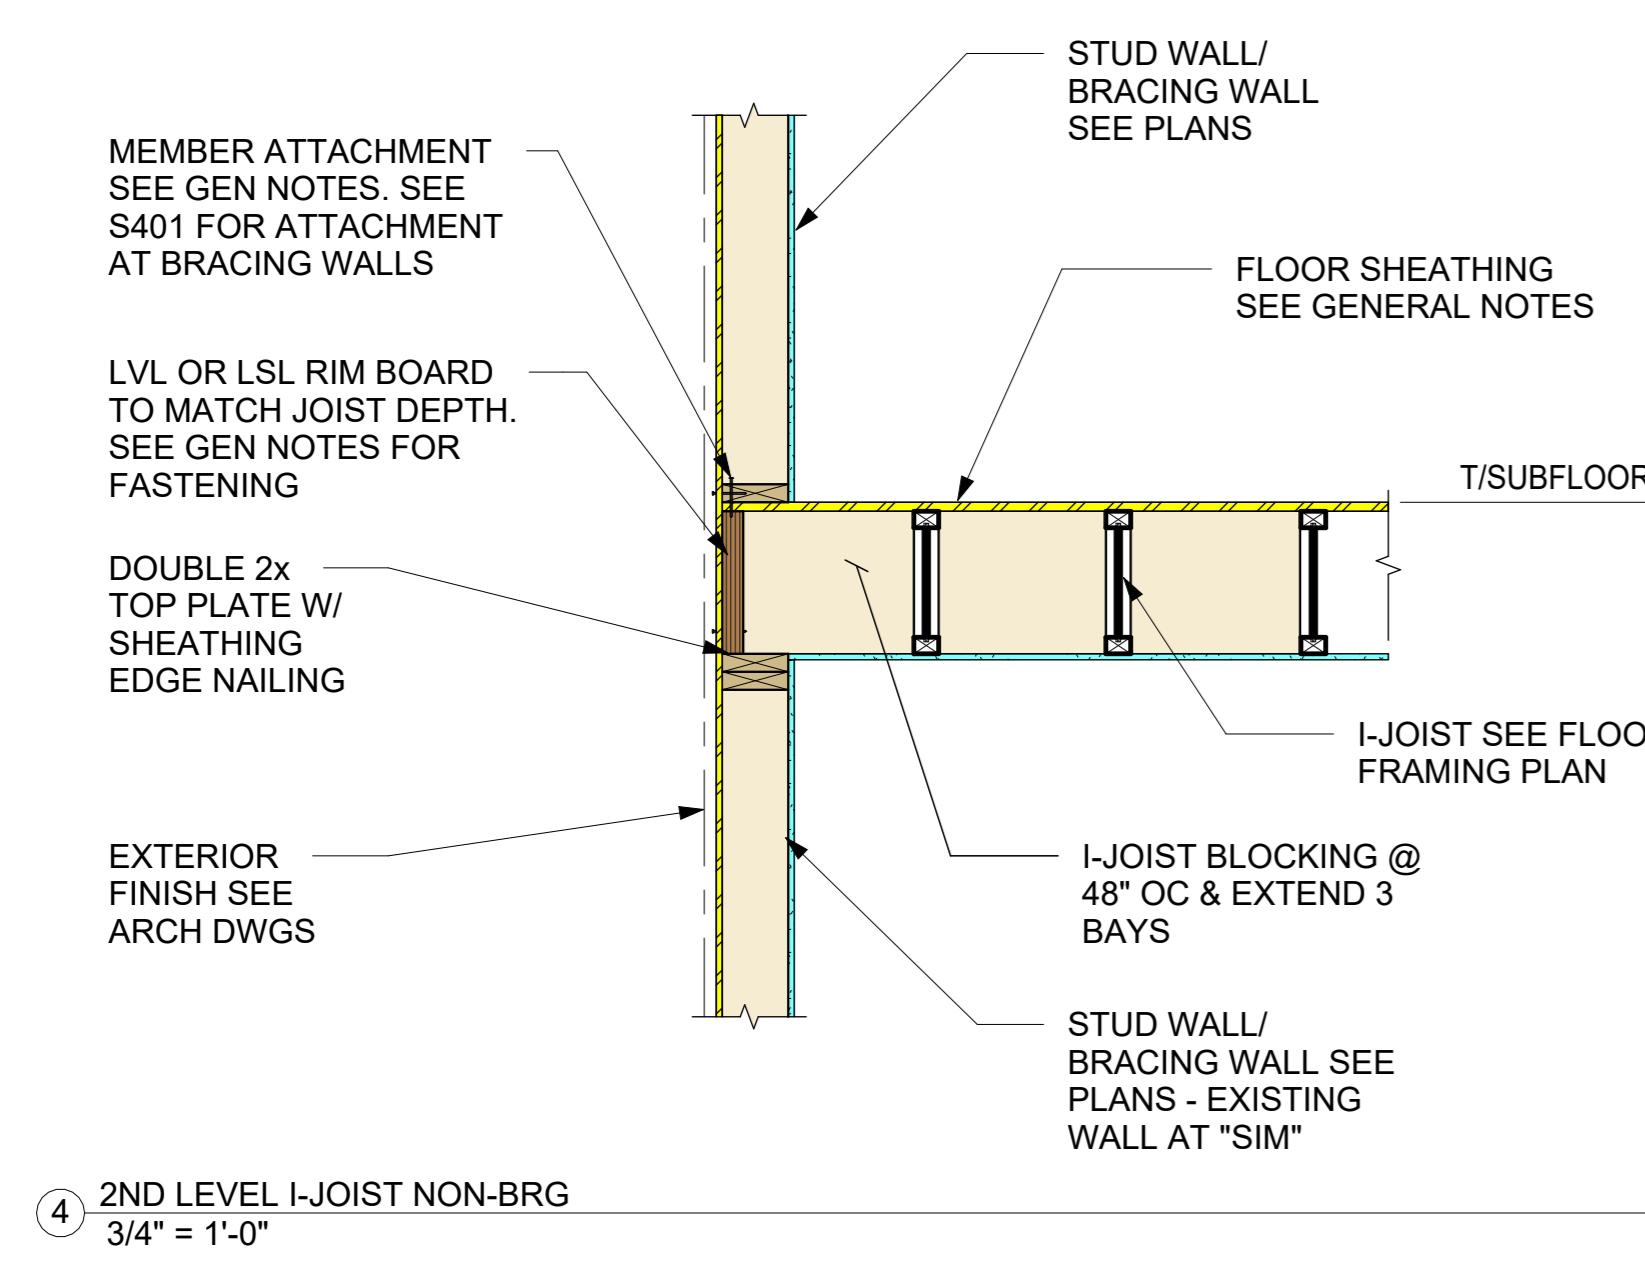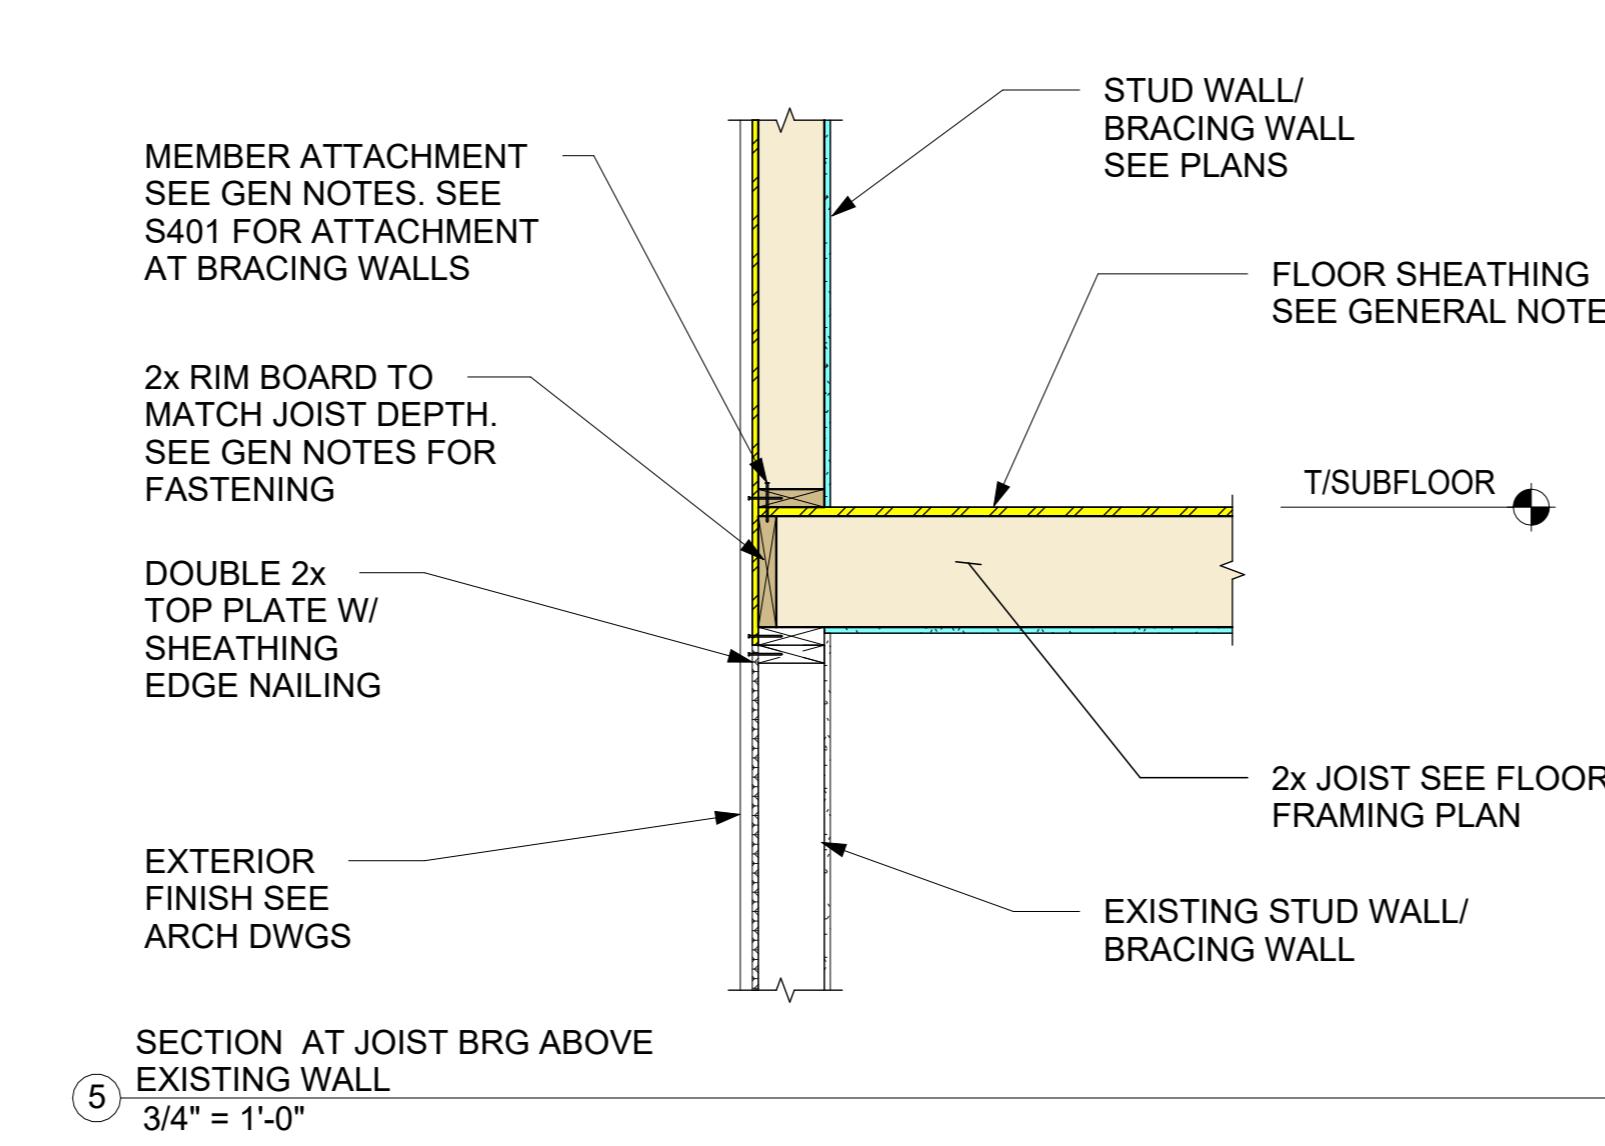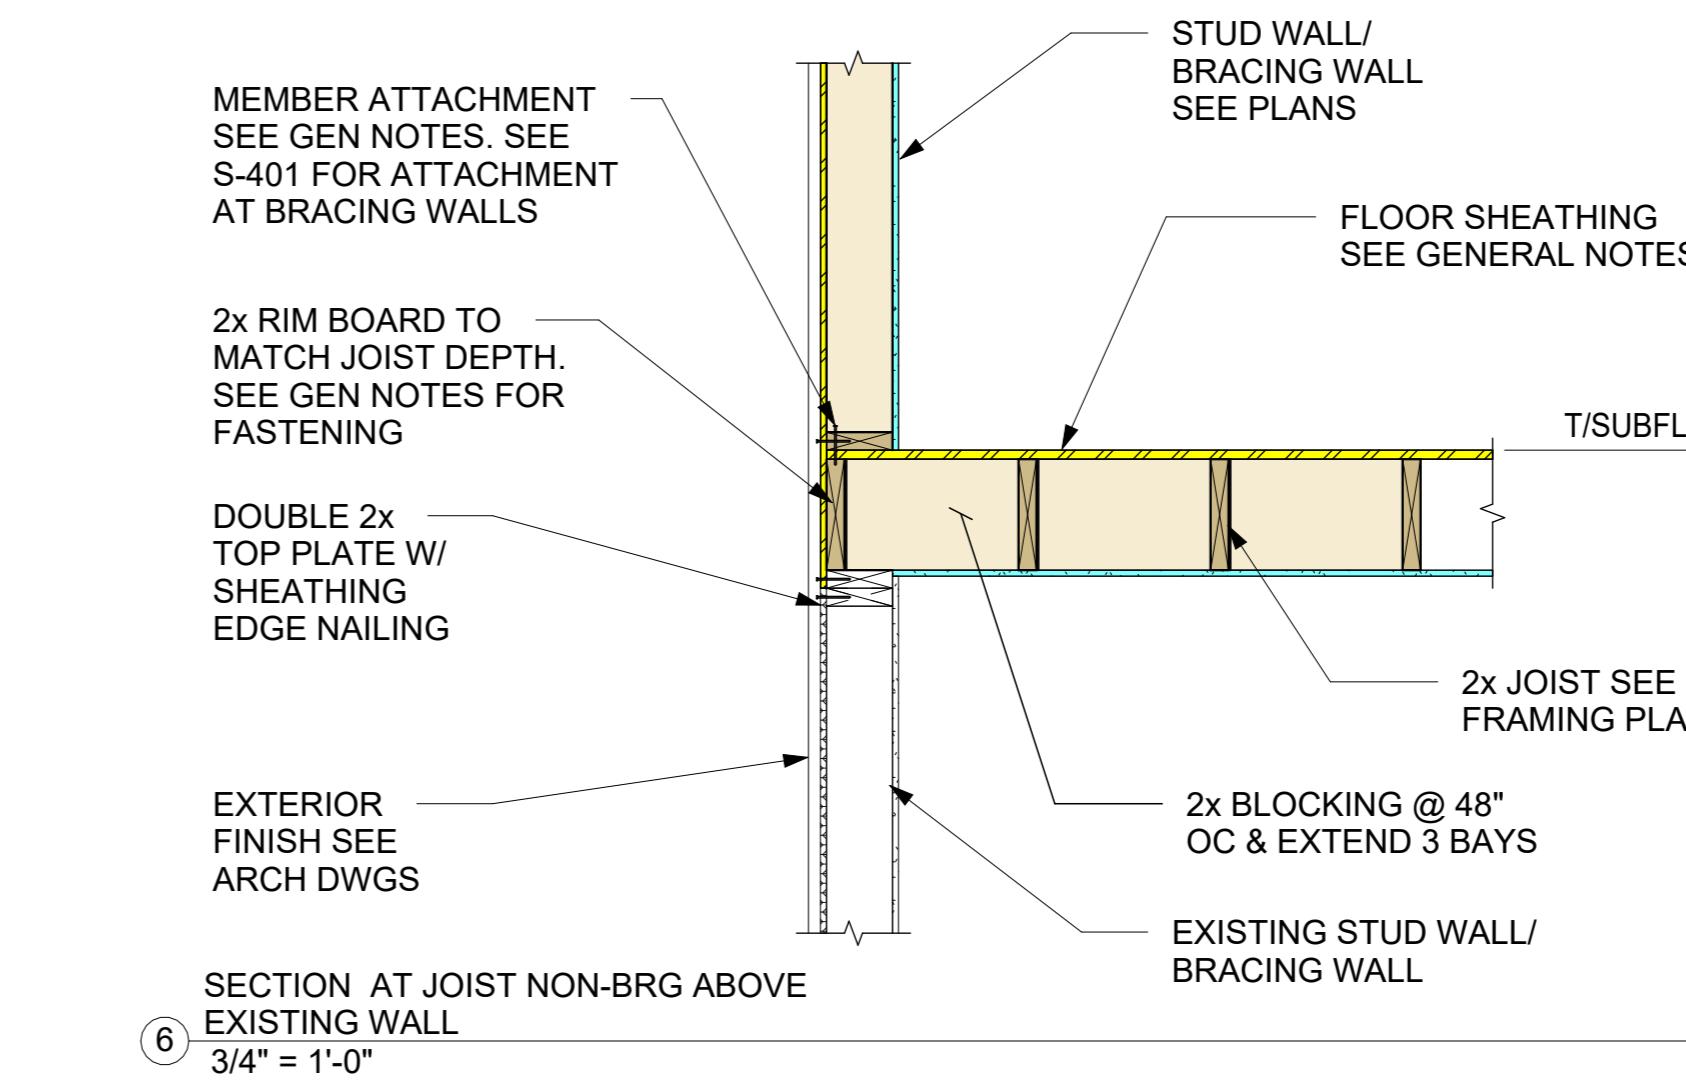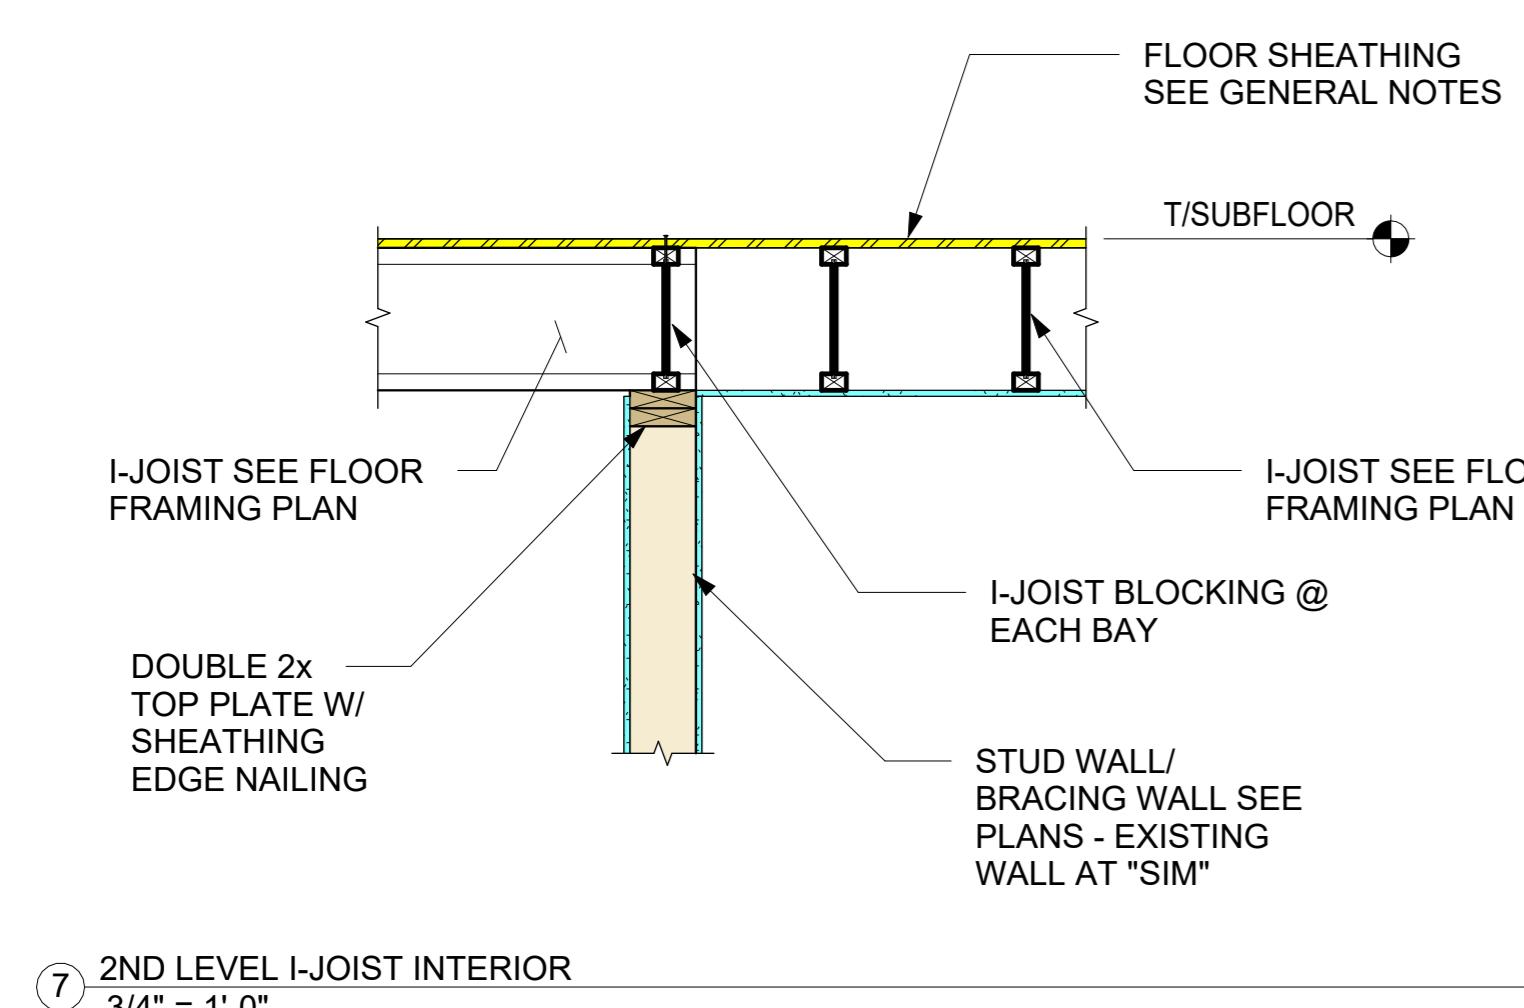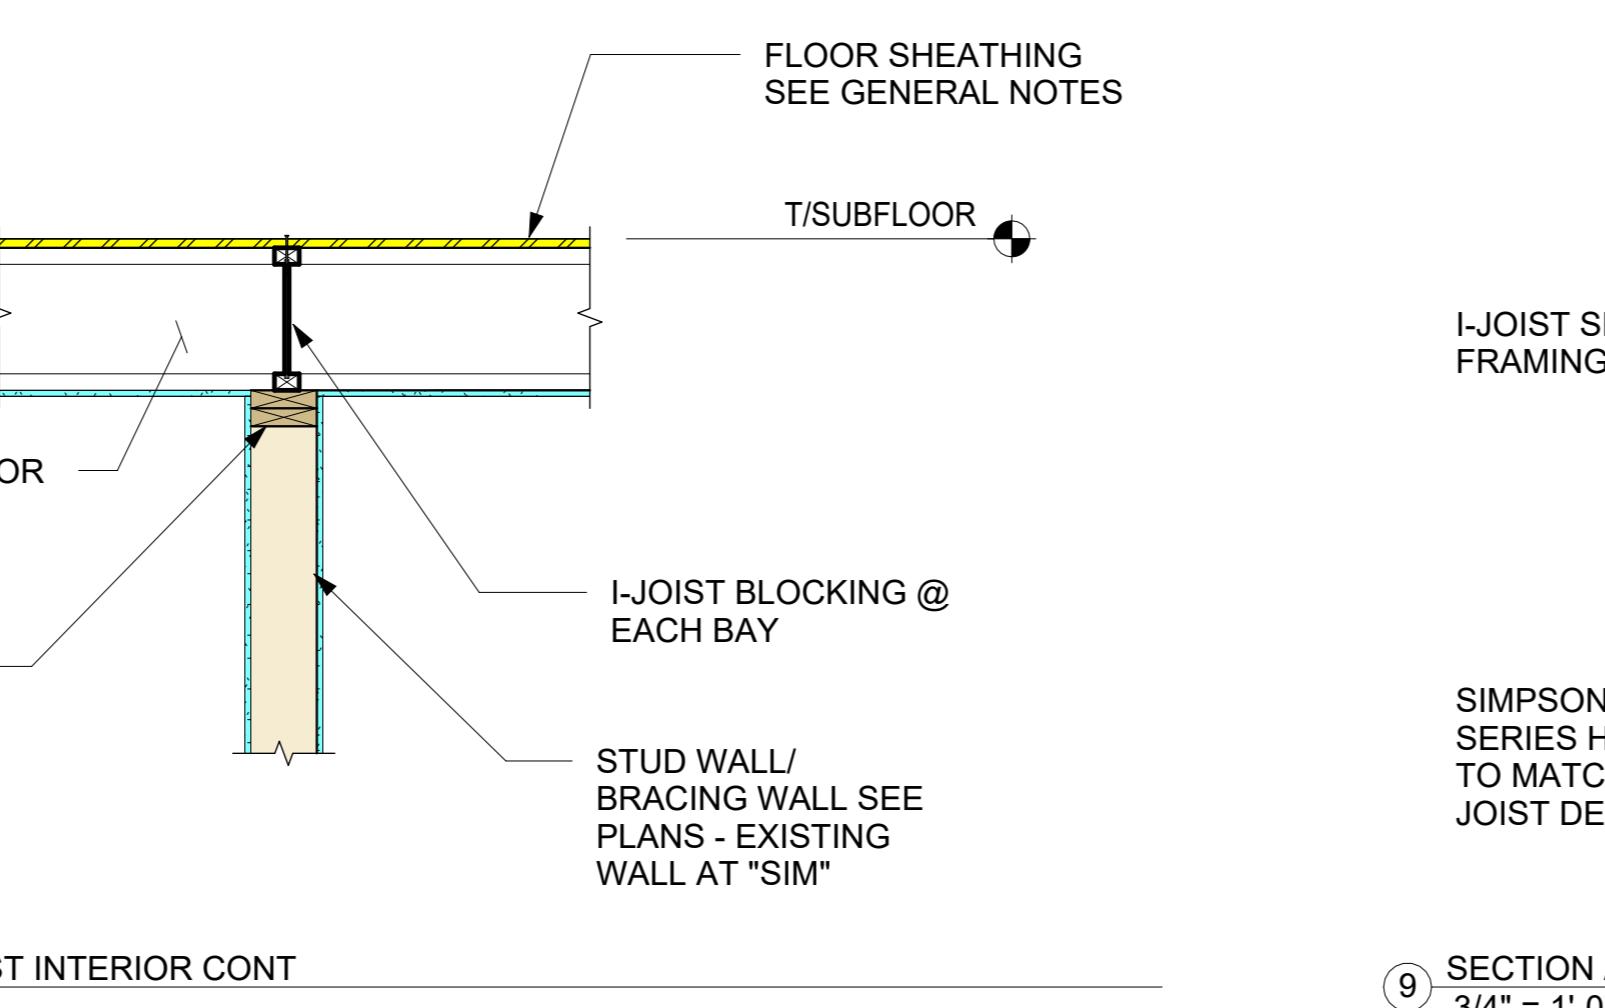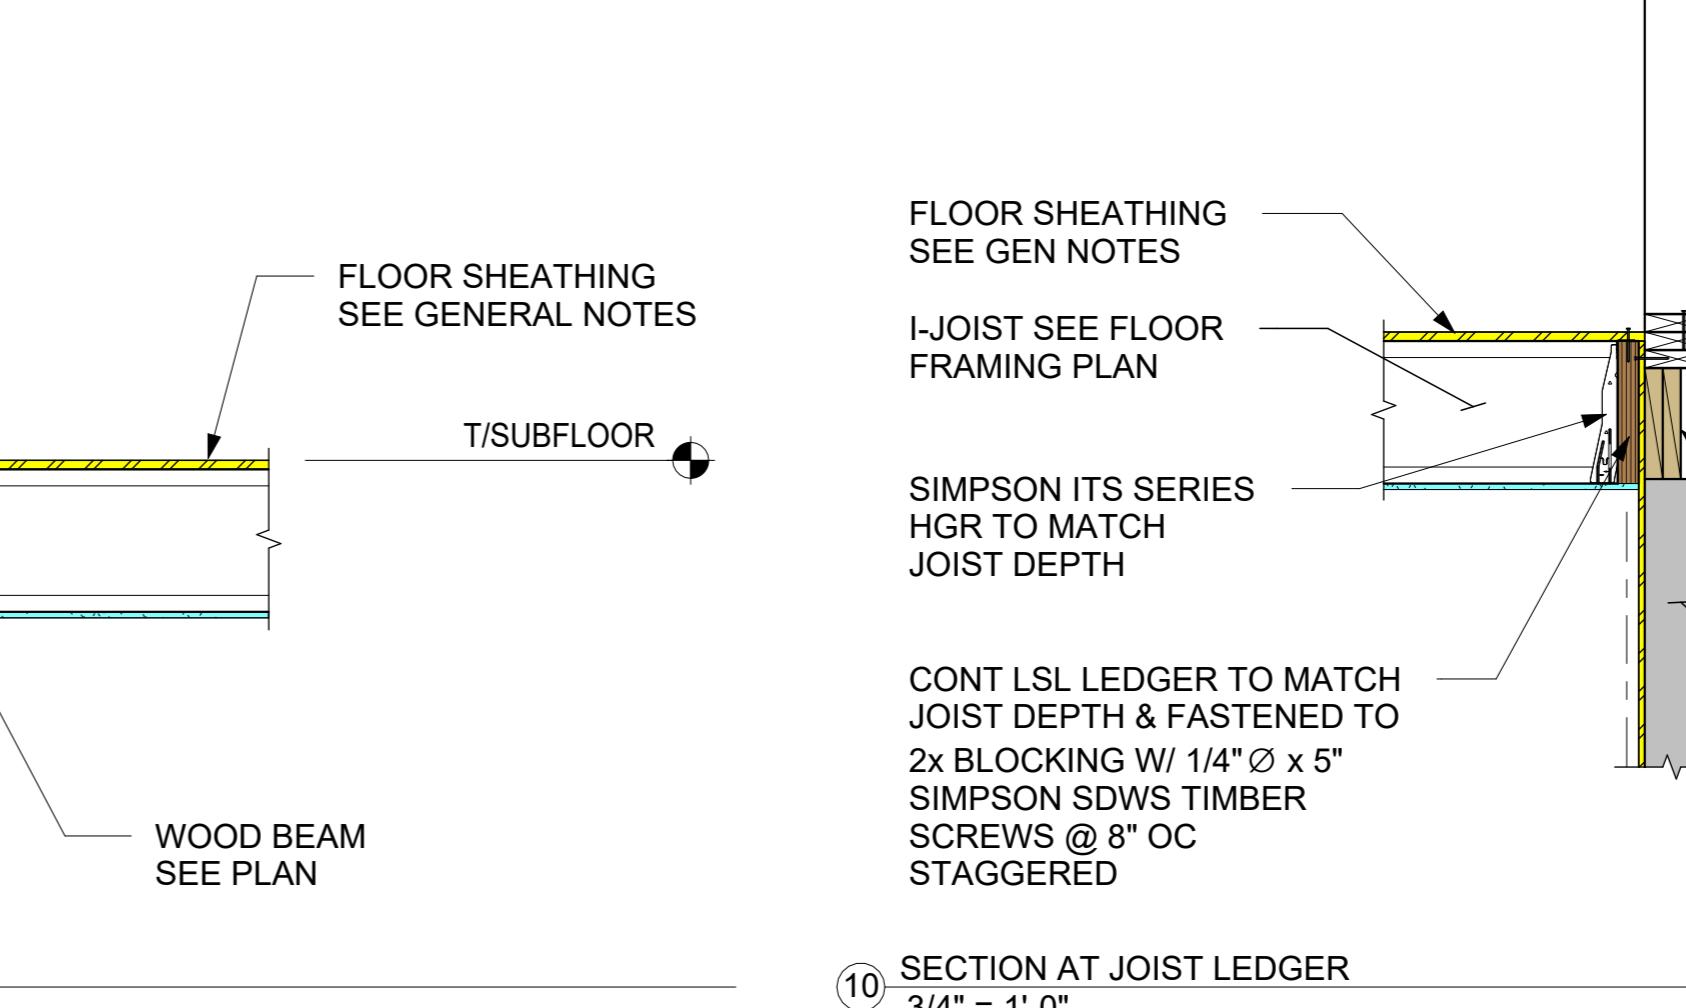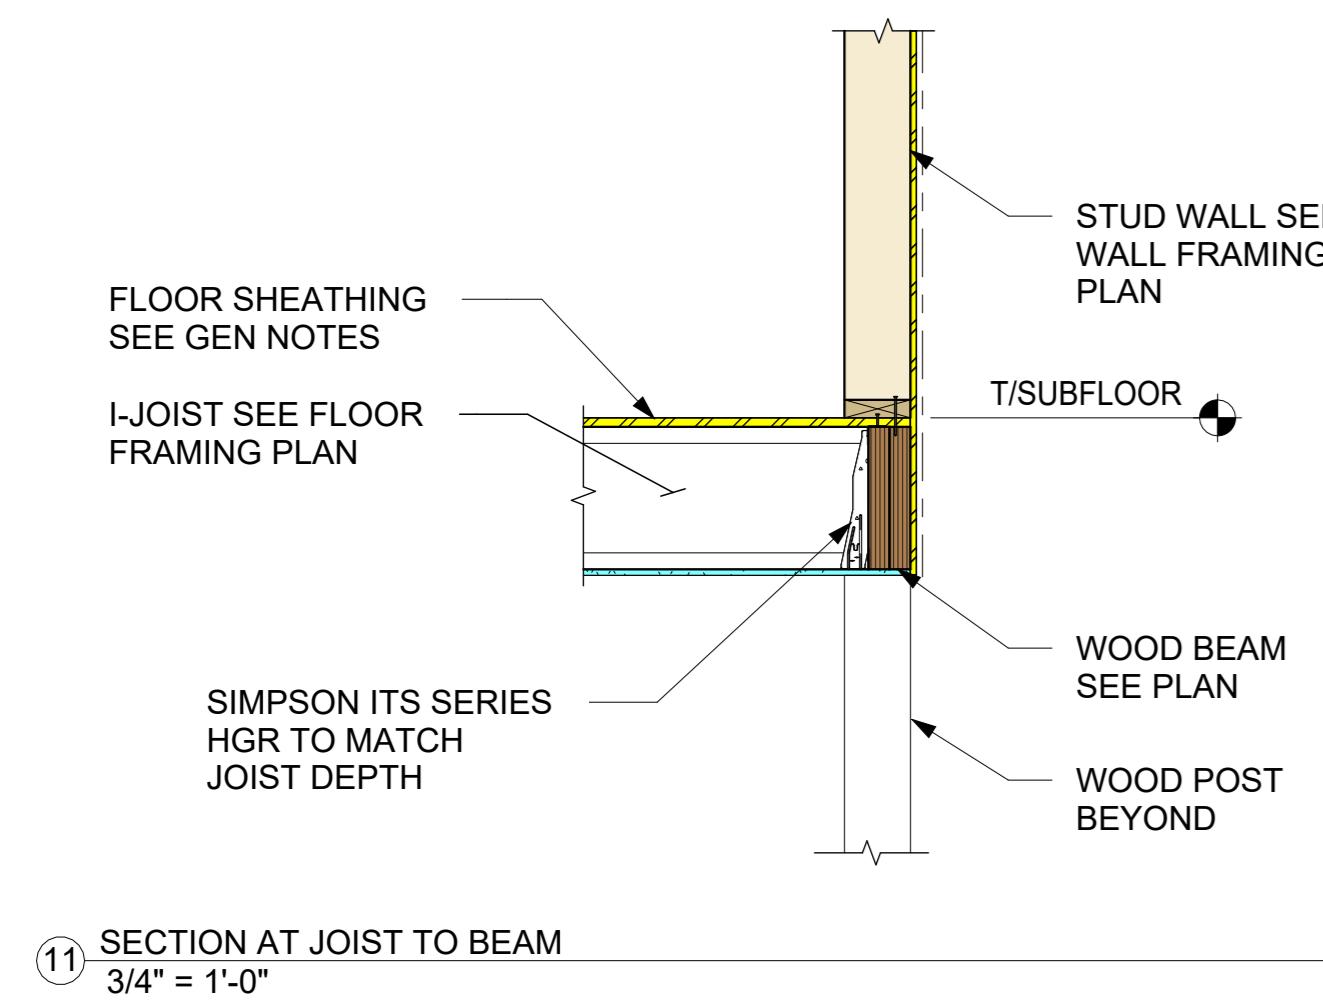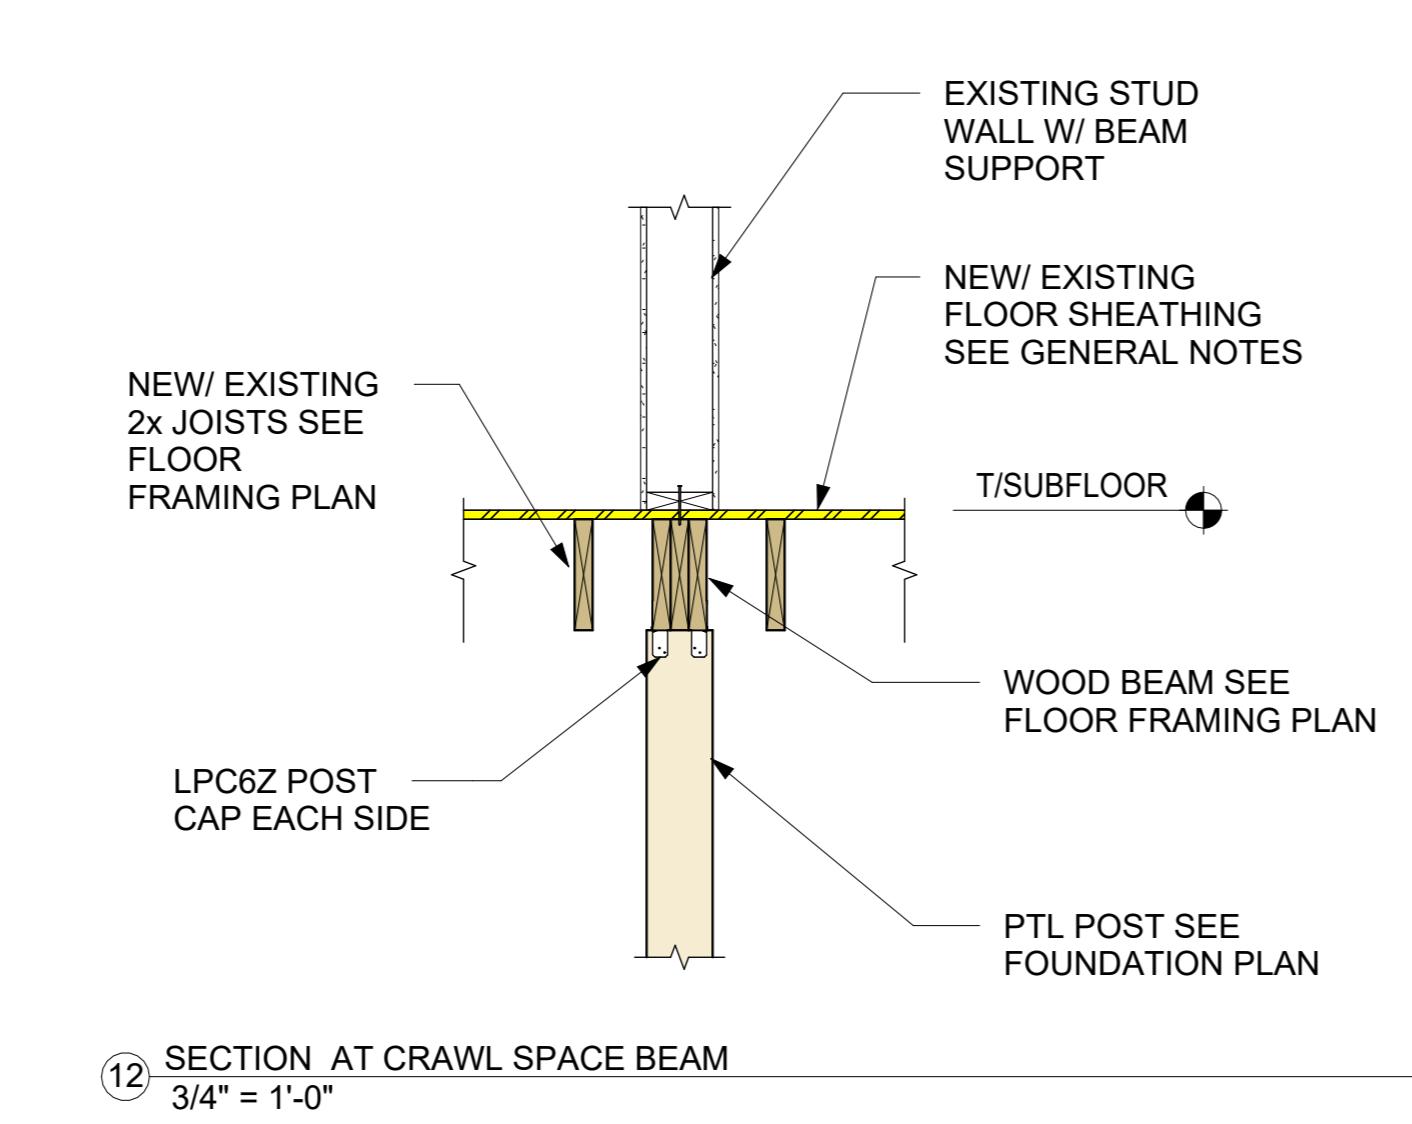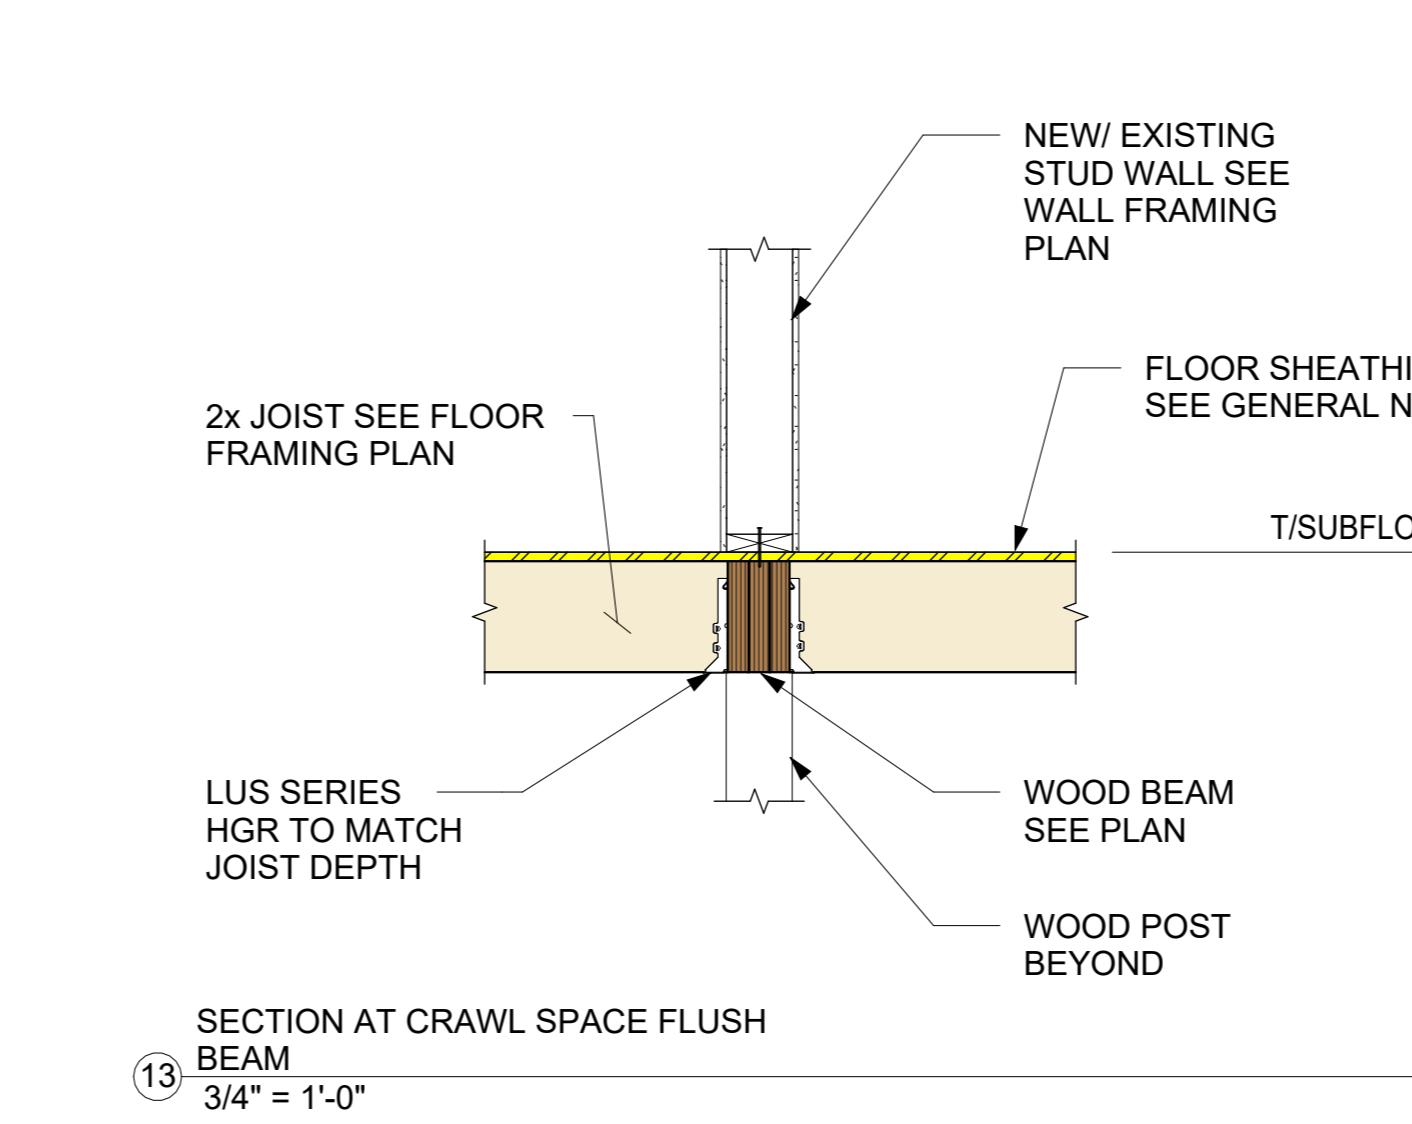① 1st Level CMU Joist Brdg
3/4" = 1'-0"② SECTION AT EXTERIOR WALL JOIST BEARING
3/4" = 1'-0"③ 2ND LEVEL I-JOIST BRG
3/4" = 1'-0"④ 2ND LEVEL I-JOIST NON-BRG
3/4" = 1'-0"⑤ SECTION AT JOIST BRG ABOVE EXISTING WALL
3/4" = 1'-0"⑥ SECTION AT JOIST NON-BRG ABOVE EXISTING WALL
3/4" = 1'-0"⑦ 2ND LEVEL I-JOIST INTERIOR
3/4" = 1'-0"⑧ 2ND LEVEL I-JOIST INTERIOR CONT
3/4" = 1'-0"⑨ SECTION AT INTERIOR FLUSH BEAM
3/4" = 1'-0"⑪ SECTION AT JOIST TO BEAM
3/4" = 1'-0"⑫ SECTION AT CRAWL SPACE BEAM
3/4" = 1'-0"⑬ SECTION AT CRAWL SPACE FLUSH BEAM
3/4" = 1'-0"

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundary
2179 Sumter Lake Drive
Marietta, GA 30062
470.357.5865
office@cleverhomellc-gc.com



November 14, 2025

Issuances		
No.	Description	Date
	Issued for Permit	11/14/25

Issued for Construction

FLOOR FRAMING SECTIONS & DETAILS

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S701

PROJECT: Fleeman Residence Remodel & Addition
245 Forest Avenue NE
Marietta, GA 30060

ARCHITECT: Made Architecture, LLC
Courtney Morrison, NCARB
453 Maple Avenue, NW
Marietta, GA 30064
404.735.2132
cmorrison@madearch.design

OWNERS: Roy and Kate Fleeman
270 Hunt Street NE
Marietta, GA 30060
Roy: 770.274.9559
royfleeman@gmail.com
Kate: katepeir@gmail.com

STRUCTURAL ENGINEER: Fernz Engineering
Michael Fernandez
488 Thomas Road
Cleveland, GA 30528
706.969.5636
mike@fernz-structural.com

GENERAL CONTRACTOR: Clever Home LLC
Karls Mundary
2179 Sumter Lake Drive
Marietta, GA 30062
470.357.5865
office@cleverhomelc-gc.com



November 14, 2025

Issuances		
No.	Description	Date
	Issued for Permit	11/14/25

**Issued for
Construction**

ROOF FRAMING SECTIONS & DETAILS

Project number	25-060
Date	10/15/2025
Drawn by	MRF
Checked by	MRF

S801

